

NFPA[®]

1141

**Standard for Fire Protection
Infrastructure for Land
Development in Wildland, Rural,
and Suburban Areas**

2017



IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® DOCUMENTS

NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA DOCUMENTS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that NFPA Standards may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendment and any Errata then in effect.

In order to determine whether an NFPA Standard has been amended through the issuance of Tentative Interim Amendments or corrected by Errata, visit the Document Information Pages on NFPA’s website. The Document Information Pages provide up-to-date, document specific information including any issued Tentative Interim Amendments and Errata.

To access the Document Information Page for a specific NFPA Standard, go to <http://www.nfpa.org/docinfo> to choose from the list of NFPA Standards or use the search feature on the right to select the NFPA Standard number (e.g., NFPA 101). The Document Information page includes postings of all existing Tentative Interim Amendments and Errata. It also includes the option to register for an “Alert” feature to receive an automatic email notification when new updates and other information are posted regarding the document.

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

ADDITIONAL NOTICES AND DISCLAIMERS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed below.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/freeaccess.

Copyright © 2016 National Fire Protection Association®. All Rights Reserved.

NFPA®1141

Standard for

Fire Protection Infrastructure for Land Development in Wildland, Rural, and Suburban Areas

2017 Edition

This edition of NFPA 1141, *Standard for Fire Protection Infrastructure for Land Development in Wildland, Rural, and Suburban Areas*, was prepared by the Technical Committee on Wildland and Rural Fire Protection. It was issued by the Standards Council on May 13, 2016, with an effective date of June 2, 2016, and supersedes all previous editions.

This edition of NFPA 1141 was approved as an American National Standard on June 2, 2016.

Origin and Development of NFPA 1141

Work on NFPA 1141 began in 1972 by the former Technical Committee on Suburban and Rural Fire Prevention and Promotion in response to needs expressed by several members. Several drafts were prepared, and a document was adopted by the Correlating Committee on Suburban and Rural Fire Protection and Prevention (predecessor to the current committee) for presentation at the 1977 Annual Meeting. Due to technical problems, the standard was withdrawn from the meeting agenda. Following reorganization of the committee in 1982, a task group undertook a review and update of the 1977 document, which resulted in the 1985 edition prepared by the committee. The current committee revised the 1985 edition, resulting in the 1990 edition.

The committee's proposed revision for the 1995 edition was returned to the committee to clarify specific issues on conflicting requirements between NFPA 1141 and NFPA 1144, and other requirements and NFPA 1 and NFPA 101®. The requisite changes resulted in moving the document to a 1998 revision cycle.

In the 1998 edition, the committee was able to resolve many issues in clarity and consistency by bringing the document into concert with NFPA 1 and NFPA 101. Because of specific fire protection circumstances found in rural areas (as listed in the revised scope and purpose of the document), the committee continued to require that some elements remain more restrictive than comparable elements referenced in other NFPA documents.

In the 2003 edition, the technical committee responded to the rapid development of structures into areas that present unusual characteristics to responding fire agencies and worked extensively on making NFPA 1141 current with other documents and more usable by adopting jurisdictions. The committee was particularly interested in keeping the flexibility in the application of the standard by jurisdictions so that it works with existing codes and standards that may or may not adequately cover planned building groups.

In the 2008 edition, the scope of the document was revised to focus on providing guidance on the development of the community infrastructure necessary to eliminate fire protection problems that result from rapid growth and change. The title change from *Fire Protection in Planned Building Groups* to *Fire Protection Infrastructure for Land Development in Suburban and Rural Areas* also reflected this broader look at the challenges facing suburban and rural areas. While creating the 2008 edition, the technical committee concurrently revised NFPA 1144 to provide complementary documents for fire protection in suburban and rural development, including special considerations for wildland interface areas. As a result, the requirements for community infrastructure (e.g., roads, water supplies) were moved from the 2001 edition of NFPA 1144 to this document, and additional guidance was taken from the USDA Forest Service and the National Wildland/Urban Interface Fire Program (Firewise Communities), as well as input from several committee members and outside experts.

In the 2012 edition, the technical committee expanded the scope to include wildland, rural, and suburban areas. In an effort to be consistent with that change, the title of the 2012 edition was changed to NFPA 1141, *Standard for Fire Protection Infrastructure for Land Development in Wildland, Rural, and Suburban Areas*. Substantial changes in this edition included new material with guidance on the appeals process, clarification on planning, and the addition of dead ends as a subsection of roadways.

In the 2017 edition, the technical committee clarified that the applicant for land use is responsible for providing documentation and maps to the authority having jurisdiction (AHJ) for review. The text in the previous edition may have been ambiguous in suggesting that the AHJ was responsible, which was not the intention of the technical committee. Various definitions have been revised to offer greater consistency across other, similar technical committee documents. Chapter 7, Premises Identification, has been added to the document. This chapter was implemented to assist responders in identifying residences, particularly in rural areas, that are located far apart or in secluded areas. The technical committee also has clarified which standard applies to certain water main and fire hydrant installations based on property ownership.

Technical Committee on Wildland and Rural Fire Protection

Rick L. Swan, Chair

IAFF Local 2881/CDF Fire Fighters, CA [L]
Rep. International Association of Fire Fighters

Gregory A. Bartlett, Brandon University, Rural Development Institute, Canada [SE]

Randall K. Bradley, Stanislaus Consolidated Fire Protection District, CA [E]

Vernon Champlin, NE Teller County Fire Protection District, CO [E]

Erik W. Christiansen, Exponent, Inc., CA [SE]

Richard A. Darby, Clay County Fire Rescue Department, FL [L]
Rep. National Volunteer Fire Council

David Doudy, City of Farmington Fire Department, NM [U]

Michael J. Gollner, University of Maryland, MD [RT]

Dustin Green, Citrus County Sheriffs Office, FL [U]

Donald J. Griego, State of New Mexico, NM [E]

Bill Hendricks, Safer Building Solutions, CA [M]

Joseph T. Holland, Hoover Treated Wood Products, FL [M]

Kelly Johnston, Wildland Professional Solutions, Canada [SE]

Justice J. Jones, Austin Fire Department, TX [U]

Wesley M. Keller, Pennsylvania Bureau of Forestry, PA [U]

Jeremy A. Keller, Macochee Joint Ambulance District, OH [E]

Robert J. Kowalski, Nationwide Insurance Companies, OH [I]

Kevin P. Kuntz, Insurance Services Office, Inc., NJ [II]

Matthew Y. Lee, CAL FIRE, CA [E]

Alexander Maranghides, National Institute of Standards & Technology, MD [RT]

Don Oaks, California Fire Chief's Association, CA [SE]

Paul Prevost, Clearwater Regional Fire Rescue Service, Canada [U]

Stephen Quarles, Insurance Institute for Business & Home Safety, SC [I]

Clifford C. Roberts, American International Group, Inc. (AIG), FL [I]

Rob Rosovich, FireIce Inc., FL [M]

Ernie Schmidt, 3M Company, MN [M]

Gregory Schreiner, San Diego County Fire Authority, CA [E]

Deborah L. Shaner, Shaner Life Safety, CO [SE]

Amy Ray Solaro, Truckee Meadows Fire Protection District, NV [E]

David P. Tyree, American Wood Council, CO [M]

Alternates

Hubert Biteau, Exponent, Inc., MD [SE]
(Alt. to Erik W. Christiansen)

Nelson P. Bryner, National Institute of Standards & Technology, MD [RT]
(Alt. to Alexander Maranghides)

Vladimir Ignatenko, American International Group, Inc. (AIG), CA [I]
(Alt. to Clifford C. Roberts)

Steve Oaks, Santa Barbara County Fire Department, CA [SE]
(Alt. to Don Oaks)

Thomas McGowan, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This committee shall have the primary responsibility for documents on fire protection in wildland, rural, and suburban areas.

Contents

| | | | |
|--|-----------------|---|-----------------|
| Chapter 1 Administration | 1141- 5 | 7.2 Visibility. | 1141- 12 |
| 1.1 Scope. | 1141- 5 | Chapter 8 Fire Protection | 1141- 12 |
| 1.2 Purpose. | 1141- 5 | 8.1 Automatic Fire Protection. | 1141- 12 |
| 1.3 Application. | 1141- 5 | 8.2 Manual Fire Protection. | 1141- 12 |
| Chapter 2 Referenced Publications | 1141- 6 | 8.3 Automatic Fire Warning Systems. | 1141- 13 |
| 2.1 General. | 1141- 6 | Chapter 9 Water Supply | 1141- 13 |
| 2.2 NFPA Publications. | 1141- 6 | 9.1 General. | 1141- 13 |
| 2.3 Other Publications. | 1141- 6 | 9.2 Water Supply Distribution. | 1141- 14 |
| 2.4 References for Extracts in Mandatory Sections. | 1141- 7 | 9.3 Areas with Municipal-Type Water Systems. | 1141- 14 |
| 9.4 Acceptance. | 1141- 7 | 9.4 Acceptance. | 1141- 14 |
| Chapter 3 Definitions | 1141- 7 | Chapter 10 Fire Protection During Construction | 1141- 14 |
| 3.1 General. | 1141- 7 | 10.1 General Requirements. | 1141- 14 |
| 3.2 NFPA Official Definitions. | 1141- 7 | 10.2 Extinguishing Equipment. | 1141- 14 |
| 3.3 General Definitions. | 1141- 7 | Chapter 11 Community Safety and Emergency Preparedness | 1141- 15 |
| Chapter 4 General Requirements | 1141- 8 | 11.1 General. | 1141- 15 |
| 4.1 General. | 1141- 8 | 11.2 Assessment of Hazards. | 1141- 15 |
| 4.2 Noncombustible Material. [5000:7.1.4.1] | 1141- 8 | 11.3 Operational Plan. | 1141- 15 |
| Chapter 5 Means of Access | 1141- 9 | Chapter 12 Capacity of Fire Protection Services. | 1141- 15 |
| 5.1 General. | 1141- 9 | 12.1 Assessment. | 1141- 15 |
| 5.2 Roadways. | 1141- 9 | 12.2 Mitigation. | 1141- 16 |
| 5.3 Fire Lanes. | 1141- 10 | Annex A Explanatory Material | 1141- 16 |
| 5.4 Parking Lots. | 1141- 11 | Annex B Informational References | 1141- 19 |
| Chapter 6 Building Access and Separation | 1141- 11 | Index | 1141- 20 |
| 6.1 General. | 1141- 11 | | |
| 6.2 Building Separation. | 1141- 12 | | |
| Chapter 7 Premises Identification | 1141- 12 | | |
| 7.1 General. | 1141- 12 | | |

NFPA 1141

Standard for

Fire Protection Infrastructure for Land Development in Wildland, Rural, and Suburban Areas

2017 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading "Important Notices and Disclaimers Concerning NFPA Documents." They can also be obtained on request from NFPA or viewed at www.nfpa.org/disclaimers.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with any TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by any TIAs or Errata, please consult the National Fire Codes® Subscription Service or visit the Document Information (DocInfo) pages on the NFPA website at www.nfpa.org/docinfo. In addition to TIAs and Errata, the DocInfo pages also include the option to sign up for Alerts for each document and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in mandatory sections of the document are given in Chapter 2 and those for extracts in informational sections are given in Annex B. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex B.

Chapter 1 Administration

1.1* Scope. This standard covers the requirements for the fire protection infrastructure in wildland, rural, and suburban areas where there is an intended change of land use or intended land development.

1.2 Purpose. The purpose of this standard is to develop fire protection and emergency services infrastructure to reduce the impact of land use changes in wildland, rural, and suburban areas.

1.3 Application.

1.3.1* This standard shall apply to land development or changes in land use in wildland, rural, and suburban areas.

1.3.1.1 Wildland Areas. In addition to other requirements in this standard, land use changes in wildland areas shall be subject to the requirements in NFPA 1144.

1.3.1.2 All new construction in wildland/urban interface areas shall be designed, located, and constructed to comply with NFPA 1144.

1.3.2 If the authority having jurisdiction (AHJ) determines that additions to existing structures or new structures have a negative impact on the fire protection of existing land use, the requirements of this standard shall be permitted to be imposed.

1.3.3 Equivalencies, Alternatives, and Modifications.

1.3.3.1 Equivalencies. Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety to those prescribed by this standard, provided technical documentation is submitted to the AHJ to demonstrate equivalency and the system, method, or device is approved for the intended purpose.

1.3.3.2 Alternatives. The specific requirements of this standard shall be permitted to be altered by the AHJ to allow alternative methods that will secure equivalent fire safety, but in no case shall the alternative afford less fire safety, in the judgment of the AHJ, than that which would be provided by compliance with the provisions contained in this standard.

1.3.3.3 Modifications. The AHJ is authorized to modify any of the provisions of this standard upon application in writing by the owner, a lessee, or a duly authorized representative where there are practical difficulties in the way of carrying out the provisions of the standard, provided that the intent of the standard shall be complied with, public safety secured, and substantial justice done.

1.3.3.4 Buildings with equivalency, alternatives, or modifications approved by the AHJ shall be considered as conforming with this standard.

1.3.3.5 Each application for an alternative fire protection feature shall be filed with the AHJ and shall be accompanied by such evidence, letters, statements, results of tests, or other supporting information as required to justify the request. The AHJ shall keep a record of actions on such applications, and a signed copy of the AHJ's decision shall be provided for the applicant.

1.3.4 Requirements.

1.3.4.1 This standard shall be enforced by the authority having jurisdiction (AHJ) designated by the governing body.

1.3.4.2* The AHJ shall have the authority to apply the requirements in this standard that are specifically addressed for buildings or other structures that are deemed to possess significant life or property loss potential.

1.3.4.3 If the fire department is not the AHJ, the AHJ shall consult with the fire department on all matters relative to the enforcement of this standard to ensure that the needs of the fire department are met in providing fire protection.

1.3.4.4 Provisions in Excess of Standard Requirements. Nothing in this standard shall be construed to prohibit a better development plan, building construction type, fire protection infrastructure, or an otherwise safer condition than that specified by the minimum requirements of this standard.

1.3.4.5 The AHJ shall use recognized fire protection measures to meet local conditions because this standard does not set forth general fire protection features or procedures addressed in other codes or standards.

1.3.4.6 Conflicts.

1.3.4.6.1 When a requirement in a referenced document is less restrictive than this standard, the requirements of this standard shall apply.

1.3.4.6.2 When a conflict between a general requirement and a specific requirement occurs, the specific requirement shall apply.

1.3.4.7* Prior to occupancy of any portion of the development, supporting infrastructure shall be installed, operational, and approved by the AHJ.

1.3.5 Public Notification.

1.3.5.1 The applicant for a land development or land use change shall provide written documentation and illustrative maps to the AHJ that specify areas that will be included in the proposed land development or land use change.

1.3.5.2 One or more published public announcements shall be made to publicize one or more public hearings at which the AHJ will present the proposed project, outline proposed methods to comply with this standard using best applicable data, and allow testimony by the public.

1.3.5.3 The applicant for a land use or land development change shall submit a written proposal to the AHJ regarding the level to which this standard shall be imposed, including justifications that demonstrate compliance, fire service impact, and responses to the public testimony.

1.3.5.4 The AHJ shall review the applicant's land use or land development change proposal and public testimony and render a written final determination if the proposed land use or land development change complies with this standard.

1.3.6 Public Appeals Process. Any person shall be permitted to appeal a decision of the AHJ. A process for appeal shall be made available to the public by the appropriate administrative body of the local adopting authority.

1.3.6.1 Adoption Appeals. Appeals shall be permitted, in part or whole, to the adoption of this standard. Upon appeal, the designated local government having authority shall affirm, modify, or disapprove in writing the determination of the AHJ in accordance with 1.3.5.3

1.3.6.2 Other Appeals. Appeals of individual requirements shall be permitted when it is claimed that any one or more of the following conditions exist:

- (1) The true intent of the requirements described in this standard has been incorrectly interpreted.
- (2) The provisions of the standard do not fully apply.
- (3) A decision is unreasonable or arbitrary as it applies to alternatives or new materials.

1.3.7 Impact Assessment. The AHJ shall conduct an impact assessment of the proposed land development or change in land use to determine the extent of impact on fire services currently available, as specified in Chapter 12 of this standard.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 1, *Fire Code*, 2015 edition.

NFPA 10, *Standard for Portable Fire Extinguishers*, 2013 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2016 edition.

NFPA 13D, *Standard for the Installation of Sprinkler Systems in One- and Two-Family Dwellings and Manufactured Homes*, 2016 edition.

NFPA 13R, *Standard for the Installation of Sprinkler Systems in Residential Occupancies up to and Including Four Stories in Height*, 2016 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 2016 edition.

NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*, 2016 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2015 edition.

NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, 2014 edition.

NFPA 54, *National Fuel Gas Code*, 2015 edition.

NFPA 58, *Liquefied Petroleum Gas Code*, 2017 edition.

NFPA 72®, *National Fire Alarm and Signaling Code*, 2016 edition.

NFPA 241, *Standard for Safeguarding Construction, Alteration, and Demolition Operations*, 2013 edition.

NFPA 291, *Recommended Practice for Fire Flow Testing and Marking of Hydrants*, 2016 edition.

NFPA 1142, *Standard on Water Supplies for Suburban and Rural Fire Fighting*, 2017 edition.

NFPA 1144, *Standard for Reducing Structure Ignition Hazards from Wildland Fire*, 2013 edition.

NFPA 1561, *Standard on Emergency Services Incident Management System*, 2014 edition.

2.3 Other Publications.

2.3.1 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace*, 2012.

ASTM E2652, *Standard Test Method for Behavior of Materials in a Tube Furnace with a Cone-shaped Airflow Stabilizer, at 750 Degrees C*, 2012.

2.3.2 AWWA Publications. American Water Works Association, 6666 West Quincy Avenue, Denver, CO 80235.

AWWA M31, *Distribution System Requirements for Fire Protection*, 4th edition, 2008.

2.3.3 Other Publications.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 1, *Fire Code*, 2015 edition.

NFPA 901, *Standard Classifications for Incident Reporting and Fire Protection Data*, 2016 edition.

NFPA 914, *Code for Fire Protection of Historic Structures*, 2015 edition.

NFPA 1142, *Standard on Water Supplies for Suburban and Rural Fire Fighting*, 2017 edition.

NFPA 5000®, *Building Construction and Safety Code*®, 2015 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.4* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.5 Shall. Indicates a mandatory requirement.

3.2.6 Should. Indicates a recommendation or that which is advised but not required.

3.2.7 Standard. An NFPA Standard, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a

generic sense, such as in the phrase "standards development process" or "standards development activities," the term "standards" includes all NFPA Standards, including Codes, Standards, Recommended Practices, and Guides.

3.3 General Definitions.

3.3.1 Accessory Building. Any building used incidentally to another building.

3.3.2 Adjacent Ground Elevation. The reference plane representing the average elevation of the finished ground level measured at a distance of 10 ft (3 m) from all exterior walls of the building.

3.3.3 Area.

3.3.3.1 Built-Out Area. Those portions of a development that have been populated to planned capacity with structures.

3.3.3.2 Gross Floor Area. The floor area within the inside perimeter of the outside walls of the building under consideration with no deduction for basements, hallways, stairs, closets, thickness of interior walls, columns, or other features.

3.3.3.3 Unbuilt Area. Those portions of a development intended to be built on that have not yet been populated with structures.

3.3.4 Building. A structure, usually enclosed by walls and a roof, constructed to provide support or shelter for an intended occupancy.

3.3.5 Combustible. A material that, in the form in which it is used and under the conditions anticipated, will ignite and burn; a material that does not meet the definition of noncombustible or limited-combustible. [5000, 2015]

3.3.6 Cul-de-Sac. A roadway that ends in a circular turnaround.

3.3.7* Curb Cut. Reduced curb height to facilitate vehicle passage over or across a curb.

3.3.8 Dead End. A passageway, or portion thereof, from which there is only one means of egress.

3.3.9 Driveway. A means of vehicular access to or from the land of a private property owner and a street, road, or highway.

3.3.10 Dwelling Unit. One or more rooms arranged for complete, independent housekeeping purposes, with space for eating, living, and sleeping; facilities for cooking; and provisions for sanitation. [5000, 2015]

3.3.11 Fire Department. The governmental or other organization that is responsible for providing fire protection and other emergency services to an area.

3.3.12 Fire Flow. The flow rate of a water supply, measured at 20 psi (138 kPa) residual pressure, that is available for fire fighting.

3.3.13 Fire Hazard. Any situation, process, material, or condition that, on the basis of applicable data, can cause a fire or explosion or that can provide a ready fuel supply to augment the spread or intensity of a fire or explosion, all of which pose a threat to life or property. [914, 2010]

3.3.14 Fire Hydrant. A valved connection on a water supply system having one or more outlets and that is used to supply hose and fire department pumper with water.

3.3.15 Fire Lane. An approved means of access or other passageway designated and identified to provide access for emergency apparatus where parking is prohibited.

3.3.16* Fire Protection. All measures taken to reduce the burden of fire on the quality of life.

3.3.17 Fire Protection System. Any fire alarm device or system or fire-extinguishing device or system, or combination thereof, that is designed and installed for detecting, controlling, or extinguishing a fire or otherwise alerting occupants, or the fire department, or both, that a fire has occurred.

3.3.18 Height. As applied to a building, the vertical distance from the adjacent ground elevation to the average elevation of the roof of the highest story.

3.3.19 Jurisdiction. Any governmental unit or political division or subdivision including, but not limited to, township, village, borough, parish, city, county, state, commonwealth, province, freehold, district, or territory over which the governmental unit exercises power and authority.

3.3.20 Land Development. The change of use of a parcel of land or contiguous parcels of land controlled by a single landowner or by a group of landowners with or without a common agreement to control the land so as to provide the buildings and infrastructure for residential and/or commercial purposes.

3.3.21 Land Use. The type or degree of activity occurring or intended to occur on a piece of land.

3.3.22 Means of Access. The method by which vehicles travel to or from structures, including but not limited to roadways, driveways, fire lanes, and parking lots.

3.3.23 Municipal-Type Water System. A system having water pipes servicing fire hydrants and designed to furnish, over and above domestic consumption, a minimum of 250 gpm (950 L/min) at 20 psi (138 kPa) residual pressure for a 2-hour duration.

3.3.24 Noncombustible Material. *See Section 4.2.*

3.3.25 Occupancy. The purpose for which a building or other structure, or part thereof, is used or intended to be used. [5000,2015]

3.3.26 Road. Any accessway, not including a driveway, that gives access to more than one parcel and is primarily intended for vehicular access.

3.3.27 Roadway. Any public or private street, including bridges and rights of way.

3.3.28 Rural. Those areas that are not unsettled wilderness or uninhabitable territory but are sparsely populated with densities below 500 persons per square mile. [1142, 2017]

3.3.29 Slope. Upward or downward incline or slant, calculated as rise divided by run and expressed as a percentage.

3.3.30* Standpipe. A pipe and attached hose valves and hose (if provided) used for conveying water to various parts of a building for fire-fighting purposes.

3.3.31 Story. The portion of a building located between the upper surface of a floor and the upper surface of the floor or roof next above. [5000, 2015]

3.3.32 Street.

3.3.32.1 Private Street. Any accessway normally intended for vehicular use not dedicated as a public street.

3.3.32.2 Public Street. A thoroughfare that has been dedicated for vehicular use by the public.

3.3.33 Structure. That which is built or constructed, an edifice or building of any kind, or any piece of work artificially built up or composed of parts joined together in some definite manner.

3.3.34 Suburb or Suburban. Those moderately inhabited areas with population densities of at least 500 persons per square mile but less than 1000 persons per square mile. [1142, 2017]

3.3.35 Water Supply. A source of water for fire suppression activities.

3.3.36 Wildland. Land in an uncultivated, more or less natural state and covered by timber, woodland, brush, and/or grass. [901, 2011]

3.3.37 Wildland Fire. An unplanned and uncontrolled fire spreading through vegetative fuels, including any structures or other improvements thereon.

Chapter 4 General Requirements

4.1 General. As a minimum, the AHJ shall require preliminary, working, and as-built plans to be submitted in a timely manner.

4.1.1 Plans shall demonstrate compliance with this standard.

4.1.1.1 The AHJ shall be permitted to require the review by an approved independent third party with expertise in the matter to be reviewed at the developer's expense.

4.1.1.2 The independent reviewer shall provide an evaluation and recommend necessary changes to the proposed plan development.

4.1.1.3 The AHJ shall be authorized to require design submittals to bear the stamp of a registered design professional.

4.1.1.4 Review and approval by the AHJ shall not relieve the applicant of the responsibility of compliance with this standard.

4.2* Noncombustible Material. [5000:7.1.4.1]

4.2.1 A material that complies with any one of the following shall be considered a noncombustible material:

(1)* The material, in the form in which it is used, and under the conditions anticipated, will not ignite, burn, support combustion, or release flammable vapors when subjected to fire or heat.

(2) The material is reported as passing ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750 Degrees C.*

(3) The material is reported as complying with the pass/fail criteria of ASTM E136 when tested in accordance with the test method and procedure in ASTM E2652, *Standard Test Method for Behavior of Materials in a Tube Furnace with a Cone-shaped Airflow Stabilizer, at 750 Degrees C.*

[5000: 7.1.4.1.1]

Chapter 5 Means of Access

5.1 General.

5.1.1 This section shall apply to all means of access, publicly or privately owned, whether or not they are designated as public thoroughfares.

5.1.2 Means of access shall be provided to all buildings more than 400 ft² (37 m²) in ground floor area and to public occupancies with structural components.

5.1.3 The AHJ shall have the authority to require a means of unlocking any security feature that is installed.

5.1.3.1 Any gates shall not be located closer than 30 ft (9.144 m) from an intersection and shall open in the direction of emergency vehicle travel unless other provisions are made for safe personnel operation.

5.1.3.2 The clear opening through gates shall have a usable width at least 2 ft (0.6 m) wider than the means of access it controls.

5.1.4 Number of Means of Access.

5.1.4.1* A land development shall have one or more means of access in accordance with Table 5.1.4.1(a), Table 5.1.4.1(b), or 5.1.4.2, whichever produces the greatest number.

5.1.4.2 Where residential areas are mixed with nonresidential areas, the minimum number of access routes shall be determined by calculating five parking spaces for each dwelling unit, adding that number to the parking spaces count for the nonresidential area, and using Table 5.1.4.1(b).

5.1.4.3 Where multiple means of access are required, one of the means of access shall be permitted to be restricted for emergency use only, when approved by the AHJ.

Table 5.1.4.1(a) Required Number of Access Routes for Residential Areas

| Number of Households | Number of Access Routes |
|----------------------|-------------------------|
| 0–100 | 1 |
| 101–600 | 2 |
| >600 | 3 |

Table 5.1.4.1(b) Required Number of Access Routes for Nonresidential Areas

| Number of Parking Spaces | Number of Access Routes |
|--------------------------|-------------------------|
| 0–1250 | 1 |
| 1251–3000 | 2 |
| >3000 | 3 |

5.1.4.4 Where multiple means of access are required, they shall be located as remotely from each other as practical and acceptable to the AHJ.

5.2 Roadways. Roadways shall be constructed and maintained in accordance with this section.

5.2.1* The legal right-of-way for a roadway shall accommodate the width necessary for the construction, drainage, erosion control, and maintenance of the roadway, and provisions for utilities and sidewalks.

5.2.2 Roadways shall be constructed of a hard, all-weather surface designed to support all legal loads of the jurisdiction.

5.2.3 Roadways shall have a minimum clear width of 12 ft (3.7 m) for each lane of travel, excluding shoulders and parking.

5.2.3.1 Curves shall not reduce the width of the roadway.

5.2.3.2 Provisions shall be made for drainage, snowbanks, parking, utilities, and the like such that they do not impinge on the minimum clear width.

5.2.4 Where parking is permitted, such space shall be provided in accordance with Section 5.4.

5.2.5 Any roadway intersecting with another shall be sloped to prevent the accumulation of water and ice on either roadway.

5.2.6 At least 13 ft 6 in. (4.2 m) nominal vertical clearance shall be provided and maintained over the full width of the roadway.

5.2.7 Turns in roadways shall be constructed with a minimum radius of 60 ft (18.2 m) to the outside of the turn.

5.2.8 Median left-turn lanes and traffic signals shall be provided at intersections where necessary to prevent traffic from impeding fire department response time.

5.2.9 Where required by the AHJ, any traffic signal system shall have an automatic means for fire apparatus to control the signals to maintain an unimpeded right-of-way.

5.2.9.1 Sight distance shall be incorporated into the design of intersections.

5.2.10* Bridges and culverts shall be designed to accommodate a minimum of 100-year flood elevations and flows in accordance with accepted engineering practices.

5.2.11 Vehicle load limits shall be posted at both entrances to bridges where required by the AHJ.

5.2.12 Easements shall be obtained to permit vegetation clearance alongside roads to minimize the likelihood of evacuation routes being blocked during wildfire or other natural disasters.

5.2.13* Roadways shall not be designed and constructed to include speed bumps or speed humps.

5.2.14 Alternative traffic calming devices such as chicanes and roundabouts shall be acceptable with approval by the AHJ.

5.2.15 Roadway design shall incorporate provisions for emergency pull-offs, spaced according to the AHJ.

5.2.16 Grades.

5.2.16.1 Grades shall not be more than 10 percent, except as permitted by this section.

5.2.16.2* Grades steeper than 10 percent shall be permitted by the AHJ where mitigation measures can be agreed upon by the fire department and the road engineering department, taking into consideration climate, traffic load, environmental conditions, the number of turns that would affect traffic flow, and the ability of fire apparatus to operate on steeper grades.

5.2.16.3 The angle of approach and the angle of departure shall not exceed 8 degrees at any point on the roadway or its intersection with another roadway or fire lane.

5.2.16.4 Where local conditions do not allow the maximum angles of approach and departure be limited to 8 degrees, the AHJ shall permit greater angles where local emergency apparatus can accommodate such angles.

5.2.16.5 Where grades are less than 0.5 percent, the road shall be crowned in the center to prevent pooling of water in a traveled way.

5.2.16.6 The design of grade crossings at railroad tracks shall be done by a professional engineer with expertise in railroad grade crossings.

5.2.17 Dead Ends.

5.2.17.1 Every dead-end roadway more than 300 ft (91 m) in length shall be provided at the closed end with a turnaround having no less than a 120 ft (36.6 m) outside diameter of the traveled way.

5.2.17.2* The length of any cul-de-sac shall not exceed the fire-fighting capability of the fire department.

5.2.17.3* A cul-de-sac exceeding 1200 ft (366 m) in length shall be provided with approved intermediate turnarounds at a maximum of 1200 ft (366 m) intervals.

5.2.18 Signage.

5.2.18.1 Addresses shall be assigned in a logical, consistent manner based on the local addressing system. Street names shall be phonetically unique.

5.2.18.2 Sign assemblies with the name of each road shall be constructed of noncombustible material and installed at each intersection.

5.2.18.3 These signs shall be installed a minimum of 7 ft (2.1 m) above the traveled way.

5.2.18.4 The letters on the signs shall be no less than 4 in. (100 mm) in height, with at least a 0.5 in. (12.7 mm) stroke, reflective and of a contrasting color to the background of the sign.

5.2.18.5 Where required by the AHJ, signs shall also include references to address numbers pertinent for that section of the road.

5.2.18.6 Where required by the AHJ, signs shall be erected at intersections indicating directions and distance to the nearest water supply.

5.2.18.7 Where the location of the nearest water supply is not obvious, signs or other directional symbols shall be erected indicating directions and distance to the nearest water supply.

5.2.18.8 The beginning of every dead-end roadway and developments with only single access shall have signage indicating that there is not a second outlet.

5.3* Fire Lanes.

5.3.1 Approval.

5.3.1.1 Fire lane plans shall be reviewed and approved by the AHJ and the fire department responsible for the protection of the property.

5.3.1.2 Changes to access points, gates, or fire lane layout shall be pre-approved by the AHJ.

5.3.2 Driveways, parking lot lanes, delivery lanes, and private roadways shall be permitted to be used as fire lanes if they meet the requirements of this section.

5.3.3 Fire lanes shall be constructed of a hard, all-weather surface designed to support any vehicle within the legal load limits of the jurisdiction.

5.3.4 The grade from a fire lane to the exterior wall of the grade level floor of a building shall not exceed 10 percent.

5.3.5 Fire lanes connecting to roadways shall be provided with curb cuts extending at least 2 ft (0.6 m) beyond each edge of the fire lane.

5.3.6 Fire lanes intended for one-way travel shall provide a minimum of 16 ft (5 m) in width of traveled way. Fire lanes providing two-way travel shall be a minimum of 24 ft (7.3 m) in width of traveled way.

5.3.6.1 The AHJ shall be permitted to allow a reduction in fire lane width where the sole purpose of the fire lane is for emergency access and operations.

5.3.6.2 Fire lane widths shall not include shoulders, sidewalks, or drainage.

5.3.7 Extra width shall be provided where the fire department determines such width is necessary to position apparatus for operations during an incident.

5.3.8 Turns in fire lanes shall be constructed to provide sufficient width to accommodate the largest piece of fire apparatus available to be operated on the fire lane, but in no case shall the radius to the outside curb line be less than 50 ft (15.2 m).

5.3.9 All grades in fire lanes shall meet the requirements of 5.2.5.

5.3.10 At least 13 ft 6 in. (4.2 m) nominal vertical clearance shall be provided and maintained over the full width of a fire lane.

5.3.11 The angle of approach and the angle of departure shall not exceed 8 degrees at any point on the fire lane or its intersection with other roads or fire lanes.

5.3.12 When a bridge is required to be used as part of a fire department access road, it shall be constructed and maintained in accordance with nationally recognized standards. [1:18.2.3.4.5.1]

5.3.12.1 The bridge shall be designed for a live load sufficient to carry the imposed loads of fire apparatus. [1:18.2.3.4.5.2]

5.3.12.2 Vehicle load limits shall be posted at both entrances to bridges where required by the AHJ. [1:18.2.3.4.5.3]

5.3.13 Any bridge constructed as part of a fire lane shall provide width of no less than that required for the fire lane.

5.3.14 Dead-end fire lanes that exceed 300 ft (91 m) in length shall be provided with a minimum 120 ft (36.6 m) diameter turnaround at the closed end of the fire lane.

5.3.15 The clear opening through gates in fire lanes shall be at least 2 ft (0.6 m) wider than the traveled way.

5.3.16 All gates at the entrance to fire lanes shall be located a minimum of 30 ft (9.144 m) from the roadway and shall open away from the roadway, unless other provisions are made for safe personnel operation.

5.3.16.1 The AHJ shall have the authority to require a means of unlocking any security feature that is installed.

5.3.16.2 If needed, fire department personnel shall have ready access to any manual releases that could be required if there is an interruption of utility power.

5.3.16.3 Means shall be provided to override normal operation and allow any gate to remain open until manually closed.

5.3.17 An acceptable plan for wintertime maintenance of access through any gates and along any fire lane shall be submitted to the fire department responsible for the protection of the property.

5.3.18 Approved "No Parking — Fire Lane" signs shall be posted in accordance with the instructions of the fire department having responsibility and a method of enforcing such provisions shall be provided by the local jurisdiction.

5.4 Parking Lots.

5.4.1* The minimum lengths of parking lot stalls shall be measured end to end as shown in Figure 5.4.1, and the minimum stall length and aisle widths shall be as shown in Table 5.4.1.

5.4.2 Parking lot aisles adjacent to any building shall provide a travel lane with a minimum 24 ft (7.3 m) clear width.

5.4.3 The minimum turning radius for parking lot aisles necessary for fire department apparatus access shall be determined by the fire department having responsibility.

Chapter 6 Building Access and Separation

6.1 General. At least one approved means of fire apparatus access shall be provided to each building in accordance with this section.

6.1.1* Approved fire apparatus access shall be provided to within 150 ft (45 m) of any point of the exterior wall of each building.

6.1.1.1 The requirements of 6.1.1 shall be permitted to be extended to 300 ft (91 m) for any building protected by an automatic sprinkler system installed and maintained according to NFPA 13 or NFPA 13R, whichever is applicable.

6.1.2 Approved fire apparatus access shall be provided to within 50 ft (15.2 m) of at least one exterior door providing access to the interior of the building.

6.1.2.1 The requirement of 6.1.2 shall not apply to one- and two-family dwellings.

Table 5.4.1 Minimum Parking Lot Stall Dimensions and Minimum Aisle Lengths

| Parking Angle | Minimum Stall Length | | Minimum Aisle Width, One-Way Traffic Flow | | Minimum Aisle Width, Two-Way Traffic Flow | |
|---------------|----------------------|-----|---|-----|---|-----|
| | ft | m | ft | m | ft | m |
| 45 degrees | 27.5 | 8.4 | 16 | 4.9 | 24 | 7.3 |
| 60 degrees | 23.7 | 7.2 | 16 | 4.9 | 24 | 7.3 |
| 75 degrees | 20.9 | 6.4 | 23 | 7.0 | 24 | 7.3 |
| 90 degrees | 18.5 | 5.6 | 26 | 7.9 | 26 | 7.9 |

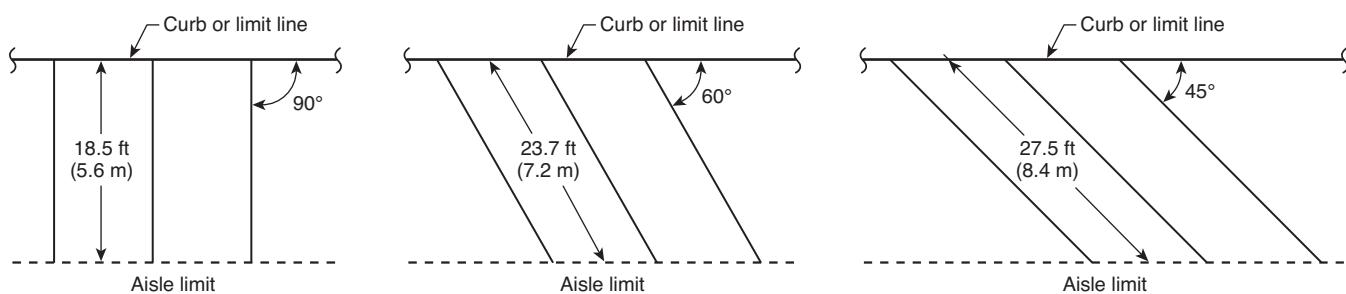


FIGURE 5.4.1 Measurements for Parking Stall Length.

6.1.3* Any building, other than a one- or two-family dwelling, exceeding two stories or 30 ft (9.144 m) in height above average adjacent ground elevation and not protected by an automatic sprinkler system installed and maintained in accordance with NFPA 13 or NFPA 13R shall have an approved means of fire apparatus access to within 30 ft (9.144 m) of all points of at least 50 percent of the exterior wall perimeter.

6.1.4* Any building exceeding three stories or 35 ft (10.7 m) in height above average adjacent ground elevation and protected by an automatic sprinkler system installed and maintained in accordance with NFPA 13 or NFPA 13R, whichever is applicable, shall have an approved means of fire apparatus access to within 30 ft (9.144 m) of an exterior wall.

6.2 Building Separation.

6.2.1 Unless governed by other locally adopted regulations, any building shall be separated from another building by at least 30 ft (9.144 m) and shall be set back at least 30 ft (9.144 m) from a property line.

6.2.1.1 If adjacent buildings are both protected with automatic sprinkler systems meeting NFPA 13 the separation between the structures or separation from a property line shall be permitted to be reduced to 15 ft (4.5 m).

6.2.1.2 If an accessory building is 400 ft² (37 m²) or less in ground floor area, the separation from the principal structure shall be permitted to be reduced to 15 ft (4.5 m) where both buildings have a separation from a property line of at least 30 ft (9.144 m).

6.2.1.3 If an accessory building is 400 ft² (37 m²) or less in ground floor area, the separation from a property line shall be permitted to be reduced to 15 ft (4.5 m) where the accessory building has a separation from the principal structure of at least 30 ft (9.144 m).

6.2.2 Any building that exceeds two stories or 30 ft (9.144 m) in height above average adjacent ground elevation and is not protected by an automatic sprinkler system installed and maintained according to NFPA 13 or NFPA 13R, shall be separated from any other structure by at least 50 ft (15.2 m) and shall be set back at least 30 ft (9.144 m) from a property line.

Chapter 7 Premises Identification

7.1 General. All premises having an assigned address under 5.2.18.1 shall be identified by signage bearing the assigned address.

7.1.1 Premises address signage shall meet the requirements of 7.1.2 through 7.1.6.

7.1.2 Sign assemblies shall consist of noncombustible materials.

7.1.3 Sign background shall be of a reflective material and of a contrasting color to the address numerals or letters.

7.1.4 Address numerals or letters shall be of a reflective material, of a contrasting color to the sign background, and with a height of not less than 4.0 in. (102 mm) with a 0.5 in. (13 mm) stroke.

7.1.5 Spacing between address numerals or letters shall be between 0.5 in. (13 mm) and 1.0 in. (25 mm).

7.1.6 A minimum border of 1.0 in. (25 mm) of sign background shall be maintained around the address letters or numerals.

7.2 Visibility. When address signage affixed directly to the premises is not visible from the roadway, additional signage shall be provided at the point of intersection between the premises driveway and the roadway.

7.2.1 End-of-driveway signage shall comply with all requirements for premises signage in 7.1.1 and the following:

- (1) Mounted between 4.0 ft (1.2 m) and 7.0 ft (2.1 m) above grade
- (2) Posted no further than 5.0 ft (1.5 m) from either the driveway or roadway travelled way, and on the same side of the road as the serviced driveway
- (3) Oriented perpendicular to the direction of travel on the roadway, and clearly visible and legible from both directions of travel on the roadway

7.2.2 End-of-driveway signage shall be maintained free of any visual obstructions, such as weeds, debris and snow.

7.2.3 End-of-driveway signage shall be replaced whenever damaged or when reflectivity or legibility has been degraded.

Chapter 8 Fire Protection

8.1 Automatic Fire Protection.

8.1.1 All buildings more than two stories or more than 30 ft (9.144 m) above adjacent ground elevation shall be fully protected with an automatic sprinkler system installed and maintained according to NFPA 13, NFPA 13R, or NFPA 13D, whichever is appropriate for the occupancy.

8.1.1.1 Where incidental portions of a building exceed two stories or 30 ft (9.144 m) in height and are not normally occupied, the provisions of 8.1.1 shall not apply.

8.1.2 Any residential building shall have an automatic sprinkler system installed in accordance with NFPA 13, or NFPA 13R, or NFPA 13D, whichever is appropriate.

8.1.3* Where municipal-type water systems are available, fire department connections for sprinkler systems designed to NFPA 13 or NFPA 13R shall be located not more than 100 ft (30.5 m) along an approved path from a fire hydrant and shall be arranged so that hose lines can be readily and conveniently attached to the inlets without interference from any nearby objects, including buildings, signs, fences, posts, or other fire department connections.

8.1.4 Fire department connections shall be located to facilitate the establishment of a continuous supplemental water supply where municipal-type water systems are not available and shall be arranged so that hose lines can be readily and conveniently attached to the inlets without interference from any nearby objects, including buildings, signs, fences, posts, or other fire department connections.

8.2 Manual Fire Protection.

8.2.1 Standpipe Systems.

8.2.1.1 General. The design and installation of standpipe systems shall be in accordance with this section and NFPA 14. [1:13.21]

8.2.1.2 Where municipal-type water systems are available, the requirements of 8.2.1.1 and 8.2.1.4 shall apply to all new buildings where any of the following conditions exist:

- (1) More than three stories above grade
- (2) More than 50 ft (15 m) above grade and containing intermediate stories or balconies
- (3) More than one story below grade
- (4) More than 20 ft (6.1 m) below grade

8.2.1.2.1 High-rise buildings shall be protected throughout by a Class I standpipe system in accordance with 8.2.1.1 and 8.2.1.4. [1:13.2.2.3]

8.2.1.2.2 The provisions of 8.2.1 shall not apply to one- and two-family dwellings.

8.2.1.3 Where municipal-type water systems are not available, the requirements of 8.2.1.3 and 8.2.1.5 shall apply to all new buildings where any of the following conditions exist:

- (1) More than two stories in height above grade
- (2) More than 40 ft (12.2 m) above grade and containing intermediate stories or balconies
- (3) More than one story below grade
- (4) More than 20 ft (6.1 m) below grade

8.2.1.3.1 High-rise buildings shall be protected throughout by a Class I standpipe system in accordance with 8.2.1.1 and 8.2.1.5. [1:13.2.2.3]

8.2.1.3.2 The provisions of this section shall not apply to one- and two-family dwellings.

8.2.1.4* Fire department connections for standpipe systems shall be located not more than 100 ft (30.5 m) from the nearest fire hydrant connected to an approved water supply.

8.2.1.4.1 The location of the fire department connections shall be permitted to exceed 100 ft (30.5 m) subject to the approval of the AHJ.

8.2.1.4.2 Fire department connections shall be located not less than 18 in. (457 mm) nor more than 48 in. (1219 mm) above the level of the adjoining ground, sidewalk, or grade surface.

8.2.1.4.3 Fire department connections shall be arranged so that hose lines can be readily and conveniently attached to the inlets without interference from any nearby objects, including buildings, fences, posts, or other fire department connections.

8.2.1.5 Fire department connections shall be located to facilitate the establishment of a continuous supplemental water supply where municipal-type water systems are not available and shall be arranged so that hose lines can be readily and conveniently attached to the inlets without interference from any nearby objects, including buildings, signs, fences, posts, or other fire department connections.

8.2.2* **Fire Extinguishers.** Fire extinguishers shall be provided as specified in Table 13.6.2 of NFPA 1 and installed in accordance with NFPA 10.

8.3 Automatic Fire Warning Systems.

8.3.1 Any residential buildings containing more than two living units shall have a local fire alarm system designed and installed in accordance with NFPA 72.

8.3.2 In any residential buildings containing four or more living units, the local fire alarm system shall retransmit to an approved central station.

8.3.3 For nonresidential structures exceeding 1000 ft² (93 m²) gross floor area, an approved fire warning or alarm system shall be installed in accordance with NFPA 72.

8.3.3.1 For nonresidential structures exceeding 5000 ft² (465 m²) gross floor area, such systems shall retransmit an alarm to an approved central station.

8.3.3.2 Alarms or warning systems shall be tested and maintained in accordance with NFPA 72.

Chapter 9 Water Supply

9.1 General.

9.1.1 Where water mains or fire hydrants are provided for fire protection purposes, the following shall apply:

- (1) Water mains or fire hydrants installed on public property or in a utility easement shall be installed and maintained in accordance with AWWA M31, *Distribution System Requirements for Fire Protection*.
- (2) Water mains or fire hydrants installed on nonpublic property shall be installed and maintained in accordance with NFPA 24.

9.1.2 Where there are no water mains for fire protection purposes, NFPA 1142 shall apply.

9.1.3 The number and type of fire hydrants and connections to approved water supplies shall be capable of delivering the required fire flow to one or more buildings of a development as determined by the AHJ using locally adopted codes, or as specified per the following conditions:

- (1) For areas without municipal-type water systems, NFPA 1142 shall be applied.
- (2) For those areas with municipal-type water systems, Annex G of NFPA 1142 shall be consulted for guidance.

9.1.4 Fire Hydrants.

9.1.4.1 Fire hydrants shall be marked in accordance with NFPA 291 and shall be made visible from the road by reflective marking or signage as designated by the AHJ.

9.1.4.2 All identification signs for fire hydrants shall be approved by the applicable authority prior to installation if they are to be located in the right-of-way or are subject to other laws.

9.1.4.3 Fire hydrants located in parking areas shall be protected by barriers that will prevent physical damage from vehicles without obstructing fire hydrant operation.

9.1.4.4 Fire hydrants shall be located within 6 ft (1.8 m) of the edge of the pavement unless the fire department determines another location is more acceptable for fire department use. Consideration shall be given to locating fire hydrants such that fire apparatus can be connected to the fire hydrant without impeding traffic flow.

9.1.4.5* Threads on fire hydrant outlets shall be American National Fire Hose Connection Screw Threads and shall be equipped with thread adapters where local fire department threads are different.

9.1.4.6 The area around fire hydrants shall remain clear of obstructions, including vegetation, signs, fences, light posts, and so forth.

9.2* Water Supply Distribution. Water sources shall be located such that the required fire flow for any building in the development can be established and maintained within 5 minutes of arrival with the fire department resources available.

9.3 Areas with Municipal-Type Water Systems.

9.3.1 Required Fire Flow. For areas with municipal-type water systems, required fire flow shall be determined as specified in NFPA 1142, Annex G, Municipal-Type Water System.

9.3.2 For a required fire flow exceeding 1500 gpm (5700 L/min), the water supply system shall be capable of delivering that fire flow for at least 2 hours at 20 psi (138 kPa) residual pressure.

9.3.3 For all required fire flows other than those described in 9.3.2, the water supply system shall be capable of delivering the required fire flow for at least 1 hour at 20 psi (138 kPa) residual pressure.

9.3.4 Modifications. [1:18.4.3]

9.3.4.1 Decreases. Fire flow requirements shall be permitted to be decreased by the AHJ for isolated buildings or a group of buildings in rural areas or suburban areas where the development of full fire flow requirements is impractical as determined by the AHJ. [1:18.4.3.1]

9.3.4.2 Increases. Fire flow shall be permitted to be increased by the AHJ where conditions indicate an unusual susceptibility to group fires or conflagrations. An upward modification shall not be more than twice that required for the building under consideration. [1:18.4.3.2]

9.3.5 Fire hydrants in partially built-out or built-out areas shall be installed at a spacing not to exceed 500 ft (152 m) of vehicle travel distance from a building unless the fire department having jurisdiction determines that closer fire hydrant spacing is required.

9.3.6* In unbuilt areas, fire hydrants shall be installed at not more than 1500 ft (456 m) spacing with provisions in place to install fire hydrants to meet 9.3.5 as the area is built out.

9.3.7 The fire department shall approve the location of all fire hydrants.

9.3.8 For nonresidential buildings, a fire hydrant shall be located within 500 ft (150 m) of each point of entry.

9.3.9 In residential areas, fire hydrants shall be supplied by not less than a 6 in. (150 mm) diameter main installed on a looped system or by not less than an 8 in. (200 mm) diameter main if the system is not looped or the fire hydrant is installed on a dead-end main exceeding 300 ft (91 m) in length.

9.3.10* In nonresidential areas, detailed fire flow calculations shall be provided and used to determine necessary pipe sizing.

9.3.10.1 Future development in the area shall be considered when fire flow requirements are calculated.

9.3.11 Dead-end mains shall not exceed 600 ft (183 m) in length for main sizes less than 10 in. (250 mm) in diameter.

9.4 Acceptance.

9.4.1 The contractor or installer of new water supply systems or extensions to existing water supply systems shall demonstrate by actual test that the capacity of the water supply system will meet the fire protection design requirements.

9.4.2 The AHJ shall witness the tests, approve the results, and provide a copy of test results to the fire department.

Chapter 10 Fire Protection During Construction

10.1* General Requirements. The provisions of NFPA 241 shall apply in addition to the specific requirements of this chapter.

10.1.1 Before the infrastructure is installed, and prior to the location and construction of buildings or portions thereof, fire protection plans shall be submitted to and approved by the AHJ.

10.1.2 Prior to the delivery of combustible materials and the start of any building construction, the water supply for fire protection, whether temporary or permanent, shall be acceptable to the AHJ and shall be available.

10.1.3 Prior to the final occupancy of any building, the permanent water supply for fire protection, including fire hydrants and fire suppression systems, shall be installed, tested, and acceptable to the AHJ.

10.1.4 Fire department vehicular access to all buildings under construction shall be provided at all times.

10.1.4.1 In areas where ground surfaces are soft or likely to become soft, hard all-weather surface access roads shall be provided.

10.1.5 Combustible trash and debris shall be placed completely within an approved container or removed from the site at the close of each working day.

10.1.6 Flammable or combustible liquids or gases shall be stored, handled, and used on the construction site in accordance with the applicable provisions of NFPA 30, NFPA 54, and NFPA 58.

10.1.7 Temporary heating devices shall be of an approved type, located away from combustible materials, and attended and maintained by competent personnel.

10.1.8 Smoking shall be prohibited, except in those areas where approved. Where required by the AHJ, "No Smoking" signs shall be posted.

10.1.9 Cutting and welding operations shall be in accordance with NFPA 51B.

10.2 Extinguishing Equipment.

10.2.1 At least one portable fire extinguisher having a rating of at least 10-A:120-B:C shall be within a travel distance of 75 ft (23 m) or less to any point of a building under construction.

10.2.2 Personnel normally on the construction site shall be instructed in the use of the fire extinguishers provided.

Chapter 11 Community Safety and Emergency Preparedness

11.1* General.

11.1.1 The AHJ shall be responsible for the adoption and maintenance of a multi-agency operational plan for the protection of lives and property during significant emergency incidents.

11.1.2 The primary goal of the plan shall be to protect people in the affected area, including emergency personnel responding to the incident, from injury or loss of life.

11.2 Assessment of Hazards. The AHJ shall identify hazards, the likelihood of their occurrence, and the vulnerability of people, property, the environment, and the community itself to those hazards.

11.3 Operational Plan. The plan shall contain, as a minimum, command, training, community notification and involvement, public fire safety information and education, public safety and evacuation, and mutual assistance elements.

11.3.1 Command Element.

11.3.1.1 The plan shall contain a command element that clearly defines the responsibilities and authorities of all agencies and organizations that will be used in management of the incident.

11.3.1.2 Supporting resources such as social service agencies, local media, law enforcement, and so forth shall be included.

11.3.1.3 An incident management system shall be used in accordance with NFPA 1561.

11.3.2 Training Element. Training, qualification, and equipment requirements shall be prepared to ensure that all personnel and equipment assigned to an emergency incident will be able to carry out assignments in a predictable, safe, cooperative, and effective manner.

11.3.3 Community Notification and Involvement Element. Public preparation shall include the following:

- (1) The establishment of a communication system to provide rapid and accurate information to the public regarding emergency incidents that endanger their community, including detailed instructions for public notification of impending evacuation
- (2) Information regarding actions to be taken for self-protection
- (3) Information regarding appropriate assistance that can be rendered by the public to fire protection agencies in the management of emergency incidents
- (4) Security measures to protect the evacuated area

11.3.4 Public Fire Safety Information and Education Element.

11.3.4.1 The AHJ shall prepare and implement a public safety information and education program.

11.3.4.2 The program, at a minimum, shall identify and analyze the following:

- (1) Fire causes and hazards
- (2) Life and property risks from other natural and technological hazards
- (3) Prevention and safety programs

- (4) Target audiences
- (5) Activities

11.3.5 Public Safety and Evacuation Element.

11.3.5.1 A public safety and evacuation element shall provide for the safety of residents and area workers threatened by potential emergency incidents.

11.3.5.2 The public safety and evacuation element shall include the following:

- (1) Incident personnel authority and criteria for ordering evacuations or relocations
- (2) Incident personnel responsibilities in evacuations or relocations
- (3) Procedures for public notification of impending evacuations or relocations
- (4) Routes for evacuations or relocations
- (5) Shelter locations
- (6) Policy addressing the issue of persons who choose to not evacuate or relocate
- (7) Policy for allowing evacuees to return when the current emergency has passed

11.3.6 Mutual Assistance Element.

11.3.6.1 Mutual assistance (mutual aid) agreements shall be developed that detail those services and resources available to support the management of emergency incidents.

11.3.6.2 Mutual assistance agreements shall be reviewed annually.

11.3.6.3 Mutual assistance agreements shall specify the following:

- (1) Legal authorities
- (2) Command organization
- (3) Fiscal responsibilities
- (4) Operational and logistical responsibilities

Chapter 12 Capacity of Fire Protection Services.

12.1* Assessment.

12.1.1 An assessment shall be conducted to determine the impact of the land use change on fire protection services.

12.1.2 The assessment shall address the following:

- (1) *Dispatching.* Are the current system and staff able to handle the increased call volume likely to be generated by the build-out resulting from the land use change?
- (2) *Fire station locations.* In order to maintain an acceptable level of fire department and emergency response times within the response area, are current fire stations distributed and designed to service changing demands resulting from the land use changes and development?
- (3) *Fire service resources.* Are there adequate fire apparatus and staffing to meet the increased service demands likely to be generated by the build-out?
- (4) *Special services.* Will the development introduce a need for special services not currently within the capability of the fire department?

12.2* Mitigation. Where the assessment determines that the existing fire department cannot maintain its current level of service delivery while also providing services to the proposed development, the fire department and the developer shall jointly determine how to mitigate the impact on the delivery of fire services or increase the capability of the fire department and how those services are to be provided.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1 Land use changes in wildland, rural, and suburban areas often occur in areas where there might be an inadequate water supply, inadequate fire department resources, extended fire department response time, limited access, hazardous vegetation, unusual terrain, or unusual characteristics. Without the involvement of the fire department from the outset, the resulting changes could create a situation where the fire department cannot properly access structures or have the resources necessary to deal with emergencies at the property and where the occupants might not be able to escape the incident.

This standard addresses the design of subdivisions and development in areas where threats of natural disasters or human-caused hazards in suburban/rural areas are not addressed by other planning and development documents. Moreover, in many areas of the United States, building and fire codes might not have been adopted, in which case this standard is meant to apply.

A.1.3.1 Wildland, rural, and suburban areas have conditions, threats, and needs that might be different from those assumed under other codes and standards. In addition, other codes and ordinances might not be in place to guide fire departments in many rural areas.

A.1.3.4.2 Structures could include such occupancies as amphitheaters, grandstands, or other public assembly structures that could need fire protection infrastructure.

A.1.3.4.7 Supporting infrastructure includes roads, bridges, water supply systems, and similar utilities.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase “authority having jurisdiction,” or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or indi-

vidual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.2.4 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.7 Curb Cut. Curb cut can be an abrupt reduction or a tapering reduction for the length of the curb on each side of the means of access.

A.3.3.16 Fire Protection. Fire protection includes measures such as fire prevention, fire detection and suppression, built-in fire protection systems, and planning and building codes.

A.3.3.30 Standpipe. See NFPA 14.

A.4.2 The provisions of 4.2 do not require inherently noncombustible materials to be tested in order to be classified as noncombustible materials. [5000, 2015]

A.4.2.1(1) Examples of such materials include steel, concrete, masonry, and glass. [5000, 2015]

A.5.1.4.1 The information in Table 5.1.4.1(a) was crudely estimated using Equation 8-3 in the 1997 *Highway Capacity Manual* (Transportation Research Board 1997).

[A.5.1.4.1]

$$SF_i = 2800(v/c)_i f_d f_w f_g f_{hv}$$

This equation states that a road's service flow rate (SF_i) in vehicles per hour (vph) is the product of the volume-to-capacity ratio for level-of-service *i*(v/c)_i, and a set of adjustment factors for directional traffic distribution *f_d*, lane and shoulder width *f_w*, grade *f_g*, and the presence of heavy vehicles *f_{hv}*. A narrow, mountainous road operating at level-of-service *F* (0.78) (maximum capacity) is assumed (for this analysis) with 100 percent of the traffic in one direction (0.71) on a 9 ft (2.7 m) wide lane and 2 ft (0.6 m) shoulder (0.70) heading downhill (1) with the possible 3 percent presence of large recreational vehicles (0.75) for an estimate of capacity per exit in clear visibility conditions with moderate demand rates of 814 vph (rounded to 800). In communities with uphill exits, wider roads, or no recreational vehicles, this can be adjusted. Concentrated demand could greatly degrade this flow rate to level-of-service *F* where capacity can no longer be reliably estimated. Also, it should be noted that this number is very optimistic because it does not consider driveways along a road or other merge points that could create flow turbulence. This information, from “Public Safety in the Urban–Wildland Interface: Should Fire-Prone Communities Have a Maximum Occupancy?,” is provided only to reference the rationale and background for the round numbers in the tables, not for specific calculations.

A.5.2.1 When approving a development, the AHJ should consider whether future rights-of-way might be needed for widening streets or providing additional means of access as the project is built out or adjacent properties are considered for development. Where there is a perceived need, the AHJ should work with the developer to set aside such rights-of-way for future use.

A.5.2.10 Driveway entrances constructed of multiple surfaces of dirt, concrete, and asphalt are usually a single vehicle width and cross the culvert leading into the actual driveway. The culverts often have either a metal or plastic pipe laid into them and the driveway is built over the pipe. During the response effort of the Black Forest Fire in Colorado in 2013, at least three incidents were cited where the integrity of the plastic pipe had been compromised by the fire and resulted in fire apparatus getting stuck in the culvert area. This situation can compromise egress of the occupants as well as the safety of responding fire crews. Fire apparatus access roads should be designed and maintained to support the imposed load of a fire apparatus and withstand the impacts of (or from) fire.

A.5.2.13 A wide variety of traffic calming devices is available. Prior to installation of any of these devices, the AHJ should work with the emergency response departments to ensure traffic calming devices can be negotiated by emergency response vehicles in a safe and timely manner without damage to those vehicles.

More information on the impact of traffic calming devices on emergency vehicles can be found in *The Influence of Traffic Calming Devices on Fire Vehicle Travel Times*, by the Portland, OR, Office of Transportation and the Fire Rescue and Emergency Services. (For brevity, tables have been eliminated from the following summary, but the full report is available at www.portlandoregon.gov/transportation/article/392063.)

The Influence of Traffic Calming Devices on Fire Vehicle Travel Times

January 1996

Portland Bureau of Fire, Rescue, and Emergency Service and the Traffic Calming Section Bureau of Traffic Management of the Portland Office of Transportation

Introduction.

Traffic calming devices are used on Portland's neighborhood streets when traffic conditions are out of character with their adjacent residential, institutional, and recreational land uses. Calming devices are used to slow vehicle speeds, to encourage the use of more appropriate streets for through trips, and to enhance pedestrian, bicycle, and transit safety. The devices have proven to be effective without significantly impacting convenience, mobility, and travel time for drivers. At the same time, certain devices affect the speed of various fire vehicles and may increase overall response times.

In 1995, the city's Fire Bureau and Bureau of Traffic Management conducted a thorough data collection effort to help quantify the relationship between three types of traffic calming devices and fire vehicle travel times. The study was conducted to determine how speed bumps and traffic circles affect fire vehicle travel times.

Research Method.

The testing considered four variables that influence the speed at which a fire vehicle can be negotiated around traffic circles or across speed bumps. The variables tested were the driver (36 different drivers), the type of fire vehicle (six fire vehicles of varying characteristics), the desirable vehicle speed, and the types of calming devices. Test runs were conducted on a total of six streets: two with 22-foot speed bumps; two with 14-foot speed bumps; and two with traffic circles. The speed and time data for each test run (four per vehicle/street, total 24 per street) was transcribed and used to calculate the distance traveled after each second as well as the vehicle's distance from the starting line after each second of the run.

For various combinations of the four variables, the time needed to travel a length of street that had no calming device was compared to the time needed to travel the same length with a calming device.

The difference between these times equals the delay associated with the calming device. Delays-per-device were calculated for desirable response speeds of 25, 30, 35, and 40 mph.

Findings.

Depending on the type of fire vehicle and the desirable response speed, the three devices were found to create a range of delays for each device as follows:

- (1) 14-foot bumps: 1.0 to 9.4 seconds of delay per bump
- (2) 22-foot bumps: 0.0 to 9.2 seconds of delay per bump
- (3) Traffic circles: 1.3 to 10.7 seconds of delay per circle

The drivers' performances did not appear to significantly influence the results. Their choices of deceleration and acceleration rates as well as their choices of minimum speeds near the devices were very consistent.

Conclusions.

The results provide quantitative data that can be used in the determination of the impacts of one or more traffic calming devices on fire response times along a given emergency response route. Additional information is necessary in order to make a complete assessment of these impacts. This includes: 1) the types of fire vehicles responding to emergencies; 2) the desirable and appropriate speed of fire vehicles at each of the calming devices located along the response route; 3) the geographical area that will be affected by any increase in delay to response times; and 4) the use of this route by fire vehicles given the likely demand for emergency services and the availability of good alternative routes.

A full assessment of the impacts on response times for a given set of traffic calming devices needs to be balanced with the benefits of traffic calming on reducing speeding problems and enhancing public safety and livability along neighborhood streets. This paper provides the initial quantitative data that is necessary to begin to weigh the pros and cons of traffic calming.

Recommendations.

1. Pursue full assessments of the impacts of specific traffic calming projects, either planned or existing projects, on emergency vehicle responses. The results of this assessment then needs to be compared to the benefits of the traffic calming project, especially the benefits to public safety.

2. To provide both fast response for emergency services and slower overall traffic speeds on neighborhood streets, a public process should be undertaken to address the tradeoffs (options) between these two community values and to provide policy direction for implementing traffic calming on a citywide basis. These options include the use of traffic signal preemption devices, the locating of new fire stations, fire vehicle modifications to minimize weight-to-horsepower ratios, securing and cushioning certain pieces of equipment, and improving vehicle suspensions. This should be done by revising the Transportation Element to include a classification for emergency response routes.

A.5.2.16.2 When considering whether to allow steeper grades, the fire department should recognize that fire apparatus is designed to operate on grades of 6 percent unless it is specifically designed for steeper grades. Moving over a steeper grade is different from operating on a steep grade for a prolonged period of time. Steep grades also often involve switchbacks, which will slow both access for fire apparatus and traffic flow exiting an area if there is a wildland fire. If the steeper grades are being allowed in areas where there are large amounts of natural fuels, the potential for a wildland fire must be recognized.

A.5.2.17.2 The AHJ should consider distances to water sources, fire flow, apparatus and equipment capabilities, and personnel availability when determining the acceptable length of a cul-de-sac.

A.5.2.17.3 Figure A.5.2.17.3 shows an example of a design for an intermediate turnaround in a cul-de-sac that exceeds 1200 ft (366 m).

A.5.3 A fire lane can be a subsurface construction of hard material designed to support the heaviest piece of fire apparatus likely to be driven on it and then covered with no more than 3 in. (75 mm) of soil, sod, or both or to the specifications of an engineered subsurface system. When a subsurface fire lane is constructed, it should be identified in a manner acceptable to the fire department.

A.5.4.1 The AHJ should consider requiring wider aisles if it is anticipated that the aisle areas will be used for tactical operations during an incident at the property.

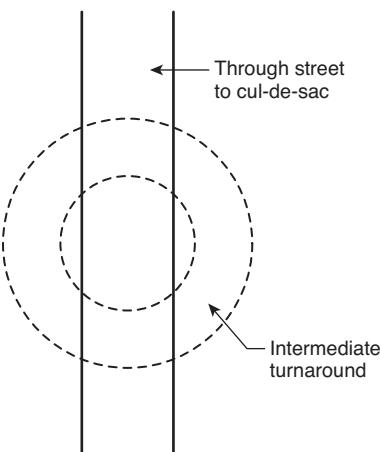


FIGURE A.5.2.17.3 Example of an Intermediate Turnaround.

A.6.1.1 Preconnected hose lines on pumping fire apparatus are normally 200 ft to 250 ft (60 m to 75 m) in length. The 150 ft (45 m) requirement allows fire fighters to stretch hose lines to a building access point on any exterior wall with a normal fire-fighting crew and have sufficient hose for fire-fighting operations inside the building.

A.6.1.3 The means of access for fire apparatus required by 6.1.3 is to allow an aerial ladder or elevating platform fire apparatus to have access to the exterior of the building to support fire-fighting operations.

A.6.1.4 The means of access for fire apparatus required by 6.1.4 is to allow an aerial ladder or elevating platform fire apparatus to have access to the exterior of the building in at least one location if aerial operations should become necessary. The required access in 6.1.2 can serve as this access if it extends to within 30 ft (9.144 m) of the building.

A.8.1.3 The AHJ should consider the fire-hydrant-to-building proximity in determining the location of the fire department connection pursuant to enforcement of this subsection. Fire hydrants should be located no closer than 50 ft (15.2 m) to the building being protected by the sprinkler system. This can be accomplished by locating the fire department connection away from the building.

A.8.2.1.4 The AHJ should consider the fire-hydrant-to-building proximity in determining the location of the fire department connection pursuant to enforcement of this section. Fire hydrants should be located no closer than 50 ft (15.2 m) to the building being protected by a standpipe system. This can be accomplished by locating the fire department connection away from the building.

A.8.2.2 This requirement can be met by providing one multi-purpose dry chemical fire extinguisher or one Class A and one Class B:C fire extinguisher. The reasoning behind the requirement to locate these extinguishers in the dwelling unit is to prevent theft.

A.9.1.4.5 See NFPA 1963.

A.9.2 It is assumed that water from a municipal-type water system will be immediately available. When a municipal-type water system is not available, NFPA 1142 requires that water delivery rate be established within 5 minutes of arrival at the incident.

A.9.3.6 It is anticipated that a stub and valve with box will be installed and left for connection of future fire hydrants.

A.9.3.10 See AWWA M31, *Distribution System Requirements for Fire Protection*, for guidance on pipe sizing.

A.10.1 NFPA 1 extracts most of its requirements for fire protection during construction from NFPA 241. The requirements in Chapter 10 of this standard should be used along with the provisions of NFPA 241, as applicable.

A.11.1 Extensive information and resources about disaster management and emergency preparedness are available in *NFPA 1600*. *NFPA 1600* promotes a common understanding of the fundamentals of planning and decision making to help entities examine all hazards and produce an integrated, coordinated, and synchronized program.

A.12.1 If it is recognized that the land use change will have significant impact on the fire protection demand, outside assistance might be required to perform the assessment. The AHJ might want to pass the cost of this assessment on to the developer.

A.12.2 Examples of possible solutions include expanding mutual aid or automatic aid agreements, requiring the developer to provide on-site facilities, requiring the developer to fund the augmentation of services, and requiring more built-in fire protection. For larger developments, regional planning for providing fire protection and EMS services can often identify better methods of providing the additional services needed than individualized local planning.

Annex B Informational References

B.1 Referenced Publications. The documents or portions thereof listed in this annex are referenced within the informational sections of this standard and are not part of the requirements of this document unless also listed in Chapter 2 for other reasons.

B.1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 1, *Fire Code*, 2015 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 2016 edition.

NFPA 241, *Standard for Safeguarding Construction, Alteration, and Demolition Operations*, 2013 edition.

NFPA 1142, *Standard on Water Supplies for Suburban and Rural Fire Fighting*, 2017 edition.

NFPA 1600®, *Standard on Disaster/Emergency Management and Business Continuity Programs*, 2016 edition.

NFPA 1963, *Standard for Fire Hose Connections*, 2014 edition.

B.1.2 Other Publications.

B.1.2.1 AWWA Publications. American Water Works Association, 6666 West Quincy Avenue, Denver, CO 80235.

AWWA M31, *Distribution System Requirements for Fire Protection*, 4th edition, 2008.

B.1.2.2 Other Publications.

Cova, Thomas J., "Public Safety in the Urban-Wildland Interface: Should Fire-Prone Communities Have a Maximum Occupancy?" *Natural Hazards Review*, Vol. 6, No. 3, August 1, 2005.

Highway Capacity Manual, Transportation Research Board, 1997. www.portlandonline.com/transportation.

The Influence of Traffic Calming Devices on Fire Vehicle Travel Times, Portland Bureau of Fire, Rescue and Emergency Service and Portland Office of Transportation, January 1996.

B.2 Informational References. The following documents or portions thereof are listed here as informational resources only. They are not a part of the requirements of this document.

B.2.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 20, *Standard for the Installation of Stationary Pumps for Fire Protection*, 2013 edition.

NFPA 22, *Standard for Water Tanks for Private Fire Protection*, 2013 edition.

NFPA 70®, *National Electrical Code*®, 2014 edition.

NFPA 80A, *Recommended Practice for Protection of Buildings from Exterior Fire Exposures*, 2012 edition.

NFPA 82, *Standard on Incinerators and Waste and Linen Handling Systems and Equipment*, 2014 edition.

NFPA 101®, *Life Safety Code*®, 2015 edition.

NFPA 211, *Standard for Chimneys, Fireplaces, Vents, and Solid Fuel-Burning Appliances*, 2013 edition.

NFPA 220, *Standard on Types of Building Construction*, 2015 edition.

NFPA 600, *Standard on Facility Fire Brigades*, 2015 edition.

NFPA 601, *Standard for Security Services in Fire Loss Prevention*, 2015 edition.

NFPA 1221, *Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems*, 2013 edition.

NFPA 1410, *Standard on Training for Initial Emergency Scene Operations*, 2015 edition.

NFPA 5000®, *Building Construction and Safety Code*®, 2015 edition.

Brannigan, Francis L., *Building Construction for the Fire Service*, 5th edition, 2012.

Fire Protection Handbook, 20th edition, 2008.

NFPA Fire and Life Safety Inspection Manual, 8th edition, 2012.

B.2.2 ISO Publications. ISO, Inc., 545 Washington Blvd., Jersey City, NJ 07310-1686.

Fire Suppression Rating Schedule, 2012.

Guide for Determination of Needed Fire Flow, 2005.

B.2.3 Other Information Sources. American Institute of Architects Research Corporation, 1735 New York Avenue, Washington, DC 20006.

American Insurance Service Group, 85 John Street, New York, NY 10038.

International City/County Managers' Association, 777 N. Capitol Street, Washington, DC 20002.

International Code Council, 5203 Leesburg Pike, Suite 600, Falls Church, VA 22041-3401

International Fire Marshals Association, c/o NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471.

B.3 References for Extracts in Informational Sections. (Reserved)