

NFPA 267

Standard Method of Test for Fire Characteristics of Mattresses and Bedding Assemblies Exposed to Flaming Ignition Source

1998 Edition



National Fire Protection Association, 1 Batterymarch Park, PO Box 9101, Quincy, MA 02269-9101
An International Codes and Standards Organization

Copyright ©
National Fire Protection Association, Inc.
One Batterymarch Park
Quincy, Massachusetts 02269

IMPORTANT NOTICE ABOUT THIS DOCUMENT

NFPA codes, standards, recommended practices, and guides, of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in its codes and standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on this document. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making this document available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of this document. Nor does the NFPA list, certify, test or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

NOTICES

All questions or other communications relating to this document and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

Users of this document should be aware that this document may be amended from time to time through the issuance of Tentative Interim Amendments, and that an official NFPA document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments then in effect. In order to determine whether this document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments, consult appropriate NFPA publications such as the *National Fire Codes*® Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed above.

A statement, written or oral, that is not processed in accordance with Section 5 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

The NFPA does not take any position with respect to the validity of any patent rights asserted in connection with any items which are mentioned in or are the subject of this document, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on this document. Users of this document are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Users of this document should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Licensing Policy

This document is copyrighted by the National Fire Protection Association (NFPA). By making this document available for use and adoption by public authorities and others, the NFPA does not waive any rights in copyright to this document.

1. Adoption by Reference—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription—**A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

3. Scope of License Grant—The terms and conditions set forth above do not extend to the index of this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Copyright © 1998 NFPA, All Rights Reserved

NFPA 267

Standard Method of Test for

Fire Characteristics of Mattresses and Bedding Assemblies Exposed to Flaming Ignition Source

1998 Edition

This edition of NFPA 267, *Standard Method of Test for Fire Characteristics of Mattresses and Bedding Assemblies Exposed to Flaming Ignition Source*, was prepared by the Technical Committee on Fire Tests and acted on by the National Fire Protection Association, Inc., at its Fall Meeting held November 17–19, 1997, in Kansas City, MO. It was issued by the Standards Council on January 16, 1998, with an effective date of February 6, 1998, and supersedes all previous editions.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

This edition of NFPA 267 was approved as an American National Standard on March 31, 1998.

Origin and Development of NFPA 267

NFPA 267 was created as a new standard in 1994 to represent the current testing procedures for fire characteristics of mattresses and bedding assemblies exposed to a flaming ignition source. This procedure was developed to provide information that can be used to aid in the selection of mattresses and bedding assemblies that provide less of a contribution of heat, flame, smoke, and gases to fire scenarios. This standard was originally developed by research conducted by the National Institute of Standards and Technology (NIST), Underwriters Laboratories Inc. (UL), and the California Bureau of Home Furnishings and Thermal Insulation (BHFTI).

The 1998 edition contains minor editorial modifications and some technical revisions. The revisions include the appropriate gas flow and testing durations, which correlate with similar requirements found in related documents such as ASTM E 1590 and California Technical Bulletin 129.

Technical Committee on Fire Tests

Jesse J. Beitel, *Chair*
Hughes Assoc. Inc., MD [SE]

April L. Berkol, ITT Sheraton Corp., NY [U]
Rep. American Hotel & Motel Assn.

John A. Blair, The DuPont Co., DE [M]
Rep. Society of the Plastics Industry Inc.

William P. Chien, State of New York Dept. of Fire Prevention & Control, NY [E]

William E. Fitch, Omega Point Laboratories Inc., TX [RT]

Sam W. Francis, American Forest & Paper Assn., PA [M]

Thomas W. Fritz, Armstrong World Industries Inc., PA [M]

James R. Griffith, Southwest Research Inst., TX [RT]

Marcelo M. Hirschler, GBH Int'l, CA [SE]

Alfred J. Hogan, Reedy Creek Improvement District, FL [E]
Rep. Fire Marshals Assn. of North America

Karl D. Houser, Gypsum Assn., DC [M]

William E. Koffel, Koffel Assoc. Inc., MD [SE]

James R. Lawson, U.S. Nat'l Inst. of Standards and Technology, MD [RT]

Gerald E. Lingenfelter, American Ins. Services Group Inc., NY [I]

William S. Metes, Underwriters Laboratories Inc., IL [RT]

George E. Meyer, Warnock Hersey, Inc., CA [RT]

John W. Michener, Milliken Research Corp., SC [M]
Rep. American Textile Mfrs. Inst. Inc.

James A. Milke, University of Maryland, MD [SE]

James C. Norris, Union Carbide Corp., TN [M]

John Roberts, Underwriters Laboratories of Canada, ON, Canada [RT]

T. Hugh Talley, Hugh Talley Co., TN [M]
Rep. Upholstered Furniture Action Council

David K. Tanaka, Factory Mutual Research Corp., MA [I]

Richard P. Thornberry, The Code Consortium, Inc., CA [SE]

Robert J. Wills, American Iron & Steel Inst., AL [M]

Peter J. Gore Willse, Industrial Risk Insurers, CT [I]
Rep. Industrial Risk Insurers

Alternates

Delbert F. Boring, Jr., American Iron & Steel Inst., OH [M]
(Alt. to R. J. Wills)

Tony Crimi, Underwriters Laboratories of Canada, ON, Canada [RT]
Alt. to J. Roberts)

Philip J. DiNenno, Hughes Assoc. Inc., MD [SE]
(Alt. to J. J. Beitel)

Richard G. Gann, U.S. Nat'l Inst. of Standards and Technology, MD [RT]
(Alt. to J. R. Lawson)

Richard D. Gottwald, Society of the Plastics Industry Inc., DC [M]
(Alt. to J. A. Blair)

Marc L. Janssens, Southwest Research Inst., TX [RT]
(Alt. to J. R. Griffith)

Gene V. Paolucci, Yasuda Fire & Marine Insurance Co. of America, NY [I]
(Alt. to G. E. Lingenfelter)

William A. Thornberg, Industrial Risk Insurers, CT [I]
(Alt. to P. J. G. Willse)

James J. Urban, Underwriters Laboratories Inc., IL [RT]
(Alt. to W. S. Metes)

Kay M. Villa, American Textile Mfrs. Inst. Inc., DC [M]
(Alt. to J. W. Michener)

Joe Ziolkowski, American Furniture Mfrs Assoc., NC [M]
(Alt. to T. H. Talley)

Nonvoting

Robert H. Barker, American Fiber Mfrs. Assn., DC [M]
(Alt. to T. L. Jilg)

James F. Hoebel, U.S. Consumer Product Safety Commission, MD

Walter P. Sterling, NFPA Staff Liaison

Tod L. Jilg, Hoechst Celanese Corp., NC [M]
Rep. to American Fiber Mfrs. Assn.

Herman H. Spaeth, Novato, CA
(Member Emeritus)

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in membership may have occurred. A key to classifications is found at the back of this document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on fire testing procedures for reviewing existing fire test standards and recommending appropriate action to NFPA; for recommending the application of and advising on the interpretation of acceptable test standards for fire problems of concern to NFPA technical committees and members; and for acting in a liaison capacity between NFPA and the committees of other organizations writing fire test standards. This Committee does not cover fire tests that are used to evaluate extinguishing agents, devices, or systems.

Contents

Chapter 1 General	267- 4	4-2 Daily Calibration	267- 7
1-1 Scope	267- 4	Chapter 5 Test Procedure	267- 7
1-2 Significance and Use	267- 4	5-1 Testing Procedure	267- 7
1-3 Summary of Test Method	267- 4	Chapter 6 Calculations	267- 7
1-4 Definitions	267- 4	6-1 Method of Calculation	267- 7
1-5 Units	267- 4	6-2 Symbols	267- 8
Chapter 2 Test Specimens	267- 4	6-3 Calibration Constant Using Propane	267- 8
2-1 Test Specimens	267- 4	6-4 Heat Release for Test Specimens	267- 8
Chapter 3 Test Equipment and Instrumentation	267- 4	6-5 Smoke Obscuration	267- 8
3-1 Ignition Source	267- 4	Chapter 7 Report of Results	267- 8
3-2 Collection — Exhaust System	267- 5	7-1 Documentation	267- 8
3-3 Velocity Measuring Instruments	267- 5	Appendix A Explanatory Material	267- 8
3-4 Gas Sampling and Analysis Equipment	267- 6	Appendix B Heat Release Calculations Using Additional Gas Analysis	267- 9
3-5 Smoke Density Measuring Instruments	267- 6	Appendix C Referenced Publications	267-10
3-6 Weighing Platform	267- 6	Index	267-11
3-7 Data Acquisition	267- 7		
3-8 Photographic and Video Equipment	267- 7		
Chapter 4 Calibration	267- 7		
4-1 Calibration of Equipment	267- 7		

NFPA 267

Standard Method of Test for

Fire Characteristics of Mattresses and
Bedding Assemblies Exposed to Flaming
Ignition Source

1998 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Appendix A.

Information on referenced publications can be found in Appendix C.

Chapter 1 General

1-1 Scope.

1-1.1 This test method, using an open calorimeter environment, shall be used to determine heat release, smoke density, weight loss, and generation of carbon monoxide of mattresses and bedding assemblies.

1-1.2* This test procedure shall be used to determine performance of mattresses and bedding assemblies without bedclothes exposed to a flaming ignition source. This performance data has been found to be useful in assessing the fire hazard of mattresses and bedding assemblies in occupancies that are identified as or considered to be public occupancies.

1-1.3* Heat release rate is indicated by measurement of oxygen depletion, and smoke generation is determined by smoke density measurement systems. Weight loss and carbon monoxide (CO) and carbon dioxide (CO₂) evolution are continuously recorded.

1-1.4* While this test method utilizes a full-scale open calorimeter, research has shown that both ASTM E 1590, *Standard Method for Fire Testing of Real Scale Mattresses*, and California Technical Bulletin 129, *Flammability Test Procedure for Mattresses for Use in Public Buildings*, provide comparable results for test specimens having heat release rates of 600 kW or less.

1-1.5 With respect to measurement of smoke and CO production, a quantitative relationship has not been established between measurements taken in the duct of the calorimeter exhaust system and measurements taken within the room. Accordingly, results of measurements of CO and smoke taken at different locations in different test environments shall not be considered equivalent.

1-2 Significance and Use.

1-2.1 This test method shall be used to determine the resulting fire performance characteristics of mattresses and bedding assemblies when exposed to a standard flaming ignition source.

1-2.2 The results from this procedure provide information that shall be permitted to be used as an aid in the selection of mattresses and bedding assemblies that provide for less contribution of heat, flame, smoke, and gases to fire scenarios.

1-2.3* Heat and smoke release rate measurements are sources of useful information for product development. They provide

a quantitative measure of specific changes in fire performance caused by product modifications.

1-3 Summary of Test Method.

1-3.1 This procedure shall provide for exposure of full-size specimens to a standard flaming ignition source in an open calorimeter environment.

1-3.2 The standard ignition source shall be a gas burner.

1-3.3 Determinations shall be made and recorded for parameters that include density of smoke, concentrations of carbon monoxide and carbon dioxide, weight loss, heat release rate, and total heat release.

1-4 Definitions.

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

Standard. A document, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and which is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions shall be located in an appendix, footnote, or fine-print note and are not to be considered a part of the requirements of a standard.

1-5 Units.

1-5.1 Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI).

1-5.2 If a value for measurement as given in this standard is followed by an equivalent value in other units, the first stated shall be regarded as the requirement. A given equivalent value shall be considered as approximate.

Chapter 2 Test Specimens

2-1 Test Specimens.

2-1.1 Size and Preparation. The test specimen shall consist of the actual mattress or bedding assembly item.

2-1.2 Conditioning. The test specimen shall be conditioned for at least 48 hours prior to test at 23°C ± 3°C (73°F ± 5°F) and a relative humidity of 50 percent ± 5 percent. Test specimens shall be tested within 10 minutes of removal from such conditions if the test conditions differ from those specified in 2-1.1.

Chapter 3 Test Equipment and Instrumentation

3-1 Ignition Source.

3-1.1 A 205-mm (8.07-in.) long "T" burner shall be constructed of 12 mm ± 1 mm (0.47 in. ± 0.039 in.) outside diameter stainless steel tubing with 0.89 mm ± 0.05 mm (0.034 in. ± 0.0019 in.) wall thickness (see Figure 3-1.1). There shall be 14 holes at 45 degrees above the centerline and spaced 13 mm ± 1 mm (0.5 in. ± 0.039 in.) apart and 9 holes at 45 degrees below the centerline and spaced 13 mm ± 1 mm (0.5 in. ± 0.039 in.) apart. All holes shall be 1 mm ± 0.1 mm (0.039 in. ± 0.0039 in.) in diameter (see Figure 3-1.1). The 1.07 m ± 0.2 m (42 in. ± 7.8 in.) straight arm of the burner shall be welded onto the rear of the burner at a 30-degree angle. The

burner shall be mounted on an adjustable height pole and shall be balanced by a counterweight or other appropriate mechanism.

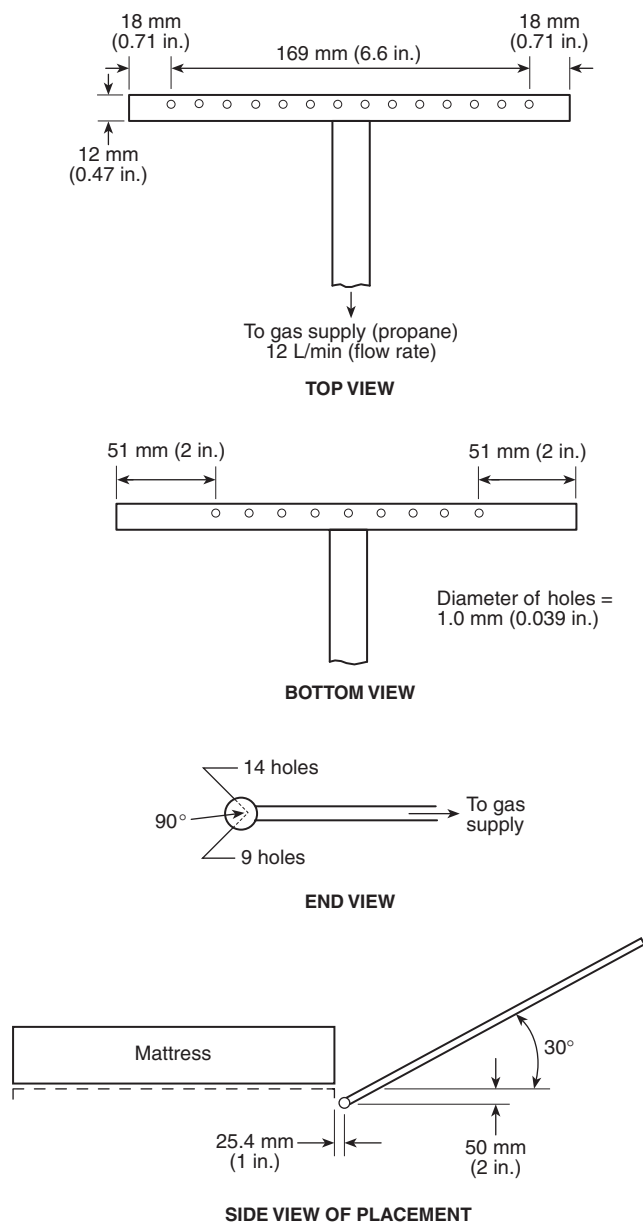


Figure 3-1.1 Propane gas burner.

3-1.2 The gas burner shall utilize commercial-grade propane gas as a fuel.

3-2 Collection — Exhaust System.

3-2.1 The hood shall be installed centrally above the weight-measuring system and test specimen. The face dimensions of the hood shall be $2.6 \text{ m} \pm 0.1 \text{ m} \times 2.6 \text{ m} \pm 0.1 \text{ m}$ ($8.53 \text{ ft} \pm 0.32 \text{ ft} \times 8.53 \text{ ft} \pm 0.32 \text{ ft}$) and the depth shall be $1.1 \text{ m} \pm 0.1$

m ($3.6 \text{ ft} \pm 0.32 \text{ ft}$). The hood shall exhaust into a plenum having a $0.9 \text{ m} \pm 0.05 \text{ m} \times 0.9 \text{ m} \pm 0.05 \text{ m}$ ($2.9 \text{ ft} \pm 0.16 \text{ ft} \times 2.9 \text{ ft} \pm 0.16 \text{ ft}$) cross section (see Figure 3-2.1). Other hood sizes shall be permitted, provided they produce equivalent test results. The distance between the lower edge of the hood and the weight-measuring system shall be approximately 2.4 m (7.87 ft).

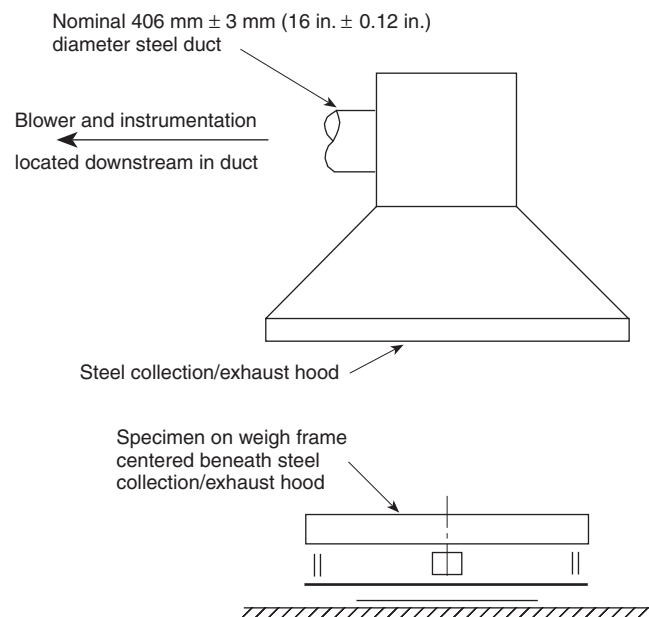


Figure 3-2.1 Collection hood and exhaust duct.

3-2.2* The exhaust duct connected to the plenum shall be $406 \text{ mm} \pm 3 \text{ mm}$ ($16 \text{ in.} \pm 0.12 \text{ in.}$) in diameter and shall have a circular aperture of $305 \text{ mm} \pm 3 \text{ mm}$ ($11.9 \text{ in.} \pm 0.12 \text{ in.}$) at its entrance.

3-2.3 The exhaust system shall have sufficient exhaust capacity to collect all products of combustion developed by the burning specimen. The exhaust hood system shall be capable of being operated within a range that varies from a minimum rate of $0.47 \text{ m}^3/\text{sec}$ ($16.6 \text{ ft}^3/\text{sec}$) to a maximum rate of at least $2.4 \text{ m}^3/\text{sec}$ ($84.8 \text{ ft}^3/\text{sec}$).

3-2.4 An alternate exhaust system design shall be permitted to be used if it has been shown to produce equivalent results.

3-3 Velocity Measuring Instruments.

3-3.1 The velocity in the exhaust duct shall be determined by measuring the differential pressure in the flow path with the use of a bidirectional probe, as shown in Figure 3-3.1, connected to an electronic pressure gauge or an equivalent measuring system. The probe shall consist of a stainless steel cylinder with a solid diaphragm in the center that divides it into two chambers. The probe shall measure 44 mm (1.7 in.) long and have an inside diameter of 22 mm (0.86 in.). The pressure taps on either side of the diaphragm shall support the probe.

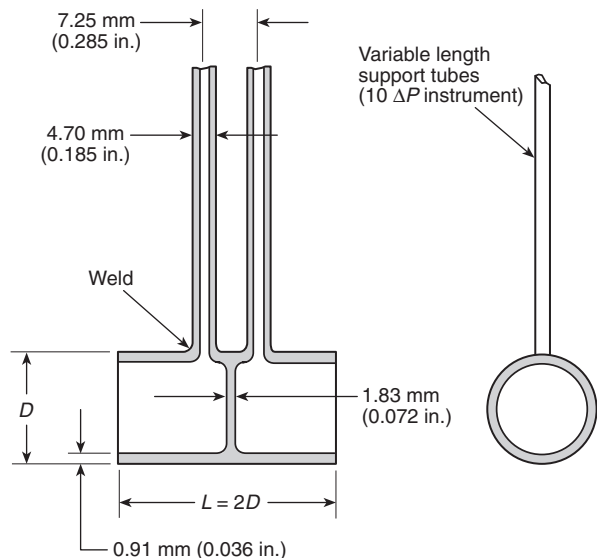


Figure 3-3.1 Bidirectional probe.

3-3.2 The axis of the probe shall be located at the centerline of the duct a minimum of 10 diameters downstream from the last turn in the duct. The taps shall be connected to a pressure transducer with a minimum resolution of 0.25 Pa (0.001 in. of water).

3-3.3 The temperature of the exhaust gas shall be measured upstream approximately $152 \text{ mm} \pm 15 \text{ mm}$ (5.9 in. $\pm$ 0.6 in.) from the probe at the centerline of the duct with a No. 28 AWG (0.08 mm²), Type K thermocouple with an inconel sheath having a 16-mm (0.62-in.) outside diameter and a thickness of 3 mm (0.12 in.).

3-4 Gas Sampling and Analysis Equipment.

3-4.1* A stainless steel gas sampling tube shall be located at least 10 diameters downstream from the last turn in the duct to obtain a continuously flowing sample for determining the oxygen concentration of the exhaust gas as a function of time. A suitable filter and cold trap shall be placed in line ahead of the analyzer to remove particulates and water. The oxygen analyzer shall be of the paramagnetic type and shall be capable of measuring the oxygen concentration in the range of from 0 percent to 21 percent with an accuracy of ± 0.2 percent of full-scale setting. The signal from the oxygen analyzer shall attain 90 percent of the calibration value within 30 seconds after introducing a step change in composition of the gas stream flowing past the inlet to the sampling tube.

3-4.2* The gas sampling tube shall be located and defined as in 3-4.1. The carbon monoxide analyzer shall be capable of measuring the carbon monoxide in a range of from 0 percent to 1.0 percent with an accuracy of ± 0.02 percent of full-scale setting. The signal from the analyzer shall attain 90 percent of the calibration value within 30 seconds after introducing a step change in composition of the gas stream flowing past the inlet to the sampling tube.

3-4.3* The gas sampling tube shall be as located and described in 3-4.1. The carbon dioxide analyzer shall be capable of measuring the carbon dioxide concentration in a range of from 0 percent to 10 percent with an accuracy of ± 0.2 percent of full-scale setting. The signal from the analyzer shall

attain 90 percent of the calibration value within 30 seconds after introducing a step change in composition of the gas stream flowing past the inlet to the sampling tube.

3-5 Smoke Density Measuring Instruments.

3-5.1 The smoke density measuring system shall be a white light system.

3-5.2 The lamp shall be of the incandescent filament type and shall operate at a color temperature of $2900 \text{ K} \pm 100 \text{ K}$. The lamp shall be supplied with stabilized direct current, stable within ± 0.2 percent, including temperature and short-term and long-term stability.

3-5.3 The lens system shall be selected such that the lens shall have a diameter, d , chosen with regard to the focal length, f , so that $d/f \leq 0.04$.

3-5.4 The aperture shall be placed in the focus of the lens.

3-5.5 The detector shall have a spectrally distributed response according to the CIE photopic curve. The detector shall be linear within 5 percent for an output range of at least 3.5 decades. This linearity shall be checked periodically with calibrated optical filters that shall cover the entire range of the instrument.

3-5.6 The system shall be mounted on a horizontal section of duct at a point where it will be preceded by a straight run of duct [at least 12 diameters or 5.2 m (17 ft)] and with the light beam directed upward along the vertical axis of the duct. A photoelectric cell, whose output is directly proportional to the amount of light received, shall be mounted over the light source and connected to a recording device. The recording device shall have an accuracy within ± 1 percent of full scale for indicating changes in the attenuation of incident light resulting from the passage of smoke, particulate, and other effluents. The distance between the light source lens and the photocell lens shall be $914 \text{ mm} \pm 102 \text{ mm}$ (35.6 in. $\pm$ 3.9 in.). The cylindrical light beam shall pass through $76 \text{ mm} \pm 3 \text{ mm}$ (2.9 in. $\pm$ 0.12 in.) diameter openings at the top and bottom of the duct, with the resultant light beam centered on the photocell.

3-5.7 An alternate smoke density measuring system shall be permitted to be used if it has been shown to produce equivalent results.

3-6 Weighing Platform.

3-6.1 Mass loss rate of the burning specimen shall be measured during the test by means of a weight-measuring device.

3-6.2 A weighing platform shall be used to support the test specimen during the test. A reinforced inorganic board having the dimensions $1.2 \text{ m} \pm 0.1 \text{ m} \times 2.4 \text{ m} \pm 0.1 \text{ m}$ (3.9 ft $\pm$ 0.32 ft $\times$ 7.87 ft $\pm$ 0.32 ft) shall be located on top of the weighing platform. The weighing platform perimeter shall have a rim extending $0.1 \text{ m} \pm 10 \text{ mm}$ (0.32 ft $\pm$ 0.39 ft) above the top surface of the inorganic board to prevent spillage of test material.

3-6.3 The weight-measuring device shall be capable of measuring the specimen mass up to at least 90 kg (198.5 lb) with an accuracy of at least $\pm 150 \text{ g}$ (0.33 lb). It shall be installed in such a way that the heat from the burning specimen and any eccentricity of the load do not affect the accuracy. Care shall be taken to avoid range shifts during measurements. All parts of the weight-measuring device shall be located below the top level of the slab.

3-6.4 The weighing platform shall support the base of the furniture specimen 127 mm $\pm$ 76 mm (5 in. $\pm$ 3 in.) above the floor.

3-6.5 The weighing platform shall be located beneath the collection hood at its geometric center.

3-7 Data Acquisition. A digital data acquisition system shall be used to collect and record oxygen, carbon monoxide, and carbon dioxide analyzer measurements; pressure gauge measurements; temperatures; smoke measurements; and weight-measuring device measurements. The speed and capacity of the data system shall be sufficient to collect the data every 5 seconds.

3-8 Photographic and Video Equipment. A camera and video equipment shall be used to record the test specimen performance throughout each test.

Chapter 4 Calibration

4-1 Calibration of Equipment.

4-1.1 The equipment and instrumentation shall be calibrated.

4-1.2 The heat release instrumentation shall be calibrated by burning propane. A gas burner shall be constructed with a 100 mm $\pm$ 6 mm (3.9 in. $\pm$ 0.23 in.) layer of Ottawa sand to provide the horizontal surface through which the gas is supplied. The gas supply to the burner shall be of commercial-grade propane and shall have a net heat of combustion of 46.4 MJ/kg $\pm$ 0.5 MJ/kg (20,000 Btu/lb $\pm$ 200 Btu/lb). The flow rate of propane shall be metered and kept constant throughout the calibration test. A heat release value of 160 kW shall be used for calibration. The test shall be conducted for a period of 10 minutes.

4-1.3 A calibration constant, C , shall be obtained as described in Chapter 6. A value for C differing more than 10 percent from the theoretical value shall not be permitted and the equipment shall be checked. For the exhaust duct configuration described in Section 3-2 and the velocity probe described in Section 3-3, C shall have a theoretical value of 2.8.

4-2 Daily Calibration.

4-2.1 Prior to the start of each day of testing, the equipment calibrations described in 4-2.2 through 4-2.7 shall be performed.

4-2.2 The oxygen analyzer shall be zeroed and spanned. The analyzer shall be zeroed by introducing 100 percent nitrogen gas to the instrument at the same pressure and flow rate as set for the test specimen combustion gases. The analyzer shall be spanned by introducing ambient duct air via the sample probe and adjusting the span to 20.95 percent oxygen. The spanning and zeroing process shall continue until adjustment-free accuracy is obtained.

4-2.3 Following zeroing and spanning, linearity of the oxygen analyzer response curve shall be verified by introducing bottled gas of a known oxygen concentration to the analyzer. The delay time of the analyzer shall be checked by introducing ambient duct air to the analyzer and noting the time at which the analyzer readings reach 90 percent of the final reading.

4-2.4 The CO analyzer and CO₂ analyzer shall be zeroed and spanned in the same manner as the oxygen analyzer. The analyzer shall be zeroed by introducing 100 percent nitrogen gas to the instrument at the same pressure and flow rate as set for

the test specimen combustion gases. The analyzer shall be spanned by feeding each analyzer with bottled gas containing the selected concentration of span gas and adjusting for the response range of each analyzer.

4-2.5 The delay time of each analyzer shall be determined. The delay time shall be measured by introducing either a calibration span gas (for CO and CO₂) or a zero gas (for O₂) at the sample line just outside the duct and noting the time at which the analyzer readings reach 90 percent of the final reading.

4-2.6 The weight-measuring device shall be calibrated with known weights suitable for the capacity of the equipment and the specimen being tested.

4-2.7 Linearity of the smoke density measuring system shall be verified by interrupting the light beam with multiple calibrated neutral density filters to cover the range of the recording instrument. Transmittance values measured by the photometer, using neutral density filters, shall be within ± 3 percent of the calibrated value for each filter.

Chapter 5 Test Procedure

5-1 Testing Procedure.

5-1.1 The test specimen and weighing platform shall be located as shown in Figure 3-2.1.

5-1.2 The initial exhaust hood flow rate shall be set at a minimum of 0.47 m³/sec (16.6 ft³/sec).

5-1.3 The burner shall be positioned 25 mm $\pm$ 3 mm (0.97 in. $\pm$ 0.12 in.) from the side and 51 mm $\pm$ 3 mm (2 in. $\pm$ 0.12 in.) below the item with the center of the burner at the centerline of the test specimen.

5-1.4 Data acquisition shall begin in order to monitor test instrumentation.

5-1.5 The gas flow rate to the burner shall be set at a volume flow rate of 12 L/min $\pm$ 0.5 L/min (3.2 gal/min $\pm$ 0.13 gal/min). Care shall be taken to allow free flow of propane through the burner holes. Periodic cleaning of soot deposits and blowing pressurized air through the tube shall be required.

5-1.6 The burner shall be ignited.

5-1.7 The exhaust hood flow rate shall be increased as required to collect all products of combustion from the test specimen.

5-1.8 The burner shall be removed from the test specimen after an exposure of 180 seconds $\pm$ 2 seconds.

5-1.9 The burner shall be turned off.

5-1.10 Combustion shall be allowed to continue until one or more of the following conditions are reached:

- (a) All flaming combustion has ceased.
- (b) Thirty minutes have elapsed from the time the burner was ignited.

Chapter 6 Calculations

6-1 Method of Calculation. The symbols used in this chapter shall be defined as in Section 6-2 and Appendix B. The equations in this chapter shall assume that only oxygen is measured.

Appropriate equations that shall be used for those cases where additional gas analysis equipment (CO₂, CO, water vapor) is used are provided in Appendix B. If a CO₂ analyzer is used and CO₂ is not removed from the oxygen sampling lines, then the appropriate equations in Appendix B shall be used.

6-2 Symbols. The following symbols are used in this chapter:

C	= calibration constant using propane (m ^{1/2} kg ^{1/2} K ^{1/2})
$\Delta H_c/r_o$	= net heat released per kg of O ₂ consumed (kJ/kg), where ΔH_c equals net heat of combustion (kJ/kg) and r_o equals stoichiometric oxygen/fuel mass ratio
I	= light intensity
I_o	= light intensity with no smoke
k	= extinction coefficient (m ⁻¹)
L	= path length (m)
ΔP	= orifice meter pressure differential (Pa)
$\dot{q}''$	= heat release rate per unit area (kW/m ²)
t	= time (sec)
t_d	= oxygen analyzer delay time (sec)
T_e	= absolute temperature of gas at the orifice meter (K)
X_{O_2}	= oxygen analyzer reading, mole fraction O ₂
$X_{O_2}^0$	= initial value of oxygen analyzer reading
$X_{O_2}^1$	= oxygen analyzer reading, before delay time correction

6-3 Calibration Constant Using Propane. The calibration constant shall be obtained from the following equation:

$$C = \left[\frac{160}{1.10(12.77 \times 10^3)} \right] \left(\sqrt{\frac{T_e}{\Delta P}} \right) \left(\frac{1.084 - 1.4X_{O_2}}{X_{O_2}^0 - X_{O_2}} \right)$$

In this equation 160 corresponds to 160 kW propane supplied, 12.77×10^3 equals $\Delta H_c/r_o$ for propane, and 1.10 is the ratio of oxygen to air molecular weight.

6-4 Heat Release for Test Specimens.

6-4.1 Prior to performing additional calculations, the oxygen analyzer time shift shall be determined by the following equation:

$$X_{O_2}(t) = X_{O_2}^1(t - t_d)$$

6-4.2 The heat release rate then shall be determined by the following equation:

$$\dot{q}(t) = \left(\frac{\Delta H_c}{r_o} \right) 1.10C \left(\sqrt{\frac{\Delta P}{T_e}} \right) \left[\frac{X_{O_2}^0 - X_{O_2}(t)}{1.084 - 1.4X_{O_2}(t)} \right]$$

6-4.3 The value of $(\Delta H_c/r_o)$ for the test specimen shall be set equal to 13.1×10^3 kJ/kg unless a more accurate value is known for the test specimen.

6-4.4 The total heat released during the first 10 minutes of the test shall be determined by the following equation:

$$\dot{q}''i = \sum_{i=0}^{10} \dot{q}''i(t)\Delta t$$

6-5 Smoke Obscuration.

6-5.1 The extinction coefficient (k) of smoke shall be determined by the following equation:

$$k = \frac{1}{L} \ln \left(\frac{I_o}{I} \right)$$

6-5.2 The smoke release rate (SRR) shall be calculated using the optical density per linear path length and the volumetric flow rate in the duct. The SRR shall be determined by the following equation:

$$SRR = km$$

In this equation SRR equals the smoke release rate in m²/sec, k equals the extinction coefficient, and m equals the volumetric flow rate in m³/sec referred to 298 K.

Chapter 7 Report of Results

7-1 Documentation. The following shall be reported for each test specimen:

- Test specimen identification or number
- Manufacturer or submitter
- Date of test
- Operator
- Composition or generic identification
- Details of preparation
- Number of replicate specimens tested
- Time to termination of test (sec)
- Maximum mass loss (kg)
- Peak rate of heat release (kW)
- Time to peak rate of heat release (sec)
- Maximum smoke release rate (m²/sec)
- Maximum carbon monoxide concentration (ppm)
- Maximum carbon dioxide concentration (ppm)
- Pretest photographic record of test specimen.

Appendix A Explanatory Material

Appendix A is not a part of the requirements of this NFPA document but is included for informational purposes only. This appendix contains explanatory material, numbered to correspond with the applicable text paragraphs.

A-1-1.2 This procedure is based on California Technical Bulletin 129, *Flammability Test Procedure for Mattresses for Use in Public Buildings*. This test may not predict changes in fire performance due to aging, wear, leaching, or contamination during normal use or due to abuse.

A-1-1.3 This test method does not take into consideration any effect of potential vandalism. Vandalism of the composite mattress could change the fire performance characteristics of certain mattress construction.

A-1-1.4 For further information on other test environments, see the following publications:

“Furniture Flammability: An Investigation of the California Technical Bulletin 133 Test — Part 1: Measuring the Hazards of Furniture Fires,” by J. Quintiere.

“Furniture Flammability: An Investigation of the California Technical Bulletin 133 Test — Part 2: Characterization of Ignition Source and Comparable Gas Burner,” by T. Ohlemiller and K. Villa.

“Furniture Flammability: An Investigation of the California Technical Bulletin 133 Test — Part 3: Full-Scale Chair Burns,” by W. J. Parker, et al.

A-1-2.3 This procedure is not intended to be used for the evaluation of residential mattresses.

A-3-2.2 The locations for velocity, temperature, gas analysis, and smoke photometer shall be chosen to ensure that the products of combustion are well-mixed and not stratified at the sampling location. The general rule is for the duct to run a sufficient length (10 diameters) downstream from the last turn in the duct prior to location of instrumentation to provide for a fully developed gas flow. Mixing vanes shall be required in the duct if concentration gradients are found to exist.

A-3-4.1 The following information is provided for informational purposes only and has not been independently verified, certified, or endorsed by the NFPA or any of its Technical Committees.

One type of oxygen analyzer is a Beckman Instrument Model 755 paramagnetic-type oxygen analyzer. Other equivalent oxygen analyzers may be permitted to be used.

A-3-4.2 The following information is provided for informational purposes only and has not been independently verified, certified, or endorsed by the NFPA or any of its Technical Committees.

One type of carbon monoxide analyzer is a Horiba Instrument Model PIR-2000 analyzer. Other equivalent carbon monoxide analyzers may be permitted to be used.

A-3-4.3 The following information is provided for informational purposes only and has not been independently verified, certified, or endorsed by the NFPA or any of its Technical Committees.

One type of carbon dioxide analyzer is a Horiba Instrument Model PIR-2000 analyzer. Other equivalent carbon dioxide analyzers may be permitted to be used.

Appendix B Heat Release Calculations Using Additional Gas Analysis

This appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

B-1 Calculation of Heat Release with Additional Gas Analysis.

B-1.1 The equations used to calculate heat release rate in Chapter 6 assume CO₂ is removed from the gas sample in a chemical scrubber before oxygen is measured. Some laboratories are equipped to measure CO₂; in such a case, it is not necessary to remove the CO₂ from the oxygen line. The advantage

is that the chemical scrubbing agent, which is costly and needs careful handling, can be avoided.

B-1.2 In this appendix, equations are provided that should be used when CO₂ is measured but *not* scrubbed out of the sampling lines. Two cases are considered. In the first case, part of the dried and filtered sample stream is diverted into infrared CO₂ and CO analyzers. In the second case, a water-vapor analyzer is also added. To avoid condensation, when measuring water-vapor concentration in the flow of combustion products, a separate sampling system with heated filters, heated sampling lines, and a heated analyzer is needed.

B-2 Symbols. The following symbols are used in this appendix:

$\Delta H_c / r_o$ = net heat released per kg of O₂ consumed kJ/kg, where equals net heat of combustion kJ/kg and equals stoichiometric oxygen/fuel mass ratio

M_a = molecular weight of air (kg/kmol)

M_e = molecular weight of the combustion products (kg/kmol)

$\dot{m}_e$ = exhaust duct mass flow rate (kg/sec)

t_d^1 = delay time of the CO₂ analyzer(s)

t_d^2 = delay time of the CO analyzer(s)

t_d^3 = delay time of the water-vapor analyzer(s)

$X_{CO_2}^0$ = initial CO₂ reading, mole fraction

X_{CO}^0 = initial CO reading, mole fraction

$X_{H_2O}^0$ = initial water-vapor reading, mole fraction

$X_{O_2}^a$ = ambient oxygen mole fraction (mol/mol)

$X_{CO_2}^1$ = CO₂ reading before delay time correction, mole fraction

X_{CO}^1 = CO reading before delay time correction, mole fraction

$X_{H_2O}^1$ = water-vapor reading before delay time correction, mole fraction

X_{CO_2} = CO₂ reading after delay time correction, mole fraction

X_{CO} = CO reading after delay time correction, mole fraction

X_{H_2O} = water reading after delay time correction, mole fraction

ϕ = oxygen depletion factor

B-3 Where CO₂ and CO Are Measured.

B-3.1 As in the case of the oxygen analyzer, measurements of CO₂ and CO should be time-shifted to take transport time in the sampling lines into account as follows:

$$X_{O_2}(t) = X_{O_2}^1(t + t_d)$$

$$X_{CO_2}(t) = X_{CO_2}^1(t + t_d^1)$$

$$X_{CO}(t) = X_{CO}^1(t + t_d^2)$$