

NATIONAL FUEL GAS CODE

An American National Standard

Secretariats





Batterymarch Park Quincy, MA 02269

NOTICE

All questions or other communications relating to this document should be sent to the American Gas Association Laboratories and the National Fire Protection Association Headquarters addressed to the attention of the committee responsible for the document.

For information on obtaining Formal Interpretations of the document, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Chairman, American National Standards Committee Z223, 8501 East Pleasant Valley Road, Cleveland, Ohio 44131 and the Secretary, Standards Council. National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

A statement written or oral that is not processed in accordance with the interpretation procedure of the Z223 Committee or with Section 16 of the NFPA Regulations Governing Committee Projects shall not be considered the position respectively of the Z223 Committee or the NFPA, and shall not be considered nor relied upon as a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. The American Gas Association and the National Fire Protection Association do not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

Fourth Edition — 1988

Printed in U.S.A.

Copyright © 1988 by the American Gas Association and the National Fire Protection Association. Permission is granted to republish in full the material herein in laws, ordinances, regulations, administrative orders or similar documents issued by public authorities. All others desiring permission to reproduce this material in whole or in part shall consult the American Gas Association Laboratories, 8501 East Pleasant Valley Road. Cleveland, Ohio 44131 and the National Fire Protection Association, Batterymarch Park, Quincy, MA 02269. (For further explanation, see the Policy Concerning the Adoption, Printing and Publication of NFPA Documents which is available upon request from the NFPA.)

NATIONAL FUEL GAS CODE

ANSI Z223.1-1988

NFPA 54-1988

1988 Edition of ANSI Z223.1—NFPA 54

This 1988 edition incorporates changes to the 1984 edition. It was adopted by the National Fire Protection Association (NFPA) on July 15, 1988 and approved by the American National Standards Institute, Inc. (ANSI) on August 22, 1988. The ANSI designation is Z223.1-1988. The NFPA designation is 54-1988.

Changes, other than editorial, from the 1984 edition, are denoted by a vertical line in the margin.

PREFACE

(This Preface is informative and is not part of the Code.)

This *Code* offers general criteria for the installation and operation of gas piping and gas equipment on consumers' premises. It is the cumulative result of years of experience of many individuals and many organizations acquainted with the installation of gas piping and equipment designed for utilization of gaseous fuels. It is intended to promote public safety by providing guidelines for the safer and more satisfactory utilization of gas.

Changes in this *Code* may become necessary from time to time. When any revision is deemed advisable, recommendations should be forwarded to the Chairman, Accredited Standards Committee Z223, 8501 East Pleasant Valley Road, Cleveland, Ohio 44131, and the Secretary, Standards Council, National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

HISTORY OF DEVELOPMENT OF NATIONAL FUEL GAS CODE

(This History is informative and is not part of the Code.)

As a result of the expressed need within the gas industry, among public safety authorities, insurance groups, architects, designers, and builders, for one Code that would cover all facets of fuel gas piping and appliance installation downstream from meter set assemblies or other facilities comprising the gas service entrance to consumers' premises, a meeting of a Conference Group on Piping and Installation Standards, consisting of representatives from the American Gas Association, the American Society of Mechanical Engineers, and the National Fire Protection Association, was held on October 25, 1967 to consider the development of a National Fuel Gas Code.

At a January 1968 meeting, a working group of this conference group developed the objectives and scope of a proposed National Standards Committee which envisioned the combining American National Standards Z21.30 (NFPA 54), Installation of Gas Appliances and Gas Piping, Z83.1 (NFPA 54A), Installation of Gas Piping and Gas Equipment on Industrial Premises and Certain Other Premises; and B31.2, Fuel Gas Piping, into a National Fuel Gas Code. The proposed scope ultimately agreed on limited coverage of piping systems to a maximum operating pressure of 60 psig. National Standards Committees Z21, Z83, and B31 agreed to relinquish, respectively, Z21.30, Z83.1, and that portion of B31.2 covering piping systems at pressures up to and including 60 psig.

On August 13, 1971, the American National Standards Institute approved the scope of activities and the formation of a National Standards Committee on National Fuel Gas Code, Z223, cosponsored by the American Gas Association, the American Society of Mechanical Engineers, and the National Fire Protection Association.

In order to establish a National Fuel Gas Code to satisfy the immediate needs of the gas industry for a single installation code, the Z223 Committee, at its organizational meeting on December 6, 1972, combined NFPA 54-1969 and Z83.1-1972 with only those editorial revisions necessary to accomplish the combination and to reflect the new scope of the standard. It had been recognized that further revisions of the *Code* would be necessary to incorporate the pertinent coverage for fuel gas piping from B31.2-1968.

The first edition of the *Code*, which combined NFPA 54-1969 and Z83.1-1972, was issued in 1974. The second edition — in which Parts 1 and 2 were consolidated and reorganized and pertinent portions of ANSI B31.2. *Fuel Gas Piping*, which was withdrawn, were added — was issued in 1980. The third edition was issued in 1984.

This, the fourth edition of the *Code*, which includes revisions in line with industry developments and current installation practices, was approved as an American National Standard by the American National Standards Institute, Inc., on August 22, 1988. It was adopted by the National Fire Protection Association, Inc., at its May 16-18, 1988 annual meeting in Los Angeles, California and issued by the NFPA Standards Council on July 15, 1988. The NFPA effective date for this edition of the *Code* is August 8, 1988.

COMMITTEE ON NATIONAL FUEL GAS CODE

E. E. Wachter, Chairman J. H. Witte, Vice Chairman

F. G. Hammaker, Administrative Secretary (Non-Member)

Representing American Gas Association:

J. J. Drechsler Kenneth W. Hoggard **Bruce Murray** Arthur J. Thompson

Representing Alliance of American

Insurers: Robert E. Rhead

Thomas H. Miller (Alternate)

Representing American Insurance Services Group, Inc.:

Wallace D. Malmstedt

Representing Factory Mutual System:

James M. Simmons Richard Leone (Alternate)

Representing Fire Marshals Association of North America:

Larry H. Bosell John W. Dries, Jr.

Representing Gas Appliance

Manufacturers Association, Inc.:

Ross K. Burnside

Russell E. Dockum (Z223 Committee

Wilbur Haag, Jr. (Z223 Committee only) Isaac Sargunam (Z223 Committee only)

Representing Gas Vent Institute:

J. H. Witte

Representing International Association of Plumbing and Mechanical Officials:

Robert Picott

John W. Meacham (Alternate)

A.G.A. Staff Liaison: Forrest G. Hammaker Allen J. Callaban

Representing National Association of Plumbing-Heating-Cooling

Contractors:

Richard E. White

Milton Snyder (Alternate)

Representing National Fire Protection

Association:

Theodore C. Lemoff (Z223 Committee

only)

Representing National LP-Gas

Association:

John R. Kukucka

Hal M. Faulconer (Alternate)

Representing National Park Service:

Kenneth R. Rueff

Representing Piping Industry Progress and Education Labor-Management

Cooperation Committee:

E. E. Wachter

Representing Southern Building Code

Congress: Willard L. Amann

Richard Vognild (Alternate)

Representing Underwriters Laboratories Inc.:

Enno Toomsalu

David W. Engblom (Alternate)

NFPA Staff Liaison: Theodore C. Lemoff

NATIONAL FUEL GAS CODE COMMITTEE

The National Fuel Gas Code Committee is a Committee functioning jointly under the procedures of the American National Standards Institute and the National Fire Protection Association and, accordingly, the National Fuel Gas Code bears two designations, ANSI Z223.1 and NFPA 54. In the ANSI context, the Code is prepared by the American National Standards Committee on National Fuel Gas Code, Z223, cosponsored by the American Gas Association (Administrative Secretariat) and the National Fire Protection Association. In the NFPA context the Committee is an NFPA Technical Committee. The personnel on both Committees is identical except as noted in the Committee roster with respect to Messrs. Dockum, Haag, Lemoff, and Sargunam.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or of any document developed by the Committee on which the member serves.

PART 1	— GENERAL	PAGE
1.1	Scope	1
1.2	Alternate Materials, Equipment, and Procedures	3
1.3	Retroactivity	3
1.4	Qualified Agency	3
1.5	Interruption of Service	3
1.6	Prevention of Accidental Ignition	4
1.7	Definitions	5
PART 2	— GAS PIPING SYSTEM DESIGN,	
	MATERIALS, AND COMPONENTS	
2.1	Piping Plan	33
2.2	Provision for Location of Point of Delivery	33
2.3	Interconnections Between Gas Piping Systems	33
2.4	Sizing of Gas Piping Systems	33
2.5	Piping System Operating Pressure Limitations	35
2.6	Acceptable Piping Materials and Joining Methods	36
2.7	Gas Meters	42
2.8	Gas Pressure Regulators	43
2.9	Overpressure Protection Devices	44
2.10	Back Pressure Protection	47
2.11	Low Pressure Protection	48
2.12	Shutoff Valves	48
2.13	Expansion and Flexibility	48
PART 3	— GAS PIPING INSTALLATION	
3.1	Piping Underground	49
3.2	Aboveground Piping Outside	50
3.3	Piping in Buildings	50
3.4	Concealed Piping in Buildings	52
3.5	Piping in Vertical Chases	53
3.6	Gas Pipe Turns	54
3.7	Drips and Sediment Traps	55
3.8	Outlets	55
3.9	Branch Pipe Connection	56
3.10	Manual Gas Shutoff Valves	56
3.11	Prohibited Devices	57
3.12	Systems Containing Gas-Air Mixtures Outside the	
	Flammable Range	57
3.13	Systems Containing Flammable Gas-Air Mixtures	57
3.14	Electrical Bonding and Grounding	60

	Electrical Circuits	61 61
PART	4 — GAS PIPING INSPECTION, TESTING, AND	
	PURGING	
4.1	Pressure Testing and Inspection	62
4.2	System and Equipment Check	65 65
4.3	Purging	03
PART :	5 — EQUIPMENT INSTALLATION	
5.1	General	68
5.2	Accessibility and Clearance	74
5.3	Air for Combustion and Ventilation	75
5.4	Equipment on Roofs	79
5.5	Equipment Connections to Building Piping	81
5.6	Electrical	83
5.7	Room Temperature Thermostats	84
DA DT	6 — INSTALLATION OF SPECIFIC EQUIPMENT	
6.1	General	85
6.2	Air Conditioning Equipment	85
6.3	Central Heating Boilers and Furnaces	87
6.4	Clothes Dryers	96
6.5	Conversion Burners.	98
6.6	Decorative Appliances for Installation in Vented	70
0.0	Fireplaces	98
6.7	Decorative Appliances, Vented	100
6.8	Direct Make-Up Air Heaters	100
6.9	Duct Furnaces.	102
6.10		102
6.11	Food Service (Commercial Cooking) Equipment,	103
0.11	Floor-Mounted	105
6.12		103
0.12	Appliances	108
6.13		109
6.14		109
6.15		111
6.16	Incinerators, Commercial-Industrial	113
6.17	Incinerators, Commercial-Industrial	113
6.18		115
6.19		116
6.20		117
6.21		117
υ, Δ Ι	1 Our man, 15,	11/

6.22 6.23 6.24 6.25 6.26 6.27 6.28 6.29	Stationary Gas Engines	118 119 122 122 122 123 124
	Water Heaters	124
	— VENTING OF EQUIPMENT	120
7.1	General	128 128
7.2	Specification for Venting	128
7.3 7.4	Design and Construction	129
7.4 7.5	Type of Venting System to be Used	131
7.3 7.6	Masonry, Metal, and Factory-Built Chimneys	136
7.0 7.7	Gas Vents	130
7.7	Single-Wall Metal Pipe	142
7.8 7.9	Condensation Drain	142
7.10	Vent Connectors for Category I Gas Utilization	142
7.10	Equipment	142
7.11	Vent Connectors for Category II, III, and IV Gas	1 74
7.11	Utilization Equipment	148
7.12	Draft Hoods and Draft Controls	149
7.13	Manually Operated Dampers	151
7.14	Automatically Operated Vent Dampers	151
7.15	Obstructions	151
7.13		151
PART 8	— PROCEDURES TO BE FOLLOWED TO	
	PLACE EQUIPMENT IN OPERATION	
8.1	Adjusting the Burner Input	152
8.2	Primary Air Adjustment	152
8.3	Safety Shutoff Devices	153
8.4	Automatic Ignition	153
8.5	Protective Devices	153
8.6	Checking the Draft	153
8.7	Operating Instructions	153
8.8	Notification of Completion	156
PART 9	— MODIFICATIONS TO EXISTING	
	APPLIANCE INSTALLATIONS FOR THE	
	PURPOSE OF FUEL CONSERVATION	
9.1	Safety Inspection	157

9.2 9.3		n of Vent Connector Size	157 157
APPEN	DIX A —	List of Reference Standards	158
APPEN	DIX B —	Coordination of Gas Utilization Equipment Design, Construction, and Maintenance	164
APPEN	DIX C —	Sizing and Capacities of Gas Piping	169
APPEN	DIX D —	Suggested Method for Checking for Leakage	191
APPEN	DIX E —	Suggested Emergency Procedure for Gas Leaks	193
APPEN	DIX F —	Flow of Gas Through Fixed Orifices	194
APPEN	DIX G —	Sizing of Venting Systems Serving Appliances Equipped With Draft Hoods and Appliances Listed for Use With Type B Vents	201
APPEN	DIX H —	Recommended Procedure for Safety Inspection of an Existing Appliance Installation	215
APPEN	DIX I —	Recommended Procedure for Installing Electrically Operated Automatic Vent Damper Devices on Existing Appliances	218
APPEN	DIX J —	Recommended Procedure for Installing Mechanically Actuated Automatic Vent Damper Devices on Existing Appliances	221
APPEN	DIX K —	Recommended Procedure for Installing Thermally Actuated Automatic Vent Damper Devices on Existing Appliances	224
INDEX			226

LIST OF ILLUSTRATIONS AND TABLES

FIG	URE PAG	E
1.	Equipment Located in Confined Spaces; All Air from Inside the Building	6
2.	Equipment Located in Confined Spaces: All Air from Outdoors—Inlet Air from Ventilated Crawl Space and Outlet Air to Ventilated Attic	7
3.	Equipment Located in Confined Spaces: All Air from Outdoors Through Ventilated Attic	8
4.	Equipment Located in Confined Spaces: All Air from Outdoors	8
5.	Method of Installing a Tee Fitting Sediment Trap8	3
6.	Extent of Protection Necessary to Reduce Clearances from Gas Equipment or Vent Connectors	2
7.	Wall Protector Clearance Reduction System	13
8.	Masonry Clearance Reduction System	14
9.	Typical Sauna Heater Installation	1
10.	Installation of Type B-W Gas Vents for Vented Wall Furnaces	25
11.	Typical Gravity Circulating Tank Type Installation	
12.	Typical Termination Locations for Chimneys and Single-Wall Metal Pipes Serving Residential-Type and Low-Heat Equipment	
13.	Plan View of Practical Separation Method for Multistory Gas Venting	
14	Locations for Barometric Draft Regulators 15	'n

LIST OF ILLUSTRATIONS AND TABLES

TABLE	PAGE
I.	Specifications for Threading Metallic Pipe
II.	Support of Piping
III.	Length of Gas Line Requiring Purging for Servicing or Modification
IV.	Length of Piping Requiring Purging Before Placing in Operation
V.	Clearances to Combustible Material for Furnaces and Boilers Installed in Rooms Which Are Large in Comparison With Size of Equipment, Except as Provided in 6.3.1-a
VI.	Reduction of Clearances with Specified Forms of Protection
VII.	Free Opening Area of Chimney Damper for Venting Flue Gases from Unlisted Decorative Appliances for Installation in Vented Fireplaces
VIII.	112
IX.	Clearances for Connectors
Χ.	Minimum Thickness for Galvanized Steel Vent Connectors for Low-Heat Appliances
XI.	Minimum Thickness for Steel Vent Connectors for Medium Heat Equipment and Commercial and Industrial Incinerators
XII.	Gas Input to Burner in Cubic Feet Per Hour

NATIONAL FUEL GAS CODE ANSI Z223.1-1988 NFPA 54-1988

Notice: Information on referenced documents may be found in Appendix A.

PART 1

GENERAL

1.1 Scope.

1.1.1 Applicability:

- a. This *Code* is a safety code which applies to the installation of fuel gas piping systems, fuel gas utilization equipment, and related accessories as follows:
 - 1. Fuel gases include natural gas, manufactured gas, liquefied petroleum (LP) gas in the vapor phase only, lique-fied petroleum gas-air mixtures, and mixtures of these gases, plus gas-air mixtures within the flammable range, with the fuel gas or the flammable component of a mixture being a commercially distributed product.
 - 2. Coverage of piping systems extends from the point of delivery to the connections with each gas utilization device. For other than undiluted liquefied petroleum gas systems, the point of delivery is the outlet of the service meter assembly, or the outlet of the service regulator or service shutoff valve when no meter is provided. For undiluted liquefied petroleum gas systems, the point of delivery is the outlet of the first stage pressure regulator.
 - 3. The maximum operating pressure is 125 psig, except that (a) piping systems for gas-air mixtures within the flammable range are limited to a maximum pressure of 10 psig and (b) LP-gas piping systems are limited to 20 psig, except as outlined in 2.5.3.
 - 4. Coverage of piping systems includes design, materials, components, fabrication, assembly, installation, testing, inspection, operation, and maintenance.
 - 5. Coverage of gas utilization equipment and related accessories includes installation, combustion, and ventilation air and venting.

- **b.** This *Code* does not apply to the following (reference standards for some of which appear in Appendix A):
 - 1. Pressures in excess of 125 psig. Piping installations above 125 psig should be constructed for specific designed equipment requiring these inlet pressures. The piping installation should be constructed in accordance with comprehensive specifications that are consistent with piping design and installation practice for the pressures being utilized.
 - 2. Portable LP-gas equipment of all types which are not connected to a fixed fuel piping system.
 - 3. Installation of farm equipment such as brooders, dehydrators, dryers, and irrigation equipment.
 - **4.** Raw material (feedstock) applications except for piping to special atmosphere generators.
 - 5. Oxygen-fuel gas cutting and welding systems.
 - **6.** Industrial gas applications using such gases as acetylene and acetylenic compounds, hydrogen, ammonia, carbon monoxide, oxygen, and nitrogen.
 - 7. Petroleum refineries, pipeline compressor or pumping stations, loading terminals, compounding plants, refinery tank farms, and natural gas processing plants.
 - **8.** Large integrated chemical plants or portions of such plants where flammable or combustible liquids or gases are produced by chemical reactions or used in chemical reactions.
 - 9. LP-gas installations at utility gas plants.
 - 10. Liquefied natural gas (LNG) installations.
 - 11. Fuel gas piping in power and atomic energy plants.
 - 12. Proprietary items of equipment, apparatus, or instruments such as gas generating sets, compressors, and calorimeters.
 - 13. LP-gas equipment for vaporization, gas mixing, and gas manufacturing.
 - 14. LP-gas piping for buildings under construction or renovations which is not to become part of the permanent building piping system, i.e., temporary fixed piping for building heat.
 - 15. Installation of LP-gas systems for railroad switch heating.
 - **16.** Installation of LP-gas and compressed natural gas (CNG) systems on vehicles.

- 17. Gas piping, meters, gas pressure regulators, and other appurtenances used by the serving gas supplier in distribution of gas, other than undiluted LP-gas.
- 18. Building design and construction, except as specified herein.
- **1.1.2** Other Standards: In applying this *Code*, reference should also be made to the manufacturer's instructions and the serving gas supplier regulations. For a list of standards specifically referenced in applying this *Code* and other standards which may be used, see Appendix A.

1.2 Alternate Materials, Equipment, and Procedures.

The provisions of this *Code* are not intended to prevent the use of any material, method of construction, or installation procedure not specifically prescribed by this *Code*, provided any such alternate is acceptable to the authority having jurisdiction (see Section 1.7, Definitions). The authority having jurisdiction shall require that sufficient evidence be submitted to substantiate any claims made regarding the safety of such alternates.

1.3 Retroactivity.

Unless otherwise stated, it is not intended that the provisions of this *Code* be retroactive to existing systems in compliance with the provisions of the code in effect at the time of installation.

1.4 Qualified Agency.

Installation and replacement of gas piping, gas utilization equipment, or accessories, and repair and servicing of equipment shall be performed only by a qualified agency. The term "qualified agency" means any individual, firm, corporation, or company which either in person or through a representative is engaged in and is responsible for (a) the installation or replacement of gas piping or (b) the connection, installation, repair, or servicing of equipment, who is experienced in such work, familiar with all precautions required, and has complied with all the requirements of the authority having jurisdiction.

1.5 Interruption of Service.

1.5.1 Notification of Interrupted Service: Except in the case of an emergency, it shall be the duty of the qualified agency, when the gas supply is to be turned off, to notify all affected users.

When two or more users are served from the same supply system, precautions shall be exercised to assure that only service to the proper user is turned off

1.5.2 Before Turning Gas Off: Before turning off the gas to the premises, or section of piping to be serviced, for the purpose of installation, repair, replacement, or maintenance of gas piping or gas utilization equipment, all equipment valves shall be turned off.

A leakage test shall be made, as specified in Appendix D, to determine that all equipment is turned off in the piping section to be affected.

- 1.5.3 Turn Gas Off: All gas piping installations, equipment installations, and modifications to existing systems shall normally be performed with the gas turned off to eliminate hazards from leakage of gas, except as outlined in "b" below.
 - **a.** Reduce gas pressure and purge section to be worked on as specified in 4.3.
 - **b.** Hot taps may be made if they are installed by trained and experienced crews utilizing equipment specifically designed for such a purpose.
- **1.5.4** Work Interruptions: When interruptions in work occur while repairs or alterations are being made to an existing piping system, the system shall be left in safe condition, such as by not leaving any open-ended piping.
- 1.6 Prevention of Accidental Ignition.
- **1.6.1 Potential Ignition Sources:** When working on piping which contains or has contained gas:
 - a. Provisions for electrical continuity shall be made before alterations are made in a metallic piping system.
 - **b.** Smoking, open flames, lanterns, welding, or other sources of ignition shall not be permitted.
 - c. A metallic electrical bond shall be installed around the location of cuts in metallic gas pipes made by other than cutting torches. If cutting torches, welding, or other sources of ignition are unavoidable, it shall be determined that all sources of gas or gas-air mixtures have been secured and that all flammable gas or liquids have been cleared from the area. Piping shall be purged as required in 4.3 before welding or cutting with a torch is attempted.

d. Artificial illumination shall be restricted to listed safety type flashlights and safety lamps. Electric switches shall not be operated, on or off.

1.6.2 Handling of Flammable Liquids:

- **a. Drip Liquids:** Liquid which is removed form a drip in existing gas piping shall be handled cautiously to avoid spillage or ignition and the gas supplier shall be notified.
- **b. Other Flammable Liquids:** Flammable liquids used by the installer shall be handled with proper precautions and shall not be left within the premises from the end of one working day to the beginning of the next.

1.7 Definitions.

The terms used in this *Code* are defined within the parameters of the scope of the *Code*.

- **Accessible.** Having access to but which first may require the removal of a panel, door, or similar covering of the item described.
- **Air, Circulating.** Air for cooling, heating, or ventilation distributed to habitable spaces.
- Air Conditioning. The treatment of air so as to control simultaneously its temperature, humidity, cleanness, and distribution to meet the requirements of a conditioned space.
- Air Mixer. That portion of an injection (Bunsen) type burner into which the primary air is introduced.
- **Air Shutter.** An adjustable device for varying the size of the primary air inlet(s).
- **Ambient Temperature.** The temperature of the surrounding medium, usually used to refer to the temperature of the air in which a structure is situated or a device operates.
- **Appliance (Equipment).** Any device which utilizes gas as a fuel or raw material to produce light, heat, power, refrigeration, or air conditioning.
- **Appliance Automatically Controlled.** Appliances equipped with an automatic burner ignition and safety shutoff device and other automatic devices which:
 - a. Accomplish complete turn-on and shutoff of the gas to the main burner or burners.
 - **b.** Graduate the gas supply to the burner or burners, but do not effect complete shutoff of the gas.

Appliance, Building Heating. Fuel-gas burning boilers operating at not over 50 psig pressure, central furnaces, and heaters intended primarily for heating spaces having volumes exceeding 25,000 cubic feet.

Appliance, Low-Heat. An appliance such as a commercial cooking range, pressing machine boiler at any pressure, bake oven, candy furnace, sterotype furnace, drying and curing appliance, and other process appliances in which materials are heated or melted at temperatures (excluding flue-gas temperatures) not exceeding 600 F.

Appliance, Medium-Heat. An industrial appliance such as an annealing furnace (glass or metal), charcoal furnace, galvanizing furnace, gas producer, commercial or industrial incinerator, and steam boiler operating at over 50 psig pressure when such appliance is larger than 100 cubic feet in size, and other furnaces classified as medium-heat appliances in accordance with nationally recognized good practice. Appliances otherwise classed as medium-heat appliances may be considered as low-heat appliances if not larger than 100 cubic feet in size, excluding any burner equipment and blower compartment.

Appliance, Residential-Type Heating. Fuel-gas burning heating appliances, except high-pressure steam boilers, for heating building spaces having a volume of not more than 25,000 cubic feet, and other heat producing appliances of the type mainly used in residences, such as cooking stoves and ranges, clothes dryers, fireplace stoves, domestic incinerators, laundry stoves, water heaters, and heat pumps.

Approved. Acceptable to the authority having jurisdiction.

Atmospheric Pressure. The pressure of the weight of air and water vapor on the surface of the earth, approximately 14.7 pounds per square inch (psi) at sea level.

Authority Having Jurisdiction. The organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in this standard in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local, or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many

circumstances the property owner or his delegated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Automatic Damper Regulator. A mechanically or electrically actuated device designed to maintain a constant draft on combustion equipment.

Automatic Firecheck. A device for stopping the progress of a flame front in burner mixture lines (flashback) and for automatically shutting off the fuel-air mixture.

Present units are customarily equipped with spring or weight loaded valves released for closure by a fusible link or by movement of bimetallic elements; they are also equipped with metallic screens for stopping the progress of a flame front.

Automatic Gas Shutoff Device. A device constructed so that the attainment of a water temperature in a hot water supply system in excess of some predetermined limit acts in such a way as to cause the gas to the system to be shut off.

Automatic Ignition. Ignition of gas at the burner(s) when the gas controlling device is turned on, including reignition if the flames on the burner(s) have been extinguished by means other than by the closing of the gas controlling device.

Backfire Preventer. (See Safety Blowout.)

Back Pressure. Pressure against which a fluid is flowing, resulting from friction in lines, restrictions in pipes, valves, pressure in vessel to which fluid is flowing, hydrostatic head, or other impediment that causes resistance to fluid flow.

Baffle. An object placed in an appliance to change the direction of, or retard, the flow of air, air-gas mixtures, or flue gases.

Barometric Draft Regulator. A balanced damper device attached to a chimney, vent connector, breeching, or flue gas manifold to protect combustion equipment by controlling chimney draft. A double acting barometric draft regulator is one whose balancing damper is free to move in either direction to protect combustion equipment from both excessive draft and backdraft.

Boiler, Low-Pressure. A self-contained gas-burning appliance for supplying steam or hot water.

a. Hot Water Heating Boiler. A boiler in which no steam is generated, from which hot water is circulated for heating purposes and then returned to the boiler, and which operates at water pressures

- not exceeding 160 psig and at water temperatures not exceeding 250 F at or near the boiler outlet.
- b. Hot Water Supply Boiler. A boiler, completely filled with water, which furnishes hot water to be used externally to itself, and which operates at water pressures not exceeding 160 psig and at water temperatures not exceeding 250 F at or near the boiler outlet.
- c. Steam Heating Boiler. A boiler in which steam is generated and which operates at a steam pressure not exceeding 15 psig.

Branch Line. Gas piping which conveys gas from a supply line to the appliance.

Breeching. (See Vent Connector.)

Broiler. A general term including broilers, salamanders, barbecues, and other devices cooking primarily by radiated heat, excepting toasters.

Btu. Abbreviation for British Thermal Unit which is the quantity of heat required to raise the temperature of one pound of water one degree Fahrenheit.

Burner. A device for the final conveyance of the gas, or a mixture of gas and air, to the combustion zone.

- a. Forced-Draft Burner. (See Power Burner.)
- **b.** Induced-Draft Burner. A burner which depends on the draft induced by a fan beyond the appliance for its proper operation.
- c. Injection (Bunsen) Type Burner. A burner employing the energy of a jet of gas to inject air for combustion into the burner and mix it with the gas.
 - Atmospheric Injection Type Burner. A burner in which the air at atmospheric pressure is injected into the burner by a jet of gas.
- d. Luminous or Yellow-Flame Burner. A burner in which secondary air only is depended on for combustion of the gas.
- e. Power Burner. A burner in which either gas or air or both are supplied at a pressure exceeding, for gas, the line pressure, and for air, atmospheric pressure; this added pressure being applied at the burner. A burner for which air for combustion is supplied by a fan ahead of the appliance is commonly designated as a forced-draft burner.
 - 1. Premixing Burner. A power burner in which all or nearly all of the air for combustion is mixed with the gas as primary air.

Carbon Steel. By common custom, steel is considered to be carbon steel when no minimum content is specified or required for alumi-

num, boron, chromium, cobalt, columbium, molybdenum, nickel, titanium, tungsten, vanadium, or zirconium, or any other element added to obtain a desired alloying effect; when the specified minimum for copper does not exceed 0.40 percent; or when the maximum content specified for any of the following elements does not exceed the percentages noted: manganese 1.65, silicon 0.60, copper 0.60.

Central Premix System. A system which distributes flammable gas-air mixtures to two or more remote stations and is employed to provide one or more of the following:

- a. Wide in-plant distribution of a centrally controlled gas-air mix-
- **b.** A wider range of mixture pressures (frequently in the 1 to 5 psig range) than available from other gas-air mixing equipment.
- c. Close control of gas-air ratios over a wide turndown range (often 20 to 1 or more).
- **d.** Ability to change total connected burner port area without installing new mixing devices or inserts.

Central premix systems may either proportion the flows of pressurized air and pressurized gas for subsequent mixing in a downstream tee or comparable fitting, or they may draw room air at essentially atmospheric pressure through a proportioning mixing valve and then through a blower or compressor downstream.

Chimney. (See also Gas Vent, Vent, and Venting System.) One or more passageways, vertical or nearly so, for conveying flue or vent gases to the outside atmosphere.

- a. Factory-Built Chimney. A chimney composed of listed factorybuilt components assembled in accordance with the terms of listing to form the completed chimney.
- b. Masonry Chimney. A field-constructed chimney of solid masonry units, bricks, stones, listed masonry chimney units, or reinforced portland cement concrete, lined with suitable chimney flue liners.
- c. Metal Chimney. A field-constructed chimney of metal.

Clearing. The act of replacing one atmosphere with another by direct displacement so rapidly as to cause a minimum of mixing between the two atmospheres. By this means duration of any explosive mixture is reduced to a minimum, the gases are vented into a large open area high (8 feet or more) aboveground, and means of ignition are excluded.

Closed Water Piping System. A system of water piping where a check valve or other device prevents the free return of water or steam to the water main.

Clothes Dryer. A device used to dry wet laundry by means of heat derived from the combustion of fuel gases. Dryer classifications are as follows:

- a. Type 1. Factory-built package, multiple produced. Primarily used in family living environment. May or may not be coin-operated for public use. Usually the smallest unit physically and in function output.
- b. Type 2. Factory-built package, multiple produced. Used in business with direct intercourse of the function with the public. May or may not be operated by public or hired attendant. May or may not be coin-operated. Not designed for use in individual family living environment. May be small, medium, or large in relative size.
- Combustible Material. As pertaining to materials adjacent to or in contact with heat producing appliances, vent connectors, gas vents, chimneys, steam and hot water pipes, and warm air ducts, shall mean materials made of or surfaced with wood, compressed paper, plant fibers, or other materials that are capable of being ignited and burned. Such material shall be considered combustible even though flame-proofed, fire-retardant treated, or plastered.
- Combustion. As used herein, the rapid oxidation of fuel gases accompanied by the production of heat, or heat and light. Complete combustion of a fuel is possible only in the presence of an adequate supply of oxygen.
- Combustion Chamber. The portion of an appliance within which combustion occurs.
- **Combustion Products.** Constituents resulting from the combustion of a fuel with the oxygen of the air, including the inerts but excluding excess air.
- Concealed Gas Piping. Gas piping, which, when in place in a finished building, would require removal of permanent construction to gain access to the piping.
- **Condensate (Condensation).** The liquid which separates from a gas (including flue gas) due to a reduction in temperature or increase in pressure.
- **Consumption.** The maximum amount of gas per unit of time, usually expressed in cubic feet per hour, or Btu per hour, required for the operation of the appliance or appliances supplied.
- **Control Piping.** All piping, valves, and fittings used to interconnect air, gas, or hydraulically operated control apparatus or instrument transmitters and receivers.

Controls. Devices designed to regulate the gas, air, water, or electrical supply to a gas appliance. These may be manual or automatic.

Conversion Burner, **Gas.** A unit consisting of a burner and its controls utilizing gaseous fuel for installation in an appliance originally utilizing another fuel.

- a. Firing Door Type. A conversion burner specifically for boiler or furnace firing door installation.
- b. Inshot Type. A conversion burner normally for boiler or furnace ash pit installation and fired in a horizontal position.
- c. Upshot Type. A conversion burner normally for boiler or furnace ash pit installation and fired in a vertical position at approximately grate level.

Counter Appliances, Gas. (See Food Service Equipment, Gas.)

Cubic Foot (Cu. Ft.) of Gas. The amount of gas which would occupy 1 cubic foot when at a temperature of 60 F, saturated with water vapor and under a pressure equivalent to that of 30.0 inches mercury column.

Decorative Appliance for Installation in a Vented Fireplace. A self-contained, free-standing, fuel-gas burning appliance designed for installation only in a vented fireplace and whose primary function lies in the aesthetic effect of the flame.

- a. Coal Basket. An open-flame type appliance consisting of a metal basket filled with simulated coals which gives the appearance of a coal fire when in operation.
- b. Fireplace Insert. Consists of an open-flame radiant-type appliance mounted in a decorative metal panel to cover the fireplace or mantel opening and having provisions for venting into the fireplace chimney.
- c. Gas Log. An open-flame type appliance consisting of a metal frame or base supporting simulated logs.
- d. Radiant Appliance. An open-front appliance designed primarily to convert the energy in fuel gas to radiant heat by means of refractory radiants or similar radiating materials. A radiant heater has no external jacket. A radiant appliance is designed for installation in a vented fireplace.

Decorative Appliance, Vented. A vented appliance whose only function lies in the aesthetic effect of the flames.

Deep Fat Fryer. (See Food Service Equipment, Gas.)

Design Pressure. The maximum operating pressure permitted by this *Code*, as determined by the design procedures applicable to the materials involved.

- **Differential Pressure.** The pressure difference between two points in a system.
- **Dilution Air.** Air which enters a draft hood or draft regulator and mixes with the flue gases.
- **Direct-Fired Oven.** An oven in which the flue gases flow through the oven compartment.
- **Direct Gas-Fired Make-Up Air Heater.** A heater in which all the products of combustion generated by the fuel-gas burning device are released into the outside air stream being heated.
- **Direct Vent Appliances.** Appliances which are constructed and installed so that all air for combustion is derived directly from the outside atmosphere and all flue gases are discharged to the outside atmosphere.
- **Diversity Factor.** Ratio of the maximum probable demand to the maximum possible demand.
- **Draft.** The flow of gases or air through chimney, flue, or equipment, caused by pressure differences.
 - Mechanical or Induced. The draft developed by fan or air or steam jet or other mechanical means.
 - b. Natural. The draft developed by the difference in temperature of hot gases and outside atmosphere.
- **Draft Hood.** A device built into an appliance, or made a part of the vent connector from an appliance, which is designed to (1) provide for the ready escape of the flue gases from the appliance in the event of no draft, backdraft, or stoppage beyond the draft hood, (2) prevent a backdraft from entering the appliance, and (3) neutralize the effect of stack action of the chimney or gas vent upon the operation of the appliance.
- **Draft Regulator.** A device which functions to maintain a desired draft in the appliance by automatically reducing the draft to the desired value.
- **Drip.** The container placed at a low point in a system of piping to collect condensate and from which it may be removed.
- **Dry Gas.** A gas having a moisture and hydrocarbon dew point below any normal temperature to which the gas piping is exposed.
- **Duct Furnace.** A furnace normally installed in distribution ducts of air conditioning systems to supply warm air for heating. This definition applies only to an appliance which depends for air circulation on a blower not furnished as part of the furnace.

- Excess Air. Air which passes through the combustion chamber and the appliance flues in excess of that which is theoretically required for complete combustion.
- **Explosion Heads (Soft Heads or Rupture Discs).** A protective device for relieving excessive pressure in a premix system by bursting of a rupturable disc.
- **Exposed Piping.** Gas piping which will be in view in the finished structure.
- **Fireplace.** A fire chamber and hearth constructed of noncombustible material for use with solid fuels and provided with a chimney.
 - a. Masonry Fireplace. A hearth and fire chamber of solid masonry units such as bricks, stones, listed masonry units, or reinforced concrete, provided with a suitable chimney.
 - **b.** Factory-Built Fireplace. A fireplace composed of listed factory-built components assembled in accordance with the terms of listing to form the completed fireplace.
- Flame Arrester. A non-valve device for use in a gas-air mixture line containing a means for temporarily stopping the progress of a flame front (flashback).

Flames.

- a. Bunsen. The flame produced by premixing some of the air required for combustion with the gas before it reaches the burner ports or point of ignition.
- **b.** Yellow, Luminous or Non-Bunsen. The flame produced by burning gas without any premixing of air with the gas.
- Floor Furnace. A completely self-contained unit furnace suspended from the floor of the space being heated, taking air for combustion from outside this space.
 - a. Fan Type Floor Furnace. A floor furnace equipped with a fan which provides the primary means for circulation of air.
 - b. Gravity Type Floor Furnace. A floor furnace depending primarily upon circulation of air by gravity. This classification also includes floor furnaces equipped with booster-type fans which do not materially restrict free circulation of air by gravity flow when such fans are not in operation.
- Flue, Appliance. The passage(s) within an appliance through which combustion products pass from the combustion chamber of the appliance to the draft hood inlet opening on an appliance equipped with a draft hood or to the outlet of the appliance on an appliance not equipped with a draft hood.

Flue, Chimney. The passage(s) in a chimney for conveying the flue or vent gases to the outside atmosphere.

Flue Collar. That portion of an appliance designed for the attachment of a draft hood, vent connector, or venting system.

Flue Exhauster. A device installed in and made a part of the vent, which will provide a positive induced draft.

Flue Gases. Products of combustion plus excess air in appliance flues or heat exchangers.

Food Service (Commercial Cooking) Equipment, Gas. Includes the following but is not limited to:

- a. Counter Appliance. An appliance such as a gas coffee brewer and coffee urn and any appurtenant water heating equipment, food and dish warmer, hot plate, and griddle.
- b. Deep Fat Fryer. An appliance including a cooking vessel in which oils or fats are placed to such a depth that the cooking food is essentially supported by displacement of the cooking fluid or a perforated container immersed in the cooking fluid rather than by the bottom of the vessel, designed primarily for use in hotels, restaurants, clubs, and similar institutions.
- c. Kettle, Gas-Fired. An appliance with a cooking chamber which is heated either by a steam jacket in which steam is generated by gas heat or by direct gas heat applied to the cooking chamber.
- d. Oven, Gas Baking and Roasting. An oven primarily intended for volume food preparation which may be composed of one or more sections or units of the following types:
 - 1. Cabinet Oven. An oven having one or more cavities heated by a single burner or group of burners.
 - 2. Reel-Type Oven. An oven employing trays that are moved by mechanical means.
 - Sectional Oven. An oven composed of one or more independently heated cavities.
- e. Range. A self-contained gas range providing for cooking, roasting, baking, or broiling, or any combination of these functions, and not designed specifically for domestic use.
- f. Steam Cooker. A gas appliance which cooks, defrosts, or reconstitutes food by direct contact with steam.
- **g.** Steam Generator. A separate appliance primarily intended to supply steam for use with food service equipment.

Furnace, Central. A self-contained, gas-burning appliance for heating air by transfer of heat of combustion through metal to the air, and

designed to supply heated air through ducts to spaces remote from or adjacent to the appliance location.

- a. Forced Air Furnace. A furnace equipped with a fan or blower which provides the primary means for circulation of air.
 - 1. Downflow Furnace. A furnace designed with air flow discharge vertically downward at or near the bottom of the furnace.
 - 2. Horizontal Furnace. A furnace designed for low headroom installation with air flow across the heating element essentially in a horizontal path.
 - 3. Upflow Furnace. A furnace designed with air flow discharge vertically upward at or near the top of the furnace. This classification includes "highboy" furnaces with the blower mounted below the heating element and "lowboy" furnaces with the blower mounted beside the heating element.
- b. Forced Air Furnace With Cooling Unit. A single-package unit, consisting of a gas-fired forced air furnace of one of the types listed in "a" above combined with an electrically or gas-operated summer air conditioning system, contained in a common casing.
- Gravity Furnace. A furnace depending primarily on circulation of air by gravity.
- d. Gravity Furnace With Booster Fan. A furnace equipped with a booster fan which does not materially restrict free circulation of air by gravity flow when the fan is not in operation.
- e. Gravity Furnace With Integral Fan. A furnace equipped with a fan or blower as an integral part of its construction and operable on gravity systems only. The fan or blower is used only to overcome the internal furnace resistance to air flow.
- Furnace, Direct Vent Central. A system consisting of (1) a central furnace for indoor installation, (2) combustion air connections between the central furnace and the outdoor atmosphere, (3) flue gas connections between the central furnace and the vent cap, and (4) vent cap for installation outdoors, supplied by the manufacturer and constructed so that all air for combustion is obtained from the outdoor atmosphere and all flue gases are discharged to the outdoor atmosphere.
- Furnace, Enclosed. A specific heating, or heating and ventilating, furnace incorporating an integral total enclosure and using only outside air for combustion.
- Furnace, Separated Combustion System Central. A system for installation in nonresidential structures consisting of a central furnace and a

vent cap supplied by the manufacturer, and (1) combustion air connections between the central furnace and the outside atmosphere and (2) flue gas connections between the central furnace and vent cap [of a type(s) specified by the manufacturer but supplied by the installer], constructed so that when installed in accordance with the manufacturer's instructions, air for combustion is obtained from the outside atmosphere and flue gases are discharged to the outside atmosphere.

- **Garage, Repair.** A building, structure, or portions thereof wherein major repair or painting or body and fender work is performed on motorized vehicles or automobiles, and includes associated floor space used for offices, parking, and showrooms.
- Garage, Residential. A building or room in which not more than three self-propelled passenger vehicles are or may be stored, and which will not normally be used for other than minor service or repair operations on such stored vehicles.
- Gas. Fuel gas, such as natural gas, manufactured gas, undiluted liquefied petroleum gas (vapor phase only), liquefied petroleum gas-air mixtures, or mixtures of these gases.
- Gas Main or Distribution Main. A pipe installed in a community to convey gas to individual services or other mains.
- Gas-Mixing Machine. Any combination of automatic proportioning control devices, blowers, or compressors which supply mixtures of gas and air to multiple burner installations where control devices or other accessories are installed between the mixing device and burner.
- **Gas Utilization Equipment.** Any device which utilizes gas as a fuel or raw material or both.
- Gas Vent. A passageway composed of listed factory-built components assembled in accordance with the terms of listing for conveying vent gases from gas appliances or their vent connectors to the outside atmosphere.
 - a. Type B Gas Vent. A vent for venting listed gas appliances with draft hoods and other Category I gas appliances listed for use with Type B gas vents.
 - b. Type B-W Gas Vent. A vent for venting listed gas-fired vented wall furnaces.
 - c. Type L Vent. A vent for venting appliances listed for use with Type L vents and appliances listed for use with Type B gas vent.
- **Governor, Zero.** A regulating device which is normally adjusted to deliver gas at atmospheric pressure within its flow rating.
- **Gravity.** (See Specific Gravity.)

- **Header.** A pipe or fitting to which a number of branch pipes are connected.
- Heating Value (Total). The number of British Thermal Units produced by the combustion, at constant pressure, of one cubic foot of gas when the products of combustion are cooled to the initial temperature of the gas and air, when the water vapor formed during combustion is condensed, and when all the necessary corrections have been applied.
- **Hoop Stress.** The stress in a pipe wall, acting circumferentially in a plane perpendicular to the longitudinal axis of the pipe and produced by the pressure of the fluid in the pipe.
- Hot Plate. (See Food Service Equipment, Counter Appliance.)
- Hot Plate, Domestic. A fuel-gas burning appliance consisting of one or more open-top type burners mounted on short legs or a base.
- **Hot Taps.** Piping connections made to operating pipelines or mains or other facilities while they are in operation. The connection of the branch piping to the operating line and the tapping of the operating line are done while it is under gas pressure.
- **Household Cooking Gas Appliance.** A gas appliance for domestic food preparation, providing at least one function of (1) top or surface cooking, (2) oven cooking, or (3) broiling.
 - a. Broiler. A unit which cooks primarily by radiated heat. Broilers are further classified as:
 - 1. Enclosed Broiler. A broiler in which the source of radiant heat is above the surface on which cooking is done.
 - 2. Open Top Broiler. A broiler in which the source of radiant heat is below the surface on which cooking is done.
 - b. Built-In Unit. A unit designed to be recessed into, placed upon, or attached to the construction of a building, but not for installation on the floor. Built-in units are further classified as:
 - 1. Broiler Unit. May have an open top or be enclosed, may be a separate broiler, or may be combined with a rotisserie.
 - 2. Oven Unit. A unit for installation in a cabinet, wall, or partition, or for installation on a counter. It may be a separate oven, may be equipped with a broiler that uses the oven burner, or the oven may serve as a broiler with a burner in the upper portion of the oven.
 - 3. Top or Surface Unit. A unit for installation in or on a counter top. It may have top burners, a griddle, a deep well cooker, or any combination thereof.

- 4. Combination of "1," "2," or "3" above, or any other household cooking device that may be for similar installation.
- c. Floor Mounted Unit. A self-contained cooking appliance for installation directly on the floor. It has a top section and an oven section. It may have additional sections. Included in this classification are:
 - Bungalow (Utility Type). A cooking appliance having a gas oven and top section, and a gas, solid, or liquid fuel section for space heating and heating a solid top section but not for oven heating.
 - Room Heater Type. A cooking appliance having a gas oven and top section, and a separate room heater section designed for gas fuel
- **Incinerator, Domestic.** A domestic, fuel-gas burning appliance, used to reduce refuse material to ashes, which is manufactured, sold, and installed as a complete unit.
- **Indirect Oven.** An indirect oven is one in which the flue gases do not flow through the oven compartment.
- **Infrared Heater.** A heater which directs a substantial amount of its energy output in the form of infrared energy into the area to be heated. Such heaters may be of either the vented or unvented type.
- Insulating Millboard. A factory fabricated board formed with non-combustible materials, normally fibers, and having a thermal conductivity in the range of 1 Btu inch per square foot per °F per hour.
- **Joint.** A connection between two lengths of pipe or between a length of pipe and a fitting.
 - a. Adhesive. A joint made in plastic piping by the use of an adhesive substance which forms a continuous bond between the mating surfaces without dissolving either one of them.
 - b. Heat Fusion. A joint made in thermoplastic piping by heating the parts sufficiently to permit fusion of the materials when the parts are pressed together.
 - c. Solvent Cement. A joint made in thermoplastic piping by the use of a solvent or solvent cement which forms a continuous bond between the mating surfaces.
- **Joint Compounds.** Nonhardening materials used on pipe threads to insure a seal.
- Kettle, Gas-Fired. (See Food Service Equipment, Gas.)
- Labeled. Equipment or materials to which has been attached a label, symbol or other identifying mark of an organization acceptable to the

- authority having jurisdiction and concerned with product evaluation that maintains periodic inspection of production of labeled equipment or materials and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.
- **Laundry Stove, Domestic.** A fuel-gas burning appliance consisting of one or more open-top type burners mounted on high legs or having a cabinet base.
- **Leak Detector.** An instrument for determining concentration of gas in air.
- **Leakage Surveys.** Systematic surveys made for the purpose of locating leaks in a gas piping system.
- **Limit Control.** A device responsive to changes in pressure, temperature, or liquid level for turning on, shutting off, or throttling the gas supply to an appliance.
- **Listed.** Equipment or materials included in a list published by an organization acceptable to the authority having jurisdiction and concerned with product evaluation that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.
- **Loads, Connected.** Sum of the rated Btu input to individual gas utilization equipment connected to a piping system. May also be expressed in cubic feet per hour.
- Main Burner. A device or group of devices essentially forming an integral unit for the final conveyance of gas or a mixture of gas and air to the combustion zone, and on which combustion takes place to accomplish the function for which the appliance is designed.
- Manifold, Gas. The conduit of an appliance which supplies gas to the individual burners.
- **Maximum Allowable Hoop Stress.** The maximum hoop stress permitted by this *Code* for the design of a piping system.
- **Maximum Working Pressure.** The maximum pressure at which a piping system may be operated in accordance with the provisions of this *Code*. It is the pressure used in determining the setting of pressure relieving or pressure limiting devices installed to protect the system from accidental overpressuring.
- Measured Gas. Gas which has passed through and the volume of which has been measured by a meter, or gas which has been otherwise measured, such as by liquid volume or weight.

Mechanical Exhaust System. Equipment installed in and made a part of the vent, which will provide a positive induced draft.

Meter. An instrument installed to measure the volume of gas delivered through it.

Mixer. The combination of mixer head, mixer throat, and mixer tube.

- a. Mixer Head. The portion of an injection (Bunsen) type burner, usually enlarged, into which primary air flows to mix with the gas stream.
- b. Mixer Throat. The portion of the mixer which has the smallest cross-sectional area and which lies between the mixer head and the mixer tube.
- c. Mixer Tube. The portion of the mixer which lies between the throat and the burner head.

Mixer Face. The air inlet end of the mixer head.

Mixing Blower. A motor-driven blower to produce gas-air mixtures for combustion through one or more gas burners or nozzles on a single-zone industrial heating appliance or on each control zone of a multi-zone industrial appliance or on each control zone of a multi-zone installation. The blower shall be equipped with a gas-control valve at its air entrance so arranged that gas is admitted to the airstream, entering the blower in proper proportions for correct combustion by the type of burners employed; the said gas-control valve being of either the zero governor or mechanical ratio valve type which controls the gas and air adjustment simultaneously. No valves or other obstructions shall be installed between the blower discharge and the burner or burners.

Noncombustible Material. For the purpose of this *Code*, noncombustible material shall mean material which is not capable of being ignited and burned, such as materials consisting entirely of, or a combination of, steel, iron, brick, tile, concrete, slate, asbestos, glass, and plaster.

Nondisplaceable Rotor Member. A nondisplaceable rotor member is one which cannot be moved from its seat by a force applied to the handle, or force applied by a plane surface to any exterior portion of the valve.

Rotor Member. That part of a gas valve rotating within or in respect to the valve body which, by its position with respect to the valve body, controls the flow of gas.

Operating Stress. The stress in a pipe or structural member under normal operating conditions.

- Orifice. The opening in a cap, spud, or other device whereby the flow of gas is limited and through which the gas is discharged to the burner.
- **Orifice Cap (Hood).** A movable fitting having an orifice which permits adjustment of the flow of gas by the changing of its position with respect to a fixed needle or other device.
- **Orifice Spud.** A removable plug or cap containing an orifice which permits adjustment of the flow of gas either by substitution of a spud with a different sized orifice or by the motion of a needle with respect to it.
- **Outdoor Cooking Gas Appliance.** As used in this *Code*, a post-mounted, fuel-gas burning outdoor cooking appliance for installation directly on and attachment to a post provided as a part of the appliance by the manufacturer.
- Oven, Gas Baking and Roasting. (See Food Service Equipment, Gas).
- **Parking Structure.** A building, structure, or portion thereof used for the parking of motor vehicles.
 - Basement or Underground. A parking structure or portion thereof located below grade.
 - b. Enclosed. Having exterior enclosing walls which have less than 25 percent of the total wall area open to atmosphere at each level using at least two sides of the structure.
- **Pilot.** A small flame which is utilized to ignite the gas at the main burner or burners.
- **Pipe, Equivalent Length.** The resistance of valves, controls, and fittings to gas flow expressed as equivalent length of straight pipe for convenience in calculating pipe sizes.
- **Piping.** As used in this *Code*, either pipe or tubing, or both.
 - **a.** Pipe. Rigid conduit of iron, steel, copper, brass, aluminum, or plastic.
 - Tubing. Semi-rigid conduit of copper, steel, aluminum, or plastic.
- **Piping System.** All piping, valves, and fittings used to connect gas utilization equipment to the point of delivery.

Plastic.

a. Thermoplastic. A plastic which is capable of being repeatedly softened by increase of temperature and hardened by decrease of temperature. b. Thermosetting. A plastic which is capable of being changed into a substantially infusible or insoluble product when cured under application of heat or chemical means.

Plenum. A compartment or chamber to which one or more ducts are connected and which forms part of the air distribution system.

Pool Heater. An appliance designed for heating nonpotable water stored at atmospheric pressure, such as water in swimming pools, therapeutic pools, and similar applications.

- a. Coil Type Pool Heater. A type of pool heater whose heat exchanger surfaces are composed primarily of water tubes whose inside diameters are less than 11/4 inches.
- b. Indirect Type Pool Heater. A type of pool heater that utilizes water in a primary heat exchanger to transmit heat from the gas combustion process by means of a secondary heat exchanger to the pool water.

Pressure. Unless otherwise stated, is expressed in pounds per square inch above atmospheric pressure, i.e., gage pressure (psig).

Pressure Control. Manual or automatic maintenance of pressure, in all or part of a system, at a predetermined level, or within a selected range.

Pressure Drop. The loss in static pressure of the medium (air, gas, or water) due to friction or obstruction in pipe, valves, fittings, regulators, and burners.

Pressure Limiting Device. Equipment which under abnormal conditions will act to reduce, restrict, or shut off the supply of gas flowing into a system in order to prevent the gas pressure in that system from exceeding a predetermined value.

Pressure or Vacuum Limit Switch. A device in a control system actuated by pressure or vacuum within the air or gas piping system.

Primary Air. The air introduced into a burner which mixes with the gas before it reaches the port or ports.

Protective Equipment. Safety devices designed to forestall the development of a hazardous or undesirable condition in the fuel supply piping, in the gas equipment, in the medium being treated, or in the combustion products.

Purge. To free a gas conduit of air, or gas, or a mixture of gas and air.

Quick-Disconnect Device. A hand-operated device which provides a means for connecting and disconnecting an appliance or an appliance connector to a gas supply and which is equipped with an automatic means to shut off the gas supply when the device is disconnected.

Range. (See Food Service Equipment, Gas.)

Readily Accessible. Having direct access without the need of removing or moving any panel, door, or similar covering of the item described.

Refrigerator (Using Gas Fuel). A fuel-gas burning appliance which is designed to extract heat from a suitable chamber.

Regulator, Gas Appliance. A pressure regulator for controlling pressure to the manifold of gas equipment. Types of gas appliance regulators are as follows:

a. Adjustable.

- 1. Spring Type, Limited Adjustment. A regulator in which the regulating force acting upon the diaphragm is derived principally from a spring, the loading of which is adjustable over a range of not more than ± 15 percent of the outlet pressure at the midpoint of the adjustment range.
- 2. Spring Type, Standard Adjustment. A regulator in which the regulating force acting upon the diaphragm is derived principally from a spring, the loading of which is adjustable. The adjustment means shall be concealed.
- b. Convertible. A nonadjustable regulator for conversion between gases having different heating values whose converting mechanism can be changed from one predetermined outlet pressure setting for one gas to another predetermined outlet pressure setting for the other gas with no intermediate pressure settings and without addition, deletion, or substitution of parts.
- c. Multistage. A regulator for use with a single gas whose adjustment means can be positioned manually or automatically to two or more predetermined outlet pressure settings. Each of these settings may be either adjustable or nonadjustable. The regulator may modulate outlet pressures automatically between its maximum and minimum predetermined outlet pressure settings.

d. Nonadjustable.

- 1. Spring Type, Nonadjustable. A regulator in which the regulating force acting upon the diaphragm is derived principally from a spring, the loading of which is not field adjustable.
- 2. Weight Type. A regulator in which the regulating force acting upon the diaphragm is derived from a weight or combination of weights.

Regulator, Line Gas. A pressure regulator placed in a gas line between the service regulator and the gas appliance regulator.

- **Regulator**, LP-Gas, First Stage. On undiluted LP-gas systems, the first pressure regulator reducing the storage container pressure.
- **Regulator**, **LP-Gas**, **Second Stage**. A line gas pressure regulator for service on undiluted LP-gas systems, reducing an intermediate high pressure to utilization pressure.
- **Regulator, Monitoring.** A pressure regulator set in series with another pressure regulator for the purpose of automatically taking over in an emergency the control of the pressure downstream of the regulator in case that pressure tends to exceed a set maximum.
- **Regulator, Pressure.** A device placed in a gas line for reducing, controlling, and maintaining the pressure in that portion of the piping system downstream of the device.
- **Regulator**, **Series**. A pressure regulator in series with one or more other pressure regulators. The regulator nearest to the gas supply source is set to continuously limit the pressure on the inlet to the regulator downstream to some predetermined value (between the pressure of the gas supply source and the pressure of the system being controlled) which can be tolerated in the downstream system.
- **Regulator, Service.** A pressure regulator installed by the serving gas supplier to reduce and limit the service line gas pressure to delivery pressure.
- **Regulator Vent.** The opening in the atmospheric side of the regulator housing permitting the in and out movement of air to compensate for the movement of the regulator diaphragm.
- **Relief Opening.** The opening provided in a draft hood to permit the ready escape to the atmosphere of the flue products from the draft hood in the event of no draft, backdraft, or stoppage beyond the draft hood, and to permit inspiration of air into the draft hood in the event of a strong chimney updraft.
- Room Heater, Unvented. An unvented, self-contained, free-standing, nonrecessed (except as noted under "b" of the following classifications), fuel-gas burning appliance for furnishing warm air by gravity or fan circulation to the space in which installed, directly from the heater without duct connection. Unvented room heaters do not normally have input ratings in excess of 40,000 Btu per hour.
- a. Unvented Circulator. A room heater designed to convert the energy in fuel gas to convected and radiant heat by direct mixing of air to be heated with the combustion products and excess air inside the jacket. Unvented circulators have an external jacket surrounding the burner and may be equipped with radiants with the jacket open in front of the radiants.

- b. Wall Heater, Unvented Closed Front. An unvented circulator having a closed front, for insertion in or attachment to a wall or partition. These heaters are marked, "UNVENTED HEATER," and do not have normal input ratings in excess of 25,000 Btu per hour.
- Room Heater, Vented. A vented, self-contained, free-standing, nonrecessed, fuel-gas burning appliance for furnishing warm air to the space in which installed, directly from the heater without duct connections.
 - a. Vented Circulator. A room heater designed to convert the energy in fuel gas to convected and radiant heat, by transfer of heat from flue gases to a heat exchanger surface, without mixing of flue gases with circulating heated air. Vented circulators may be equipped with transparent panels and radiating surfaces to increase radiant heat transfer as long as separation of flue gases from circulating air is maintained. Vented circulators may also be equipped with an optional circulating air fan, but should perform satisfactorily with or without the fan in operation.
 - **b.** Vented Circulator, Fan Type. A vented circulator equipped with an integral circulating air fan, the operation of which is necessary for satisfactory appliance performance.
 - c. Vented Overhead Heater. A room heater designed for suspension from or attachment to or adjacent to the ceiling of the room being heated and transferring the energy of the fuel gas to the space being heated primarily by radiation downward from a hot surface, and in which there is no mixing of flue gases with the air of the space being heated.
- Room Large in Comparison with Size of Equipment. Rooms having a volume equal to at least 12 times the total volume of a furnace or air conditioning appliance and at least 16 times the total volume of a boiler. Total volume of the appliance is determined from exterior dimensions and is to include fan compartments and burner vestibules, when used. When the actual ceiling height of a room is greater than 8 feet, the volume of the room is figured on the basis of a ceiling height of 8 feet.
- Safety Blowout (Backfire Preventer). A protective device located in the discharge piping of large mixing machines, incorporating a bursting disc for excessive pressure release, means for stopping a flame front and an electric switch or other release mechanism for actuating a built-in or separate safety shutoff. A check valve, signaling means, or both, may also be incorporated.

Safety Shutoff Device. A device that will shut off the gas supply to the controlled burner(s) in the event the source of ignition fails. This device may interrupt the flow of gas to main burner(s) only, or to pilot(s) and main burner(s) under its supervision.

Sauna Heater. A vented heater designed to raise the temperature of an occupied room to a temperature in excess of 100 F. The appliance may or may not include the means for altering the humidity within the room.

- a. Direct Vent Sauna Heater. A system consisting of an appliance, combustion air, and flue gas connections between the appliance and the outside atmosphere and a vent cap supplied by the manufacturer and constructed so that all air for combustion is obtained from the outside atmosphere. The appliance should be complete with grilles or equivalent, designed for incorporation in or permanent attachment to the structure of a building, and should furnish heated air circulated directly into the space to be heated through openings in the casing. Such appliances should not be provided with duct extensions.
- b. Flue-Connected Sauna Heater. An appliance designed for connection to a chimney or gas vent. All air for combustion and draft hood dilution is obtained from a room effectively sealed from the heated room but not from outside the structure containing the heated room.

Secondary Air. The air externally supplied to the flame at the point of combustion.

Secondary Stress. Stress created in the pipe wall by loads other than internal fluid pressure. For example, backfill loads, traffic loads, beam action in a span, loads at supports and at connections to the pipe.

Service Meter Set Assembly. The piping and fittings installed by the serving gas supplier to connect the inlet side of the meter to the gas service and to connect the outlet side of the meter to the customer's house or yard piping.

Service Pipe. The pipe which brings the gas from the gas main to the meter.

Service Regulator. (See Regulator, Service Pressure.)

Shall. Indicates a mandatory requirement.

Shutoff. (See Valve.)

Sources of Ignition. Devices or equipment which, because of their intended modes of use or operation, are capable of providing sufficient thermal energy to ignite flammable gas-air mixtures.

Space, Confined. For the purposes of this *Code*, a space whose volume is less than 50 cubic feet per 1,000 Btu per hour of the aggregate input rating of all appliances installed in that space.

Space, Unconfined. For purposes of this *Code*, a space whose volume is not less than 50 cubic feet per 1,000 Btu per hour of the aggregate input rating of all appliances installed in that space. Rooms communicating directly with the space in which the appliances are installed, through openings not furnished with doors, are considered a part of the unconfined space.

Specific Gravity. As applied to gas, the ratio of the weight of a given volume to that of the same volume of air, both measured under the same conditions.

Steam Cooker. (See Food Service Equipment, Gas.)

Steam Generator. (See Food Service Equipment, Gas.)

Stress. The resultant internal force that resists change in the size or shape of a body acted on by external forces. In this *Code* "stress" is often used as being synonymous with unit stress, which is the stress per unit area (psi).

Tensile Strength. The highest unit tensile stress (referred to the original cross section) a material can sustain before failure (psi).

Thermostat.

- a. Electric Switch Type. A device which senses changes in temperature and controls electrically, by means of separate components, the flow of gas to the burner(s) to maintain selected temperatures.
- b. Integral Gas Valve Type. An automatic device, actuated by temperature changes, designed to control the gas supply to the burner(s) in order to maintain temperatures between predetermined limits, and in which the thermal actuating element is an integral part of the device.
 - 1. Graduating Thermostat. A thermostat in which the motion of the valve is approximately in direct proportion to the effective motion of the thermal element induced by temperature change.
 - 2. Snap-Acting Thermostat. A thermostat in which the thermostatic valve travels instantly from the closed to the open position, and vice versa.

Type B Gas Vent. (See Gas Vents.)

Type B-W Gas Vent. (See Gas Vents.)

Type L Vent. (See Gas Vents.)

Unit Broiler. A broiler constructed as a separate appliance. **Unit Heater.**

- a. High-Static Pressure. A self-contained, automatically controlled, vented, fuel-gas burning appliance having integral means for circulation of air against 0.2 inch or greater static pressure. It is equipped with provisions for attaching an outlet air duct and, when the appliance is for indoor installation remote from the space to be heated, is also equipped with provisions for attaching an inlet air duct.
- b. Low-Static Pressure. A self-contained, automatically controlled, vented, fuel-gas burning appliance, intended for installation in the space to be heated without the use of ducts, having integral means for circulation of air, normally by a propeller fan(s), and may be equipped with louvers or face extensions made in accordance with the manufacturer's specifications.

Unmeasured Gas. Gas which has not passed through and the volume of which has not been measured by a meter, or gas which has not otherwise been measured such as by liquid volume or weight.

Unusually Tight Construction. Construction where:

- a. Walls and ceilings exposed to the outside atmosphere have a continuous water vapor retarder with a rating of one perm or less with openings gasketed or sealed, and
- Weatherstripping has been added on openable windows and doors, and
- c. Caulking or sealants are applied to areas such as joints around window and door frames, between sole plates and floors, between wall-ceiling joints, between wall panels, at penetrations for plumbing, electrical, and gas lines, and at other openings.

Utility Gases. Natural gas, manufactured gas, liquefied petroleum gas-air mixtures, or mixtures of any of these gases.

Valve. A device used in piping to control the gas supply to any section of a system of piping or to an appliance.

- a. Automatic. An automatic or semi-automatic device consisting essentially of a valve and operator that controls the gas supply to the burner(s) during operation of an appliance. The operator may be actuated by application of gas pressure on a flexible diaphragm, by electrical means, by mechanical means, or by other means.
- **b.** Automatic Gas Shutoff. A valve used in conjunction with an automatic gas shutoff device to shut off the gas supply to a fuel-gas burning water heating system. It may be constructed integrally with the gas shutoff device, or be a separate assembly.

- c. Individual Main Burner. A valve which controls the gas supply to an individual main burner.
- d. Main Burner Control. A valve which controls the gas supply to the main burner manifold.
- e. Manual Main Gas-Control. A manually operated valve in the gas line for the purpose of completely turning on or shutting off the gas supply to the appliance, except to pilot or pilots which are provided with independent shutoff.
- f. Manual Reset. An automatic shutoff valve installed in the gas supply piping and set to shut off when unsafe conditions occur. The device remains closed until manually reopened.
- g. Relief. A safety valve designed to forestall the development of a dangerous condition by relieving either pressure, temperature, or vacuum in a hot water supply system.
 - Pressure. A valve which automatically opens and closes a relief vent, depending on whether the pressure is above or below a predetermined value.
 - 2. Temperature. A valve which automatically opens and automatically closes a relief vent, depending on whether the temperature is above or below a predetermined value.
 - Vacuum. A valve which automatically opens and closes a vent for relieving a vacuum within the hot water supply system depending on whether the vacuum is above or below a predetermined value.
- h. Service Shutoff. A valve, installed by the serving gas supplier between the service meter or source of supply and the customer piping system, to shut off the entire piping system.
- i. Shutoff. A valve (located in the piping system and readily accessible and operable by the consumer) used to shut off individual equipment.
- j. Tamperproof. Valves designed and constructed to minimize the possibility of the removal of the core of the valve accidentally or willfully with ordinary household tools.

Vent. A passageway used to convey flue gases from gas utilization equipment, or their vent connectors, to the outside atmosphere.

Vent Connector. The pipe or duct which connects a fuel-gas burning appliance to a vent or chimney.

Vent Damper Device, Automatic. A device intended for installation in the venting system, in the outlet of or downstream of the appliance draft hood, of an individual automatically operated fuel-gas burning appliance and which is designed to automatically open the venting system when the appliance is in operation and to automatically close off the venting system when the appliance is in a standby or shutdown condition.

- a. Electrically Operated. An automatic vent damper device that employs electrical energy to control the device.
- b. Mechanically Actuated. An automatic vent damper device dependent for operation upon the direct application or transmission of mechanical energy without employing any type of energy conversion.
- c. Thermally Actuated. An automatic vent damper device dependent for operation exclusively upon the direct conversion of the thermal energy of the vent gases into mechanical energy.

Vent Gases. Products of combustion from fuel-gas burning appliances plus excess air, plus dilution air in the venting system above the draft hood or draft regulator.

Vented Appliance Categories.

- a. Category I. An appliance which operates with a non-positive vent pressure and with a vent gas temperature at least 140 F above its dewpoint, measured as specified in the appropriate nationally recognized appliance standard.
- b. Category II. An appliance which operates with a non-positive vent pressure and with a vent gas temperature less than 140 F above its dewpoint, measured at the entrance to the venting system.
- c. Category III. An appliance which operates with a positive vent pressure and with a vent gas temperature at least 140 F above its dewpoint, measured at the entrance to the venting system.
- **d.** Category IV. An appliance which operates with a positive vent pressure and with a vent gas temperature less than 140 F above its dewpoint, measured at the entrance to the venting system.

Vented Wall Furnace. A self-contained, vented, fuel-gas burning appliance complete with grilles or equivalent, designed for incorporation in or permanent attachment to the structure of a building and furnishing heated air, circulated by gravity or by a fan, directly into the space to be heated through openings in the casing. Such appliances should not be provided with duct extensions beyond the vertical and horizontal limits of the casing proper, except that boots not to exceed 10 inches beyond the horizontal limits of the casing for extension through walls of nominal thickness are permitted. When such boots are provided they shall be supplied by the manufacturer as an integral part of the appliance. This definition excludes floor furnaces, unit heaters, direct vent wall furnaces, and central furnaces.

- Fan Type Vented Wall Furnace. A wall furnace equipped with a fan.
- **b.** Gravity Type Vented Wall Furnace. A wall furnace depending on circulation of air by gravity.

Venting. Removal of combustion products as well as process fumes to the outer air.

Venting System. A continuous open passageway from the flue collar or draft hood of a gas-burning appliance to the outside atmosphere for the purpose of removing flue or vent gases.

NOTE: A venting system is usually composed of a vent or a chimney and vent connector(s), if used, assembled to form the open passageway.

Wall Furnace, Direct Vent. A system consisting of an appliance, combustion air, and flue gas connections between the appliance and the outdoor atmosphere, and a vent cap supplied by the manufacturer and constructed so that all air for combustion is obtained from the outdoor atmosphere. The appliance shall be complete with grilles or equivalent, designed for incorporation in or permanent attachment to the structure of a building, mobile home, or recreational vehicle, and shall furnish heated air circulated by gravity or by a fan directly into the space to be heated through openings in the casing. Such appliances shall not be provided with duct extensions beyond the vertical and horizontal limits of the appliance casing, except that boots not to exceed 10 inches beyond the horizontal limits of the casing for extension through walls or nominal thickness may be permitted. This definition excludes floor furnaces, unit heaters, vented wall furnaces and central furnaces as defined in appropriate American National Standards.

Water Heater. An appliance for supplying hot water for domestic or commercial purposes.

- a. Automatic Instantaneous Water Heater. A water heater which has a rated input of at least 4,000 Btu per hour per gallon of self-stored water. Automatic control is obtained by water-actuated control, thermostatic control, or combination of water-actuated control and thermostatic control. This classification includes faucet type water heaters designed to deliver water through a single faucet integral with or directly adjacent to the appliance.
- b. Circulating Heaters.
 - Automatic Circulating Tank Water Heater. A water heater which furnishes hot water to be stored in a separate vessel. Storage tank temperatures are controlled by means of a ther-

- mostat installed on the water heater. Circulation may be either gravity or forced.
- Nonautomatic Circulating Tank Water Heater. A water heater which furnishes hot water to be stored in a separate vessel. Storage tank temperatures are controlled by means of a thermostat installed in the storage vessel.
- c. Coil Circulation Water Heater. A water heater whose heat transfer surface is composed primarily of water tubes less than 1½ inches in internal diameter and which requires circulation.
- **d.** Commercial Storage Heater. A water heater that heats and stores water at a thermostatically controlled temperature for delivery on demand. Input rating: 75,000 Btu per hour or more.
- e. Counter Top Domestic Storage Heater.
 - 1. Concealed Type. A vented automatic storage heater which is designed for flush installation beneath a counter top 36 inches high, wherein the entire heater is concealed.
 - 2. Flush Type. A vented automatic storage water heater with flat sides, top, front, and back, which is designed primarily for flush installation in conjunction with or adjacent to a counter 36 inches high, wherein the front and top of the heater casing are exposed.
 - 3. Recessed Type. A vented automatic storage water heater with flat sides, top, front, and back, which is designed for flush installation beneath a counter 36 inches high, wherein the front of the heater casing is exposed.
- f. Domestic Storage Heater. A water heater that heats and stores water at a thermostatically controlled temperature for delivery on demand. Input rating may not exceed 75,000 Btu per hour.
- g. Side-Arm Type Water Heater. A water heater designed for use with auxiliary storage systems, usually containing water-carrying parts of the tubular or cast element design.

Water Heater, Direct Vent. A system consisting of (1) a water heater for indoor installation, (2) combustion air connections between the water heater and the outside atmosphere, (3) flue gas connections between the water heater and the vent cap, and (4) a vent cap for installation outdoors, supplied by the manufacturer and constructed so all air for combustion is obtained from the outside atmosphere and all flue gases are discharged to the outside atmosphere.

PART 2

GAS PIPING SYSTEM DESIGN, MATERIALS. AND COMPONENTS

2.1 Piping Plan.

- 2.1.1 Installation of Piping System: When required by the authority having jurisdiction, a piping sketch or plan shall be prepared before proceeding with the installation. This plan shall show the proposed location of piping, the size of different branches, the various load demands, and the location of the point of delivery.
- **2.1.2** Addition to Existing System: When connecting additional gas utilization equipment to a gas piping system, the existing piping shall be checked to determine if it has adequate capacity (see 2.4.3). If inadequate, the existing system shall be enlarged as required or separate gas piping of adequate capacity shall be provided.

2.2 Provision for Location of Point of Delivery.

The location of the point of delivery shall be acceptable to the serving gas supplier.

- 2.3 Interconnections Between Gas Piping Systems.
- 2.3.1 Interconnections Supplying Separate Users: When two or more meters, or two or more service regulators when meters are not provided, are located on the same premises and supply separate users, the gas piping systems shall not be interconnected on the outlet side of the meters or service regulators.
- 2.3.2 Interconnections for Stand-By Fuels: When a supplementary gas for stand-by use is connected downstream from a meter or a service regulator when a meter is not provided, a suitable device to prevent backflow shall be installed. A three-way valve installed to admit the stand-by supply and at the same time shut off the regular supply may be used for this purpose.
- 2.4 Sizing of Gas Piping Systems.
- **2.4.1** General Considerations: Gas piping shall be of such size and so installed as to provide a supply of gas sufficient to meet the maximum

demand without undue loss of pressure between the point of delivery and the gas utilization equipment. The size of gas piping depends upon the following factors:

- **a.** Allowable loss in pressure (see 2.4.4) from point of delivery to equipment.
- b. Maximum gas demand.
- c. Length of piping and number of fittings.
- d. Specific gravity of the gas.
- e. Diversity factor.
- f. Foreseeable future demand.
- **2.4.2** Maximum Gas Demand: The volume of gas to be provided (in cubic feet per hour) shall be determined directly from the manufacturer's input ratings of the gas utilization equipment served. When input rating is not indicated, the gas supplier, equipment manufacturer, or a qualified agency shall be contacted for estimating the volume of gas to be supplied.

NOTE: To obtain the cubic feet per hour of gas required, divide the Btu per hour rating by the Btu per cubic foot heating value of the gas supplied. The heating value of the gas may be obtained from the local gas supplier.

The total connected hourly load shall be used as the basis for piping sizing since all equipment may be operating at full capacity simultaneously. If, however, a diversity of load can be established, smaller sized piping may be used.

In case the ratings of the equipment to be installed are not known, Table C-1 of Appendix C shows the approximate demand of typical appliances by types.

2.4.3 Gas Piping Size: The gas-carrying capacities for different sizes and lengths of iron pipe, or equivalent rigid pipe, and semi-rigid tubing are shown in the capacity tables given in Appendix C.

Tables C-3 to C-14 in Appendix C indicate approximate capacities for single runs of piping. If the specific gravity of the gas is other than 0.60, correction factors shall be applied. Correction factors for use with these tables are given in Table C-15.

For any gas piping system, for special gas utilization equipment or for conditions other than those covered by the capacity tables in Appendix C, such as longer runs, greater gas demands, or greater pressure drops.

the size of each gas piping system shall be determined by standard engineering methods acceptable to the authority having jurisdiction.

A suggested procedure with an example of using tables to size a gas piping system is presented in Appendix C.

2.4.4 Allowable Pressure Drop: The design pressure loss in any piping system under maximum probable flow conditions, from the point of delivery to the inlet connection of the gas utilization equipment, shall be such that the supply pressure at the equipment is greater than the minimum pressure required for proper equipment operation.

2.5 Piping System Operating Pressure Limitations.

- **2.5.1 Maximum Design Operating Pressure:** The maximum design operating pressure for piping systems located inside buildings shall not exceed 5 psig unless approved by the authority having jurisdiction and one or more of the following conditions are met:
 - a. The piping system is welded.*
 - **b.** The piping is located in a ventilated chase or otherwise enclosed for protection against accidental gas accumulation.
 - **c.** The piping is located inside buildings or separate areas of buildings used exclusively for:
 - Industrial processing or heating;
 - 2. Research:
 - 3. Warehousing; or
 - 4. Boiler or mechanical equipment rooms.
 - d. The piping is a temporary installation for buildings under construction.
- **2.5.2** Gas-Air Mixture Systems: Piping systems for gas-air mixtures within the flammable range are limited to a maximum pressure of 10 psig.
- **2.5.3** Liquefied Petroleum Gas Systems: In no case shall the maximum design operating pressure for undiluted LP-gas systems exceed 20 psig, except for buildings, or separate areas of buildings, constructed in accordance with Chapter 7 of the *Standard for the Storage and Handling*

^{*}For welding specifications and procedures which may be used, see API Standard for Welding Pipelines and Related Facilities, Std. 1104: AWS B2 1, Standard for Welding Procedure and Performance Qualification, or the ASME Boiler and Pressure Vessel Code, Section IX

of Liquefied Petroleum Gases, ANSI/NFPA 58, and used exclusively to house industrial processes, research and experimental laboratories, or equipment or processing having similar hazards.

2.6 Acceptable Piping Materials and Joining Methods.

2.6.1 General:

- **a. Material Application:** Materials and components conforming to nationally recognized standards or specifications listed herein and/or acceptable to the authority having jurisdiction may be used for appropriate applications, as prescribed and limited by this *Code*.
- **b.** Used Materials: Pipe, fittings, valves, or other materials shall not be used again unless they are free of foreign materials and have been ascertained to be adequate for the service intended.
- c. Other Materials: Material not covered by the standards specifications listed herein shall be investigated and tested to determine that it is safe and suitable for the proposed service, and, in addition, shall be recommended for that service by the manufacturer and shall be acceptable to the authority having jurisdiction.

2.6.2 Metallic Pipe:

- a. Cast-iron pipe shall not be used.
- **b.** Steel and wrought-iron pipe shall be at least of standard weight (Schedule 40) and shall comply with one of the following standards:
 - 1. The Standard for Welded and Scamless Wrought-Steel Pipe, ANSI/ASME B36.10;
 - 2. Specification for Black and Hot-Dipped, Zinc-Coated Welded and Scamless Steel Pipe, ASTM A53;
 - 3. Specification for Seamless Carbon Steel Pipe for High-Temperature Service, ASTM A106; or
 - **4.** Specification for Black and Hot-Dipped Zinc-Coated (Galvanized) Welded and Seamless Steel Pipe for Ordinary Uses, ASTM A120.
- c. Nodular (ductile) iron pipe shall comply with one of the following standards:
 - 1. The Standard for Ductile-Iron Pipe, Centrifugally Cast, in Metal Molds or Sand-Lined Molds, for Gas, ANSI A21.52; or

2. Specification for Ductile Iron Pressure Pipe, ASTM A377.

Such pipe shall be not less than 3-inch size, shall not be welded, and shall be used only underground outside building foundation boundaries, or aboveground, provided that joints are properly restrained against movement and separation.

d. Copper and brass pipe shall not be used if the gas contains more than an average of 0.3 grains of hydrogen sulfide per 100 standard cubic feet of gas. This is equivalent to a trace as determined by the following applicable standard: Test for Hydrogen Sulfide and Mercaptan Sulfur in Natural Gas (Cadmium Sulfate-Iodometric Titration Method), ANSI/ASTM D2385; or Test for Hydrogen Sulfide in Liquefied Petroleum (LP) Gases (Lead Acetate Method), ANSI/ASTM D2420.

Threaded copper, brass, or aluminum alloy pipe in iron pipe sizes may be used with gases not corrosive to such material.

e. Aluminum alloy pipe shall comply with the Specification for Aluminum-Alloy Seamless Pipe and Seamless Extruded Tube, ASTM B241 (except that the use of alloy 5456 is prohibited), and shall be suitably marked at each end of each length indicating compliance. Aluminum alloy pipe shall be coated to protect against external corrosion where it is in contact with masonry, plaster, or insulation, or is subject to repeated wettings by such liquids as water, detergents, or sewage.

Aluminum alloy pipe shall not be used in exterior locations or underground.

- **2.6.3 Metallic Tubing:** Seamless copper, aluminum alloy, or steel tubing may be used with gases not corrosive to such material.
 - a. Steel tubing shall comply with the Standard Specification for Electric-Resistance-Welded Coiled Steel Tubing for Gas and Fuel Oil Lines, ASTM A539, or the Standard Specification for Copper Brazed Steel Tubing, ASTM A254.
 - **b.** Copper tubing shall comply with standard Type K or L, of the Specification for Seamless Copper Water Tube, ASTM B88; or the Specification for Seamless Copper Tube for Air Conditioning and Refrigeration Field Service, ASTM B280.

Copper and brass tubing and fittings (except tin-lined copper tubing) shall not be used if the gas contains more than an average of 0.3 grains of hydrogen sulfide per 100 standard cubic feet of gas.

This is equivalent to a trace as determined by the following applicable standard: Test for Hydrogen Sulfide and Mercaptan Sulfir in Natural Gas (Cadmium Sulfate-Iodometric Titration Method), ANSI/ASTM D2385; or Test for Hydrogen Sulfide in Liquefied Petroleum (LP) Gases (Lead Acetate Method), ANSI/ASTM D2420.

c. Aluminum alloy tubing shall comply with the Specification for Aluminum-Alloy Drawn Seamless Tubes, ASTM B210, or the Specification for Aluminum-Alloy Seamless Pipe and Seamless Extruded Tube, ASTM B241. Aluminum-alloy tubing shall be coated to protect against external corrosion where it is in contact with masonry, plaster, or insulation, or is subject to repeated wettings by such liquids as water, detergent, or sewage.

Aluminum-alloy tubing shall not be used in exterior locations or underground.

- **d.** Corrugated stainless steel conduit shall be tested and listed as to compliance with construction, installation, and performance requirements* for use in interior gas piping systems.
- **2.6.4** Plastic Pipe, Tubing, and Fittings: Plastic pipe or tubing and compatible fittings shall be used outside underground only and shall conform with the *Specification for Thermoplastic Gas Pressure Pipe, Tubing and Fittings*, ASTM D2513, or the *Specification for Reinforced Epoxy Resin Gas Pressure Pipe and Fittings*, ASTM D2517.

For use of plastic pipe, tubing and fittings in undiluted liquefied petroleum gas piping systems, see the *Standard for Storage and Handling of Liquefied Petroleum Gases*, ANSI/NFPA 58.

2.6.5 Workmanship and Defects: Gas pipe or tubing and fittings shall be clear and free from cutting burrs and defects in structure or threading, and shall be thoroughly brushed, and chip and scale blown.

Defects in pipe or tubing or fittings shall not be repaired. When defective pipe, tubing, or fittings are located in a system, the defective material shall be replaced. See 4.1.1-c.

2.6.6 Protective Coating: When in contact with material or atmosphere exerting a corrosive action, metallic piping and fittings coated with a corrosion-resistant material shall be used.

One such standard is AGA 1-87, Requirements for Interior Piping Systems Using Corrugated Stainless Steel Conduit

External or internal coatings or linings used on piping or components shall not be considered as adding strength.

2.6.7 Metallic Pipe Threads:

- a. Specifications for Pipe Threads: Metallic pipe and fitting threads shall be taper pipe threads and shall comply with the Standard for Pipe Threads, General Purpose (Inch), ANSI/ASME B1.20.1.
- b. Damaged Threads: Pipe with threads which are stripped, chipped, corroded, or otherwise damaged shall not be used. If a weld opens during the operation of cutting or threading, that portion of the pipe shall not be used.
- **c. Number of Threads:** Table I may be used as a guide for field threading of metallic pipe.
- **d.** Thread Compounds: Thread (joint) compounds (pipe dope) shall be resistant to the action of liquefied petroleum gas or to any other chemical constituents of the gases to be conducted through the piping.

Table I
Specifications for Threading Metallic Pipe

Iron Pipe Size (inches)	Approximate Length of Threaded Portion (Inches)	Approximate No. of Threads to be Cut	
1/2	3/4	10	
3/4	3/4	10	
1	⁷ / ₈	10	
1 1/4	1	1.1	
1 1/2	1	11	
2	1	11	
21/2	1 1/2	12	
3	1 1/2	12	
4	15/8	13	

2.6.8 Metallic Piping Joints and Fittings: The type of piping joint used shall be suitable for the pressure-temperature conditions and shall be selected giving consideration to joint tightness and mechanical strength under the service conditions. The joint shall be able to sustain the maximum end force due to the internal pressure and any additional forces due to temperature expansion or contraction, vibration, fatigue, or to the weight of the pipe and its contents.

- a. Pipe Joints: Pipe joints shall be threaded, flanged, or welded*, and nonferrous pipe may also be brazed* with materials having a melting point in excess of 1,000 F. Brazing alloys shall not contain phosphorus.
- **b. Tubing Joints:** Tubing joints shall either be made with approved gas tubing fittings or be brazed* with a material having a melting point in excess of 1,000 F. Brazing alloys shall not contain phosphorus.
- c. Flared Joints: Flared joints shall be used only in systems constructed from nonferrous pipe and tubing where experience or tests have demonstrated that the joint is suitable for the conditions and where adequate provisions are made in the design to prevent separation of the joints.

d. Metallic Fittings (Including Valves, Strainers, Filters):

- 1. Threaded fittings in sizes larger than 4-inches shall not be used unless acceptable to the authority having jurisdiction.
- 2. Fittings used with steel or wrought iron pipe shall be steel, brass, bronze, malleable iron, ductile iron, or cast iron.
- 3. Fittings used with copper or brass pipe shall be copper, brass, or bronze.
- **4.** Fittings used with aluminum alloy pipe shall be of aluminum alloy.
 - 5. Cast Iron Fittings
 - Flanges may be used.
 - Bushings shall not be used.
 - Fittings shall not be used in systems containing flammable gas-air mixtures.
 - Fittings in sizes 4-inches and larger shall not be used indoors unless approved by the authority having jurisdiction.
 - Fittings in sizes 6-inches and larger shall not be used unless approved by the authority having jurisdiction.
- **6.** Brass, Bronze, or Copper Fittings: Fittings, if exposed to soil, shall have a minimum 80 percent copper content.

For welding and brazing specifications and procedures which may be used, see API Standard for Welding Pipelines and Related Facilities, Std. 1104; AWS B2.1, Standard for Welding Procedure and Performance Qualification; AWS B2.2 Brazing Procedure and Performance Qualification; or the ASME Boder and Pressure Vessel Code, Section IX.

- 7. Aluminum Alloy Fittings: Threads shall not form the joint seal.
- **8.** Zinc-Aluminum Alloy Fittings: Fittings shall not be used in systems containing flammable gas-air mixtures.
- 9. Special Fittings: Fittings such as couplings, proprietary type joints, saddle tees, gland-type compression fittings, flared, flareless, or compression type tubing fittings may be used provided they are: 1) used within the fitting manufacturer's pressure-temperature recommendations; 2) used within the service conditions anticipated with respect to vibration, fatigue, thermal expansion, or contraction; 3) installed or braced to prevent separation of the joint by gas pressure or external physical damage; and 4) acceptable to the authority having jurisdiction.
- 2.6.9 Plastic Piping Joints and Fittings: Plastic pipe, tubing, and fittings shall be joined by either the solvent cement method, adhesive method, heat-fusion method, or by means of compression couplings or flanges. The joining method used shall be compatible with the materials being joined and the recommendations of the maufacturer. The following shall be observed when making such joints:
 - a. Plastic pipe or tubing shall not be threaded.
 - **b.** The joint shall be designed and installed so that the longitudinal pull-out resistance of the joint will be at least equal to the tensile strength of the plastic piping material.
 - c. Solvent cement joints, adhesive joints, and heat-fusion joints shall be made in accordance with qualified procedures which have been established and proven by test to produce gastight joints at least as strong as the pipe or tubing being joined.
 - **d.** Solvent cement or heat-fusion joints shall not be made between different kinds of plastics.
 - e. Heat-fusion or mechanical joints shall be used when joining polyethylene pipe, tubing, or fittings.
 - **f.** Flanges or special joints may be used provided they are properly qualified and utilized.
 - g. When compression type mechanical joints are used, the gasket material in the fitting shall be compatible with the plastic piping and with the gas distributed by the system. An internal tubular rigid stiffener shall be used in conjunction with the fitting, and the stiffener shall be flush with the end of the pipe or tubing and extend at least to the outside end of the compression fitting when installed.

The stiffener shall be free of rough or sharp edges and shall not be a force fit in the plastic. A split tubular stiffener shall not be used.

- h. For plastic piping joints and fittings for use in liquefied petroleum gas piping systems, see the *Standard for the Storage and Handling of Liquefied Petroleum Gases*, ANSI/NFPA 58.
- **2.6.10 Flanges:** All flanges shall comply with nationally recognized standards and specifications as listed in Appendix A. The pressure-temperature ratings shall equal or exceed that required by the application.
 - **a. Flange Facings:** Standard facings are suitable for use under this *Code.* When 150-pound steel flanges are bolted to Class 125 cast-iron flanges, the raised face on the steel flange shall be removed.
 - **b.** Lapped Flanges: Lapped flanges may be used only aboveground or in exposed locations accessible for inspection.
- 2.6.11 Flange Gaskets: Material for gaskets shall be capable of withstanding the design temperature and pressure of the piping system, and the chemical constituents of the gas being conducted, without change to its chemical and physical properties. The effects of fire exposure to the joint shall be considered in choosing material.
 - a. Acceptable materials include:
 - 1. Metal or metal-jacketed asbestos (plain or corrugated);
 - 2. Asbestos; and
 - 3. Aluminum "O" rings and spiral wound metal gaskets.
 - b. When a flanged joint is opened, the gasket shall be replaced.
 - c. Full-face gaskets shall be used with all bronze and cast-iron flanges.

2.7 Gas Meters.

2.7.1 Capacity: Gas meters shall be properly selected for the maximum expected pressure and permissible pressure drop.

2.7.2 Location:

- **a.** Gas meters shall be located in ventilated spaces readily accessible for examination, reading, replacement, or necessary maintenance.
- **b.** Gas meters shall not be placed where they will be subjected to damage, such as adjacent to a driveway, under a fire escape, in

public passages, halls, coal bins, or where they will be subject to excessive corrosion or vibration.

- **c.** Gas meters shall be located at least 3 feet from sources of ignition.
- **d.** Gas meters shall not be located where they will be subjected to extreme temperatures or sudden extreme changes in temperature. Meter manufacturers shall furnish information regarding safe temperature limits.
- 2.7.3 Supports: Gas meters shall be securely supported or connected to rigid piping so as not to exert a strain on the meters. When flexible connectors are used to connect a gas meter to downstream piping at mobile homes in mobile home parks, the meter shall be supported by a post or bracket placed in a firm footing or other means providing equivalent support.
- **2.7.4** Meter Protection: Meters shall be protected against overpressure, back pressure, and vacuum, if necessary.
- **2.7.5 Identification:** Gas piping at multiple meter installations shall be plainly marked by a metal tag or other permanent means attached by the installing agency, designating the building or the part of the building being supplied.

2.8 Gas Pressure Regulators.

- 2.8.1 When Required: When the gas supply pressure is higher than that at which the branch supply line or gas utilization equipment is designed to operate or varies beyond design pressure limits, a line gas pressure regulator or gas equipment pressure regulator, as applicable, shall be installed.
- **2.8.2** Location: The gas pressure regulator location shall be such that the connections are readily accessible for servicing.
- **2.8.3 Regulator Protection:** Pressure regulators shall be protected against physical damage.

2.8.4 Venting:

- a. Line Gas Pressure Regulators, Including Second Stage LP-Gas Regulators:
 - 1. An adequately sized independent vent to the outside of the building shall be provided when the location of a regulator

is such that a ruptured diaphragm will cause a hazard. When there is more than one regulator at a location, each regulator shall have a separate vent to the outside, or if approved by the authority having jurisdiction, the vent lines may be manifolded in accordance with accepted engineering practices to minimize back pressure in the event of diaphragm failure. See 2.9.7 for properly locating the vent.

Exception: A regulator and vent limiting means combination listed as complying with the Standard for Gas Appliance Pressure Regulators, ANSI Z21.18, may be used without a vent to the outside, provided the regulator and vent limiting means are installed in a ventilated location.

- 2. The vent shall be designed to prevent the entry of water, insects, or other foreign materials that could cause blockage.
- 3. At locations where regulators might be submerged during floods, a special anti-flood type breather vent fitting shall be installed, or the vent line shall be extended above the height of the expected flood waters.
- **4.** A regulator shall not be vented to the gas equipment flue or exhaust system.
- **b. Gas Appliance Pressure Regulators:** For venting of gas appliance pressure regulators, see 5.1.18.
- **2.8.5 Bypass Piping:** Suitably valved and regulated bypasses may be placed around gas line pressure regulators where continuity of service is imperative.
- **2.8.6 Identification:** Line pressure regulators at multiple regulator installations shall be plainly marked by a metal tag or other permanent means designating the building or the part of the building being supplied.
- 2.8.7 Second Stage LP-Gas Regulators: Second stage regulators on undiluted liquefied petroleum gas piping systems shall comply with the Standard for Pressure Regulating Valves for LP-Gas, ANSI/UL 144, and shall be installed in accordance with the Standard for Storage and Handling of Liquefied Petroleum Gases, ANSI/NFPA 58.

2.9 Overpressure Protection Devices.

2.9.1 General: Overpressure protection devices shall be provided to prevent the pressure in the piping system from exceeding that value

which would cause unsafe operation of any connected and properly adjusted gas utilization equipment. (See 2.9.5.)

- a. The requirements of this section shall be met and a piping system deemed to have adequate overpressure protection when there are two acceptable devices (a service or line pressure regulator plus one other device), each limiting the pressure to a value that does not exceed the maximum working pressure of the downstream system, both of which must fail simultaneously in order to overpressure the downstream system. The pressure regulating, limiting, and relieving devices shall be properly maintained, and inspection procedures shall be devised or suitable instrumentation installed to detect failures or malfunctions of such devices, and replacements or repairs shall be promptly made.
- b. No pressure relieving or limiting device is required if (1) the gas does not contain materials that could seriously interfere with the operation of the service of line pressure regulator; (2) the operating pressure of the gas source is 60 psig or less; and (3) the service or line pressure regulator has all of the following design features or characteristics:
 - 1. Pipe connections to the service or line regulator do not exceed 2 inches nominal diameter:
 - 2. It is self-contained with no external static or control piping;
 - 3. It has a single port valve with an orifice diameter no greater than that recommended by the manufacturer for the maximum gas pressure at the regulator inlet;
 - 4. The valve seat is made of resilient material designed to withstand abrasion of the gas, impurities in the gas, and cutting by the valve, and to resist permanent deformation when it is pressed against the valve port; and
 - 5. It is capable, under normal operating conditions, of regulating the downstream pressure within the necessary limits of accuracy and of limiting the discharge pressure under no-flow conditions to not more than 150 percent of the discharge pressure maintained under flow conditions.
- **2.9.2 Devices:** Any of the following pressure relieving or pressure limiting devices may be used:
 - a. Spring loaded relief device.
 - **b.** Pilot loaded back pressure regulator used as a relief valve so designed that failure of the pilot system or external control piping will cause the regulator relief valve to open.

- c. A monitoring regulator installed in series with the service or line pressure regulator.
- **d.** A series regulator installed upstream from the service or line regulator and set to continuously limit the pressure on the inlet of the service or line regulator to the maximum working pressure of the downstream piping system.
- e. An automatic shutoff device installed in series with the service or line pressure regulator and set to shut off when the pressure on the downstream piping system reaches the maximum working pressure or some other predetermined pressure less than the maximum working pressure. This device shall be designed so that it will remain closed until manually reset.
- **f.** A liquid seal relief device that can be set to open accurately and consistently at the desired pressure.

The above devices may be installed as an integral part of the service or line pressure regulator or as separate units. If separate pressure relieving or pressure limiting devices are installed, they shall comply with 2.9.3 through 2.9.8.

- **2.9.3 Construction and Installation:** All pressure relief or pressure limiting devices shall:
 - **a.** Be constructed of materials so that the operation of the device will not normally be impaired by corrosion of external parts by the atmosphere or of internal parts by the gas.
 - **b.** Be designed and installed so they can be readily operated to determine if the valve is free. The devices shall also be designed and installed so they can be tested to determine the pressure at which they will operate and examined for leakage when in the closed position.
- **2.9.4 External Control Piping:** External control piping shall be reasonably protected from falling objects, excavations, or other causes of damage and shall be designed and installed so that damage to any control piping shall not render both the regulator and the overpressure protective device inoperative.
- 2.9.5 Setting: Each pressure limiting or pressure relieving device shall be set so that the pressure shall not exceed a safe level beyond the maximum allowable working pressure for the piping and appliances connected.
- **2.9.6** Unauthorized Operation: Precautions shall be taken to prevent unauthorized operation of any shutoff valve which will make a pressure

relief valve or pressure limiting device inoperative. Acceptable methods for complying with this provision are:

- a. Lock the valve in the open position. Instruct authorized personnel of the importance of leaving the shutoff valve open and of being present while the shutoff valve is closed so that it can be locked in the open position before leaving the premises.
- **b.** Install duplicate relief valves, each having adequate capacity to protect the system, and arrange the isolating valves or three-way valve so that only one safety device can be rendered inoperative at a time.
- 2.9.7 Vents: The discharge stacks, vents, or outlet parts of all pressure relief and pressure limiting devices shall be located so that gas is discharged into the atmosphere without undue hazard. Discharge stacks or vents shall be designed to prevent the entry of water, insects, or other foreign material that could cause blockage. The discharge stack or vent line shall be at least the same size as the outlet of the pressure relieving device.
- 2.9.8 Size of Fittings, Pipe, and Openings: The openings, pipe, and fittings located between the system to be protected and the pressure relieving device shall be of adequate size to prevent hammering of the valve and to prevent impairment of relief capacity.

2.10 Back Pressure Protection.

- 2.10.1 When to Install: When the design of utilization equipment connected is such that air, oxygen, or stand-by gases may be forced into the gas supply system, suitable protective devices shall be installed as close to the utilization equipment as practical. Gas and air combustion mixers incorporating double diaphragm "zero" or "atmosphere" governors or regulators require no further protection unless connected directly to compressed air or oxygen at pressures of 5 psig or more.
- **2.10.2** Suitable Devices: Suitable protective devices include but are not limited to the following:
 - a. Check valves:
 - **b.** Three-way valves (of the type that completely closes one side before starting to open the other side);
 - c. Reverse flow indicators controlling positive shutoff valves; and
 - d. Normally closed air-actuated positive-shutoff pressure regulators.

2.11 Low Pressure Protection.

A suitable protective device shall be installed between the meter and the gas utilization equipment if the operation of the equipment is such (i.e., gas compressors) that it may produce a vacuum or a dangerous reduction in gas pressure at the meter. Such devices include, but are not limited to mechanical, diaphragm-operated, or electrically operated low-pressure shutoff valves.

2.12 Shutoff Valves.

Shutoff valves shall be approved and shall be selected giving consideration to pressure drop, service involved, emergency use, and reliability of operation.

2.13 Expansion and Flexibility.

2.13.1 Design: Piping systems shall be designed to have sufficient flexibility to prevent thermal expansion or contraction from causing excessive stresses in the piping material, excessive bending or loads at joints, or undesirable forces or moments at points of connections to equipment and at anchorage or guide points. Formal calculations or model tests shall be required only where reasonable doubt exists as to the adequate flexibility of the system.

Flexibility shall be provided by the use of bends, loops, offsets, or couplings of the slip type. Provision shall be made to absorb thermal changes by the use of expansion joints of the bellows type, or by the use of "ball" or "swivel" joints. Expansion joints of the slip type shall not be used inside buildings or for thermal expansion. If expansion joints are used, anchors or ties of sufficient strength and rigidity shall be installed to provide for end forces due to fluid pressure and other causes.

Pipe alignment guides shall be used with expansion joints according to the recommended practice of the joint manufacturer.

2.13.2 Special Local Conditions: Where local conditions include earthquake, tornado, unstable ground, or flood hazards, special consideration shall be given to increased strength and flexibility of piping supports and connections.

PART 3

GAS PIPING INSTALLATION

3.1 Piping Underground.

- 3.1.1 Clearances: Underground gas piping shall be installed with enough clearance from any other underground structure to avoid contact therewith, to allow proper maintenance, and to protect against damage that might result from proximity to other structures. In addition, underground plastic piping shall be installed with sufficient clearance, or shall be insulated, from any source of heat so as to prevent the heat from impairing the serviceability of the pipe.
- 3.1.2 Protection Against Damage: Where soil conditions are unstable and settling of piping or foundation walls or heavy vehicular traffic may occur, adequate measures shall be provided to prevent excessive stressing of the piping. Piping shall be buried a sufficient depth or covered in a manner so as to protect the piping from physical damage.

Consideration should be given to protecting the piping from physical damage when it passes through flower beds, shrub beds, and other such cultivated areas.

- a. Cover Requirements: Underground piping systems shall be installed with at least 18 inches of cover. The cover may be reduced to 12 inches if external damage to the pipe is not likely to result. If a minimum of 12 inches of cover cannot be maintained, the pipe shall be installed in conduit or bridged (shielded).
- **b. Trenches:** The trench shall be graded so that the pipe has a firm, substantially continuous bearing on the bottom of the trench.
- c. Backfilling: Where flooding of the trench is done to consolidate the backfill, care shall be exercised to see that the pipe is not floated from its firm bearing on the trench bottom.
- 3.1.3 Protection Against Corrosion: Gas piping in contact with earth, or other material which may corrode the piping, shall be protected against corrosion in an approved manner. When dissimilar metals are joined underground, an insulating coupling or fitting shall be used. Piping shall not be laid in contact with cinders.

Uncoated threaded or socket welded joints shall not be used in piping in contact with soil or where internal or external crevice corrosion may occur.

3.1.4 Protection Against Freezing: Where the formation of hydrates or ice is a problem, piping shall be protected against freezing.

NOTE: The gas supplier may be consulted for recommendations.

- **3.1.5** Connection of Plastic Piping: Connections between metallic and plastic piping shall be made only outside, underground, and with approved transition fittings.
- **3.1.6** Piping Through Foundation Wall: Underground piping, when installed below grade through the outer foundation or basement wall of a building, shall be encased in a protective pipe. The annular space between the gas piping and the sleeve shall be sealed at the foundation or basement wall to prevent entry of gas or water.
- 3.1.7 Piping Underground Beneath Buildings: When the installation of gas piping underground beneath buildings is unavoidable, the piping shall be encased in an approved conduit designed to withstand the superimposed loads. The conduit shall extend into a normally usable and accessible portion of the building and, at the point where the conduit terminates in the building, the space between the conduit and the gas piping shall be scaled to prevent the possible entrance of any gas leakage. If the end sealing is of a type that will retain the full pressure of the pipe, the conduit shall be designed for the same pressure as the pipe. The conduit shall extend at least 4 inches outside the building, be vented above grade to the outside, and be installed so as to prevent the entrance of water and insects.
- 3.2 Aboveground Piping Outside: Piping installed aboveground shall be securely supported and located where it will be protected from physical damage. (Also see 3.1.4.) When passing through an outside wall, the piping shall also be protected against corrosion by coating or wrapping with an inert material. When piping is encased in a protective pipe sleeve, the annular space between the gas piping and the sleeve shall be sealed at the wall to prevent the entry of water, insects, or rodents.

3.3 Piping in Buildings.

3.3.1 Building Structure:

a. The installation of gas piping shall not cause structural stresses within building components to exceed allowable design limits.

- **b.** Before any beams or joists are cut or notched, permission shall be obtained from the authority having jurisdiction.
- **3.3.2** Other Than Dry Gas: Drips, sloping, protection from freezing, and branch pipe connections, as provided for in 3.1.4, 3.3.3, 3.7.1, and 3.9-a, shall apply only when other than dry gas is distributed and climatic conditions make such provisions necessary.
- 3.3.3 Gas Piping to be Sloped: Piping for other than dry gas conditions shall be sloped not less than ¼ inch in 15 feet to prevent traps. Horizontal lines shall slope upward to risers and from the risers to the meter, or service regulator when a meter is not provided, or to the equipment.
- **3.3.4** Above-Ceiling Locations: Gas piping may be installed in accessible above-ceiling spaces, whether or not such spaces are used as a plenum. Valves shall not be located in such spaces.
- **3.3.5 Prohibited Locations:** Gas piping inside any building shall not be run in or through a circulating air duct, clothes chute, chimney or gas vent, ventilating duct, dumbwaiter, or elevator shaft. This provision shall not apply to ducts used to provide combustion and ventilation air in accordance with 5.3 or to above-ceiling spaces as covered in 3.3.4.

3.3.6 Hangers, Supports, and Anchors:

- a. Piping shall be supported in a substantial and workmanlike manner with pipe hooks, metal pipe straps, bands, brackets, or hangers suitable for the size of piping, of adequate strength and quality, and located at proper intervals so as to prevent or damp out excessive vibration. Piping shall be anchored sufficiently to prevent undue strains on connected equipment and shall not be supported by other piping. Pipe hangers and supports shall conform to the requirements of Standard Practice for Pipe Hangers and Supports—Materials, Design and Manufacturer, ANSI/MSS SP-58.
- **b.** Spacings of supports in gas piping installations shall not be greater than shown in Table II.
- c. Supports, hangers, and anchors shall be installed so as not to interfere with the free expansion and contraction of the piping between anchors. Suitable spring hangers, sway bracing, etc., shall be provided where necessary. All parts of the supporting equipment shall be designed and installed so they will not be disengaged by movement of the supported piping.

3.3.7 Removal of Pipe: If piping containing gas is to be removed, the line shall be first disconnected from all sources of gas and then thoroughly purged with air, water, or inert gas before any cutting or welding is done. (See 4.3.)

Table II
Support of Piping

Steel Pipe, Nominal Size of Pipe (Inches)	Spacing of Supports (Feet)	Nominal Size of Tubing (Inch O.D.)	Spacing of Supports (Feet)
1/2	6	V ₂	4
¾ or 1	8	5/8 or 3/4	6
1¼ or larger (horizontal)	10	% or l	8
11/4 or larger (vertical)	every floor level		

3.4 Concealed Piping in Buildings.

- **3.4.1** General: Gas piping may be installed in concealed locations in accordance with this section.
- **3.4.2** Connections in Original Installations: When installing gas piping which is to be concealed, unions, tubing fittings, running threads, right and left couplings, bushings, and swing joints made by combinations of fittings shall not be used.
- **3.4.3** Piping in Partitions: Concealed gas piping shall not be located in solid partitions.
- **3.4.4 Tubing in Partitions:** This provision shall not apply to tubing which pierces walls, floors, or partitions.

Tubing shall not be run horizontally inside hollow walls or partitions unless protected along its full concealed length against physical damage.

Tubing may be run vertically inside hollow walls or partitions without protection along its entire concealed length provided:

- **a.** A steel striker barrier not less than 0.0508 inch thick* or equivalent is installed between the tubing and the finished wall and extends at least 4 inches beyond concealed penetrations of plates, fire stops, etc.; and
- **b.** The tubing is not rigidly secured.

3.4.5 Piping in Floors:

- a. Except as provided in "b," gas piping in solid floors such as concrete shall be laid in channels in the floor suitably covered to permit access to the piping with a minimum of damage to the building. When piping in floor channels may be exposed to excessive moisture or corrosive substances, it shall be suitably protected.
- b. In other than industrial occupancies and when approved by the authority having jurisdiction, gas piping may be embedded in concrete floor slabs constructed with portland cement. Piping shall be surrounded with a minimum of 1½ inches of concrete and shall not be in physical contact with other metallic structures such as reinforcing rods or electrically neutral conductors. All piping, fittings, and risers shall be protected against corrosion in accordance with 2.6.6. Piping shall not be embedded in concrete slabs containing quickset additives or cinder aggregate.
- **3.4.6 Reconnections:** When necessary to insert fittings in gas pipe which has been installed in a concealed location, the pipe may be reconnected by welding, flanges, or the use of a ground joint union with the nut center-punched to prevent loosening by vibration. Reconnection of tubing in a concealed location is prohibited.

3.5 Piping in Vertical Chases.

3.5.1 Pressure Reduction: If pressure reduction is needed in branch connections for compliance with 2.5.1, such reduction shall take place either inside the chase or immediately adjacent to the outside wall of the chase. Regulator venting and downstream overpressure protection shall comply with 2.8.4 and 2.9. The regulator shall be accessible for service and repair.

This corresponds to No. 16 U.S. Standard gage sheet steel with all applicable minus tolerances included

- **a.** Regulators equipped with a vent limiting means may be vented into the chase.
- **b.** Regulators not equipped with a vent limiting means shall be vented directly to the outdoors or to a point within the top one foot of the chase.
- **3.5.2 Construction:** Chase construction shall comply with local building codes with respect to fire resistance and protection of horizontal and vertical openings.
- 3.5.3 Ventilation: A chase shall be ventilated to the outdoors and only at the top. The opening(s) shall have a minimum free area (in square inches) equal to the product of one-half of the maximum pressure in the piping (in psig) times the largest nominal diameter of that piping (in inches), or the cross-sectional area of the chase, whichever is smaller. When more than one fuel gas piping system is present, the free area for each system shall be calculated and the largest area used.

NOTE: Only vertical chases are recognized by the coverage. It is believed that welded joints for a horizontal gas line would be preferable to a horizontal chase.

3.6 Gas Pipe Turns.

Changes in direction of gas pipe may be made by the use of fittings, factory bends, or field bends.

3.6.1 Metallic Pipe:

- a. Bends shall be made only with bending equipment and procedures especially intended for that purpose.
- **b.** All bends shall be smooth and free from buckling, cracks, or other evidence of mechanical damage.
- **c.** The longitudinal weld of the pipe shall be near the neutral axis of the bend.
- **d.** Pipe shall not be bent through an arc of more than 90 degrees.
- e. The inside radius of a bend shall be not less than 6 times the outside diameter of the pipe.

3.6.2 Plastic Pipe:

a. Plastic pipe may be bent provided that the pipe is not damaged and the internal diameter of the pipe is not effectively reduced.

- **b.** The radius of the inner curve of such bends shall not be less than 25 times the inside diameter of the pipe.
- c. When the piping manufacturer specifies the use of special bending equipment or procedures, such equipment or procedures shall be used.
- **3.6.3** Mitered Bends: Mitered bends are permitted subject to the following limitations:
 - a. Miters shall not be used in systems having a design pressure greater than 50 psig. Deflections caused by misalignments up to 3 degrees are not considered as miters.
 - **b.** The total deflection angle at each miter shall not exceed 90 degrees.
 - c. Care shall be taken in making mitered joints to provide proper root opening and alignment and full weld penetration.
- **3.6.4** Elbows: Factory made welding elbows or transverse segments cut therefrom may be used for changes in direction provided that the arc length measured along the crotch is at least 1 inch in pipe sizes 2 inches and larger.

3.7 Drips and Sediment Traps.

- **3.7.1** Provide Drips Where Necessary: A drip shall be provided at any point in the line of pipe where condensate may collect. When condensation is excessive, a drip should be provided at the outlet of the meter. This drip should be so installed as to constitute a trap wherein an accumulation of condensate will shut off the flow of gas before it will run back into the meter.
- **3.7.2** Location of Drips: All drips shall be installed only in such location that they will be readily accessible to permit cleaning or emptying. A drip shall not be located where the condensate is likely to freeze.
- 3.7.3 Sediment Traps: See 5.5.6.
- 3.8 Outlets.

3.8.1 Location and Installation:

a. The outlet fittings or piping shall be securely fastened in place.

- **b.** Outlets shall not be located behind doors.
- c. Outlets shall be located far enough from floors, walls, patios, slabs, and ceilings to permit the use of proper wrenches without straining, bending, or damaging the piping.
- d. The unthreaded portion of gas piping outlets shall extend not less than I inch through finished ceilings or indoor or outdoor walls.
- e. The unthreaded portion of gas piping outlets shall extend not less than 2 inches above the surface of floors or outdoor patios or slabs.
- f. The provisions of 3.8.1-d and -e do not apply to listed quick-disconnect devices of the flush-mounted type. Such devices shall be installed in accordance with the manufacturer's installation instructions.

3.8.2 Cap All Outlets:

a. Each outlet, including a valve or cock outlet, shall be securely closed gastight with a threaded plug or cap immediately after installation and shall be left closed until the gas utilization equipment is connected thereto. Likewise, when the equipment is disconnected from an outlet and the outlet is not to be used again immediately, it shall be securely closed gastight.

Outlets shall not be closed with tin caps, wooden plugs, corks, or by other improvised methods.

Exception: Laboratory equipment installed in accordance with 5.5.2-a.

b. The above provision does not prohibit the normal use of a listed quick-disconnect device.

3.9 Branch Pipe Connection.

- a. Except on undiluted liquefied petroleum gas supply systems, all branch outlet pipes shall be taken from the top or sides of horizontal lines and not from the bottom.
- **b.** When a branch outlet is placed on a main supply line before it is known what size pipe will be connected to it, the outlet shall be of the same size as the line which supplies it.

3.10 Manual Gas Shutoff Valves (Also see 5.5.4).

3.10.1 Valves at Regulators: An accessible gas shutoff valve shall be provided upstream of each gas pressure regulator. Where two gas

pressure regulators are installed in series in a single gas line, a manual valve is not required at the second regulator.

3.10.2 Valves Controlling Multiple Systems:

- a. Accessibility of Gas Valves: Main gas shutoff valves controlling several gas piping systems shall be readily accessible for operation and installed so as to be protected from physical damage. They shall be plainly marked with a metal tag attached by the installing agency so that the gas piping systems supplied through them can be readily identified.
- b. Shutoff Valves for Multiple House Lines: In multiple tenant buildings supplied through a master meter, or one service regulator when a meter is not provided, or where meters or service regulators are not readily accessible from the equipment location, an individual shutoff valve for each apartment or tenant line shall be provided at a convenient point of general accessibility.

In a common system serving a number of individual buildings, shutoff valves shall be installed at each building.

3.10.3 Emergency Shutoff Valves: An exterior shutoff valve to permit turning off the gas supply to each building in an emergency shall be provided. The emergency shutoff valves shall be plainly marked as such and their locations posted at appropriate points.

3.11 Prohibited Devices.

No device shall be placed inside the gas piping or fittings that will reduce the cross-sectional area or otherwise obstruct the free flow of gas, except when proper allowance in the piping system design has been made for such a device and when approved by the authority having jurisdiction.

3.12 Systems Containing Gas-Air Mixtures Outside the Flammable Range.

When gas-air mixing machines are employed to produce mixtures above or below the flammable range, they shall be provided with suitable stops to prevent adjustment of the mixture to within or approaching the flammable range.

3.13 Systems Containing Flammable Gas-Air Mixtures.

3.13.1 Required Components: A central premix system with a flammable mixture in the blower or compressor shall consist of the following components:

- a. Gas-mixing machine in the form of an automatic gas-air proportioning device combined with a downstream blower or compressor.
- b. Flammable mixture piping, minimum Schedule 40 NPS.
- c. Automatic firecheck(s).
- d. Safety blowout(s) or backfire preventers for systems utilizing flammable mixture lines above $2\frac{1}{2}$ inches nominal pipe size or the equivalent.
- **3.13.2 Optional Components:** The following components may also be utilized in any type central premix system:
 - a. Flowmeter(s).
 - **b.** Flame arrester(s).
- **3.13.3 Additional Requirements:** Gas-mixing machines shall have nonsparking blowers and shall be so constructed that a flashback will not rupture machine casings.
- **3.13.4** Limitations: A mixing blower system shall be limited to applications with minimum practical lengths of mixture piping, limited to a maximum mixture pressure of 10 inches water column, and limited to gases containing no more than 10 percent hydrogen.

The blower shall be equipped with a gas-control valve at its air entrance so arranged that gas is admitted to the air stream, entering the blower in proper proportions for correct combustion by the type of burners employed, the said gas-control valve being of either the zero governor or mechanical ratio valve type which controls the gas and air adjustment simultaneously. No valves or other obstructions shall be installed between the blower discharge and the burner or burners.

NOTE: The mixing blower is acknowledged as a special case because of its inability to tolerate control valves or comparable restrictions between mixing blower and burner(s). With these limitations, mixing blower installations are not required to utilize safety blowouts, backfire preventers, explosion heads, flame arresters, or automatic firechecks which introduce pressure losses.

3.13.5 Installation of Gas-Mixing Machines:

a. The machine shall be located in a large, well-ventilated area or in a small detached building or cut-off room provided with room construction and explosion vents in accordance with the *Guide for*

Venting of Deflagrations, ANSI/NFPA 68. Such rooms or belowgrade installations shall have adequate positive ventilation.

b. When gas-mixing machines are installed in well-ventilated areas, the type of electrical equipment shall be governed by the *National Electrical Code*®, ANSI/NFPA 70, for general service conditions unless other hazards in the area prevail.

When gas-mixing machines are installed in small detached buildings or cut-off rooms, the electrical equipment and wiring shall be installed in accordance with the *National Electrical Code*, ANSI/NFPA 70, for hazardous locations (Article 500, Sections 501-1 through 501-17, Class I, Division 2).

- c. Air intakes for gas-mixing machines using compressors or blowers shall be taken from outdoors whenever practical.
- d. Controls for gas-mixing machines shall include interlocks and a safety shutoff valve of the manual reset type in the gas supply connection to each machine arranged to automatically shut off the gas supply in the event of high or low gas pressure. Except for open burner installations only, this shall be interlocked so that the blower or compressor will stop operating following a gas supply failure. When a system employs pressure air, suitable means shall be provided to shut off the gas supply in the event of air failure.

NOTE: Additional interlocks may be necessary for safe operation of equipment supplied by the gas-mixing machine.

- e. Centrifugal gas-mixing machines in parallel can cause troublesome downstream pulsation or equipment overload. Such systems shall be carefully reviewed by user and equipment manufacturer before installation and means or plans for minimizing these effects shall be prepared and utilized as required.
- 3.13.6 Use of Automatic Firechecks, Safety Blowouts, or Backfire Preventers: Automatic firechecks and safety blowouts or backfire preventers shall be provided in piping systems distributing flammable air-gas mixtures from gas-mixing machines to protect the piping and the machines in event of flashback, in accordance with the following recommendations:
 - a. Approved automatic firechecks shall be installed upstream as close as practicable to the burner inlets following the firecheck manufacturer's instructions.

NOTE 1: Two basic methods are generally used. One calls for a separate firecheck at each burner, the other a firecheck at

each group of burners. The second method is generally more practical if a system consists of many closely spaced burners.

- NOTE 2: An approved automatic firecheck shall be installed as near as practicable upstream from a flame arrester used for local protection where test burners or lighting torches are employed.
- **b.** A separate manually operated gas valve shall be provided at each automatic firecheck for shutting off the flow of gas-air mixture through the firecheck after a flashback has occurred. The valve shall be located upstream as close as practicable to the inlet of the automatic firecheck.

CAUTION: These valves shall not be reopened after a flashback has occurred until the firecheck has cooled sufficiently to prevent reignition of the flammable mixture and has been properly reset.

c. A safety blowout or backfiring preventer shall be provided in the mixture line near the outlet of each gas-mixing machine where the size of the piping is larger than 2½ inches NPS or equivalent, to protect the mixing equipment in the event of an explosion passing through an automatic firecheck. The manufacturer's instructions shall be followed when installing these devices, particularly after a disc has burst.

The discharge from the safety blowout or backfire preventer shall be located or shielded so that particles from the ruptured disc cannot be directed toward personnel. Whenever there are interconnected installations of gas-mixing machines with safety blowouts or backfire preventers, provision shall be made to keep the mixture from other machines from reaching any ruptured disc opening. Check valves shall not be used for this purpose.

d. Explosion heads (rupture disc) may be provided in large capacity premix systems to relieve excessive pressure in pipelines. They shall be located at and vented to a safe outdoor location. Provisions shall be provided for automatically shutting off the supply of gas-air mixture in the event of rupture.

3.14 Electrical Bonding and Grounding.

a. Each aboveground portion of a gas piping system upstream from the equipment shutoff valve shall be electrically continuous

and bonded to any grounding electrode. as defined by the *National Electrical Code*, ANSI/NFPA 70.

b. Gas piping shall not be used as a grounding electrode.

3.15 Electrical Circuits.

Electrical circuits shall not utilize gas piping or components except that low-voltage (50 volts or less) control circuits, ignition circuits, and electronic flame detection device circuits may make use of piping or components for a part of an electric circuit.

3.16 Electrical Connections.

- a. All electrical connections between wiring and electrically operated control devices in a piping system shall conform to the requirements of the *National Electrical Code*, ANSI/NFPA 70 (see 3.14).
- b. Any essential safety control depending upon electric current as the operating medium shall be of a type which will shut off (fail safe) the flow of gas in the event of current failure.

PART 4

GAS PIPING INSPECTION, TESTING, AND PURGING

4.1 Pressure Testing and Inspection.

4.1.1 General:

- **a.** Prior to acceptance and initial operation, all piping installations shall be inspected and tested to determine that the materials, design, fabrication, and installation practices comply with the requirements of this *Code*.
- b. Inspection shall consist of visual examination, during or after manufacture, fabrication, assembly, or pressure tests as appropriate. Supplementary types of nondestructive inspection techniques, such as magnetic-particle, radiographic, ultrasonic, etc., although desirable, are not required unless specifically listed herein or in the engineering design.
- c. In the event repairs or additions are made following the pressure test, the affected piping shall be tested, except that in the case of minor repairs or additions testing may be omitted when precautionary measures are taken to assure sound construction.
- d. Because it is sometimes necessary to divide a piping system into test sections and install test heads, connecting piping, and other necessary appurtenances for testing, it is not required that the tie-in sections of pipe be pressure tested. Tie-in connections, however, shall be tested with soap solution after gas has been introduced and the pressure has been increased sufficiently to give some indications should leaks exist. (See caution following 4.1.5-b.)
- e. The test procedure used shall be capable of disclosing all leaks in the section being tested and shall be selected after giving due consideration to the volumetric content of the section and to its location.
- f. A piping system may be tested as a complete unit or in sections as the construction progresses. Under no circumstances shall a valve in a line be used as a bulkhead between gas in one section of the piping system and test medium in an adjacent section, unless two valves are installed in series with a valved "tell-tale" located

between these valves. A valve shall not be subjected to the test pressure unless it can be determined that the valve, including the valve closing mechanism, is designed to safely withstand the test pressure.

g. Regulator and valve assemblies fabricated independently of the piping system in which they are to be installed may be tested with inert gas at the time of fabrication.

4.1.2 Test Medium:

- a. Except as provided in 4.1.2-b, the test medium shall be air, nitrogen, or carbon dioxide. OXYGEN SHALL NEVER BE USED.
- b. Fuel gas may be used in piping systems operating at pressures of ½ pound per square inch or less.

4.1.3 Test Preparation:

- **a.** Whenever possible, pipe joints, including welds, shall be left uninsulated and exposed for examination during the test. If the pipe end joints have been previously tested in accordance with this *Code*, they may be insulated, covered, or concealed.
- **b.** Expansion joints shall be provided with temporary restraints, if required, for the additional thrust load under test.
- c. Equipment which is not to be included in the test shall be either disconnected from the piping or isolated by blanks, blind flanges, or caps. Flanged joints at which blinds are inserted to blank off other equipment during the test need not be tested.
- d. When the piping system is connected to equipment or components designed for operating pressures of less than the test pressure, such equipment and their individual shutoff valves shall be isolated from the piping system by disconnecting them and capping the outlet(s).
- e. When the piping system is connected to equipment or components designed for operating pressures equal to or greater than the test pressure, such equipment shall be isolated from the piping system by closing their individual manual shutoff valve(s).
- f. All testing of piping systems shall be done with due regard for the safety of employees and the public during the test. Bulkheads, anchorage, and bracing suitably designed to resist test pressures

shall be installed if necessary. Prior to testing, the interior of the pipe shall be cleared of all foreign material.

4.1.4 Test Pressure:

- a. Test pressure shall be measured with a manometer or with a pressure measuring device designed and calibrated to read, record, or indicate a pressure loss due to leakage during the pressure test period. The source of pressure shall be isolated before the pressure tests are made.
- b. The test pressure to be used shall be no less than $1\frac{1}{2}$ times the proposed maximum working pressure, but not less than 3 psig, irrespective of design pressure. When the test pressure exceeds 125 psig, the test pressure shall not exceed a value which produces a hoop stress in the piping greater than 50 percent of the specified minimum yield strength of the pipe.
- c. Systems for undiluted liquefied petroleum gases shall withstand the pressure test in accordance with "b" above, or, for systems operating at a pressure of ½ psig or less when appliances are connected to the piping system, shall withstand a pressure of not less than 10.0 inches nor more than 14.0 inches water column for a period of not less than 10 minutes without showing any drop in pressure. The source of pressure shall be isolated before the pressure tests are made.
- d. Test duration shall be not less than one-half hour for each 500 cubic feet of pipe volume or fraction thereof. When testing a system having a volume less than 10 cubic feet or a system in a single-family dwelling, the test duration may be reduced to 10 minutes. For piping systems having a volume of more than 24,000 cubic feet, the duration of the test need not exceed 24 hours.

4.1.5 Detection of Leaks and Defects:

- a. The piping system shall withstand the test pressure specified without showing any evidence of leakage or other defects. Any reduction of test pressures as indicated by pressure gages shall be deemed to indicate the presence of a leak unless such reduction can be readily attributed to some other cause.
- b. The leakage shall be located by means of an approved combustible gas detector, soap and water, or an equivalent nonflammable solution, as applicable. Matches, candles, open flames, or other methods which could provide a source of ignition shall not be used.

CAUTION: Since some leak test solutions, including soap and water, may cause corrosion or stress cracking, the piping shall be rinsed with water after testing, unless it has been determined the leak test solution is noncorrosive.

When leakage or other defects are located, the affected portion of the piping system shall be repaired or replaced and retested. (See 4.1.1-c.)

4.1.6 Test Records: Records shall be made of inspection and all tests performed. These records shall indicate which portions of the piping system conform to this *Code* or were pressure tested.

4.2 System and Equipment Check.

- **4.2.1 Before Turning Gas On:** Before gas is introduced into a system of new gas piping, or back into an existing system after being shut off, the entire system shall be checked to determine that there are no open fittings or ends and that all manual valves at outlets on equipment are closed and all unused valves at outlets are closed and plugged or capped.
- **4.2.2** Check for Leakage: Immediately after turning on the gas, the piping system shall be checked to ascertain that no gas is escaping. (See Appendix D for suggested method.)

If leakage is indicated, the gas supply shall be shut off until the necessary repairs have been made.

4.2.3 Placing Equipment in Operation: Gas utilization equipment may be placed in operation after the piping system has been tested and determined to be free of leakage and purged in accordance with 4.3.2.

4.3 Purging.

The processes of voiding a gas pipe line of fuel gas and replacing the fuel gas with air, or charging a gas pipe line that is full of air with fuel gas, require that a significant amount of combustible mixture not be developed within the pipe line or released within a confined space.

4.3.1 Removal from Service: When gas piping is to be opened for servicing, addition, or modification, the section to be worked on shall be turned off from the gas supply at the nearest convenient point, and the line pressure vented to the outdoors.

If this section exceeds the lengths shown in Table III, the remaining gas shall be displaced with an inert gas.

Table III

Length of Gas Line Requiring Purging for Servicing or Modification

Nominal Pipe Size, Inches	Min. Length o Piping Requirin Purging				
21/2	50 feet				
3	30 feet				
4	15 feet				
6	10 feet				
8 or larger	Any length				

4.3.2 Placing in Operation: When piping full of air is placed in operation, the air in the piping shall be displaced with fuel gas, provided the piping does not exceed the length shown in Table IV. The air can be safely displaced with fuel gas provided that a moderately rapid and continuous flow of fuel gas is introduced at one end of the line and air is vented out at the other end. The fuel gas flow should be continued without interruption until the vented gas is free of air. The point of discharge shall not be left unattended during purging. The vent shall then be closed.

If the piping exceeds the lengths shown in Table IV, the air in the piping shall be displaced with an inert gas, and the inert gas shall then be displaced with fuel gas.

Table IV

Length of Piping Requiring Purging Before
Placing in Operation

Nominal Pipe Size, Inches	Min. Length of Piping Requirin Purging				
3	30 feet				
4	15 feet				
6	10 feet				
8 or larger	Any length				

- **4.3.3** Discharge of Purged Gases: The open end of piping systems being purged shall not discharge into confined spaces or areas where there are sources of ignition unless precautions are taken to perform this operation in a safe manner by ventilation of the space, control or purging rate, and elimination of all hazardous conditions.
- **4.3.4** Placing Equipment in Operation: After the piping has been placed in operation, all equipment shall be purged and then placed in operation, as necessary.

PART 5

EQUIPMENT INSTALLATION

5.1 General.

5.1.1 Appliances, Accessories, and Equipment To Be Approved: Gas appliances, accessories, and gas utilization equipment shall be approved. Approved shall mean "acceptable to the authority having jurisdiction."

Acceptance of unlisted gas utilization equipment and accessories shall be on the basis of a sound engineering evaluation. In such cases, the equipment shall be safe and suitable for the proposed service and be recommended for the service by the manufacturer.

NOTE: The National Fire Protection Association, the American National Standards Institute, and the American Society of Mechanical Engineers do not approve, inspect, or certify any installations, procedures, equipment, or materials, nor do they approve or evaluate testing laboratories. In determining acceptability of installations or procedures, the authority having jurisdiction may base acceptance on compliance with NFPA, ANSI, ASME, or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices (see Section 1.7, Definitions) of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

- 5.1.2 Assignment and Coordination of Gas Equipment Design, Construction, and Maintenance: Because industrial gas applications are so varied in nature, many agencies are jointly involved with their safe and satisfactory use. See Appendix B for suggested guidelines and checklist
- **5.1.3** Added or Converted Equipment: When additional or replacement equipment is installed or an appliance is converted to gas from another fuel, the location in which the equipment is to be operated shall be checked to:
 - a. Verify that air for combustion and ventilation is provided when required, in accordance with provisions of Section 5.3. If existing

facilities are not adequate they shall be upgraded to Section 5.3 specifications; and

b. The installation components and equipment shall meet the clearances to combustible material provisions of paragraph 5.2.2.

It shall be determined that the installation and operation of the additional or replacement equipment does not render the existing equipment unsafe for continued operation. See Appendix H for recommended procedures.

- **5.1.4** Type of Gas(es): It shall be determined whether the gas utilization equipment has been designed for use with the gas to which it will be connected. No attempt shall be made to convert the equipment from the gas specified on the rating plate for use with a different gas without consulting the serving gas supplier or the equipment manufacturer for complete instructions.
- 5.1.5 Safety Shutoff Devices for Unlisted LP-Gas Equipment Used Indoors: Unlisted gas utilization equipment for use with undiluted liquefied petroleum gases and installed indoors, shall be equipped with safety shutoff devices of the complete shutoff type.
- 5.1.6 Use of Air or Oxygen Under Pressure: When air or oxygen under pressure is used in connection with the gas supply, effective means such as a backpressure regulator and relief valve shall be provided to prevent air or oxygen from passing back into the gas piping. The serving gas supplier shall be consulted for details. When oxygen is used, see the Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting and Allied Processes, ANSI/NFPA 51.
- 5.1.7 Protection of Gas Equipment from Fumes or Gases Other than Products of Combustion: When corrosive or flammable process fumes are present, suitable means for their safe disposal shall be provided. Such fumes include, among others, carbon monoxide, hydrogen sulfide, ammonia, chlorine, and halogenated hydrocarbons.

NOTE: Halogenated hydrocarbons are particularly injurious and corrosive after contact with flames or hot surfaces.

Gas appliances installed in beauty shops, barber shops, or other facilities where chemicals which generate corrosive or flammable products such as aerosol sprays are routinely used, shall be located in an equipment room separate or partitioned off from other areas with provisions for combustion and dilution air from outdoors. This requirement shall not apply to direct vent equipment which is constructed and

installed so all air for combustion is obtained from the outside atmosphere and all flue gases are discharged to the outside atmosphere.

5.1.8 Building Structural Members:

- a. Structural members of a building shall not pass through gas utilization equipment having an operating temperature in excess of 500 F.
- b. Structural members passing through gas utilization equipment having an operating temperature of 500 F or less shall be of noncombustible material. Building columns, girders, beams, or trusses shall not be included within equipment, unless appropriate insulation and ventilation are provided to avoid all deterioration in strength, and linear expansion of the building structure in either a vertical or horizontal direction.
- c. Gas utilization equipment shall be furnished either with load distributing bases or with a sufficient number of adequate supports to prevent damage to either the building structure or equipment.
- **d.** At the locations selected for installation of gas utilization equipment, the dynamic and static load carrying capacities of the building structure shall be checked to determine if they are adequate to carry the additional loads. The equipment shall be adequately supported and shall be connected to the piping so as not to exert undue stress on the connections.
- **5.1.9 Flammable Vapors:** Gas appliances shall not be installed in any location where flammable vapors are likely to be present, unless the design, operation, and installation are such to eliminate the probable ignition of the flammable vapors. Gas utilization equipment installed in compliance with 5.1.10, 5.1.11, and 5.1.12 shall be considered to comply with the intent of this provision.

5.1.10 Installation in Residential Garages:

- a. Gas utilization equipment in residential garages shall be installed so that all burners and burner ignition devices are located not less than 18 inches above the floor.
- **b.** Such equipment shall be located, or protected, so it is not subject to physical damage by a moving vehicle.

5.1.11 Installation in Commercial Garages:

a. Parking Structures: Gas utilization equipment may be installed in enclosed, basement, and underground parking structures

(see Section 1.7. Definitions) when there is no dispensing or transferring of liquefied petroleum gas or Class I or Class II flammable liquids (as defined in the Flammable and Combustible Liquids Code, ANSI/NFPA 30), provided all burners, burner flames, and burner ignition devices are located not less than 18 inches above the floor, or the equipment is enclosed by a partition not less than 18 inches high, and provided continuous mechanical ventilation is supplied at a rate of not less than six air changes per hour. Gas utilization equipment shall be located or protected so it is not subject to physical damage by a moving vehicle.

Overhead heaters shall be installed at least 8 feet above the floor. Overhead radiant type heaters shall be located at a sufficient height to avoid overheating vehicles parked underneath.

For installations in parking structures which have facilities for dispensing fuel, see the *Standard for Parking Structures*, NFPA 88A.

b. Repair Garages: Gas utilization equipment may be installed in a repair garage (see Section 1.7, Definitions) when there is no dispensing or transferring of liquefied petroleum gas or Class I or II flammable liquids (as defined in the Flammable and Combustible Liquids Code, ANSI/NFPA 30), provided all burners, burner flames, and burner ignition devices are located not less than 18 inches above the floor, and provided continuous mechanical ventilation is supplied at a rate of not less than 0.75 cubic foot per minute per square foot of floor area. For installations in below grade areas, an approved means shall be provided for introducing an equal amount of outdoor air. The equipment and the ventilation system shall be interlocked so the equipment will not operate unless the ventilation system is in operation. Gas utilization equipment shall be located or protected so it is not subject to physical damage by a moving vehicle.

Overhead heaters shall be installed at least 8 feet above the floor. Overhead radiant type heaters shall be located at a sufficient height to avoid overheating vehicles parked underneath.

For installations in repair garages, see the Standard for Repair Garages, NFPA 88B.

5.1.12 Installation in Aircraft Hangars: Heaters in aircraft hangars shall be installed in accordance with the *Standard on Aircraft Hangars*, ANSI/NFPA 409.

- **5.1.13** Gas Equipment Physical Protection: When it is necessary to locate gas utilization equipment close to a passageway traveled by trucks or cranes, suitable guardrails or bumper plates shall be installed to protect the equipment from damage.
- **5.1.14 Venting of Flue Gases:** Gas utilization equipment shall be vented in accordance with the provisions of Part 7, Venting of Equipment.
- **5.1.15** Extra Device or Attachment: No device or attachment shall be installed on any gas utilization equipment which may in any way impair the combustion of gas.
- **5.1.16** Adequate Capacity of Piping: When connecting additional gas utilization equipment to a gas piping system, the existing piping shall be checked to determine if it has adequate capacity (see 2.4). If inadequate, the existing system shall be enlarged as necessary or separate gas piping of adequate capacity shall be run from the point of delivery to the equipment.
- **5.1.17** Avoid Strain on Gas Piping: Gas utilization equipment shall be adequately supported and so connected to the piping as not to exert undue strain on the connections.
- **5.1.18** Gas Appliance Pressure Regulators: When the gas supply pressure is higher than that at which the gas utilization equipment is designed to operate or varies beyond the design pressure limits of the equipment, a gas appliance pressure regulator shall be installed.

5.1.19 Venting of Gas Appliance Pressure Regulators:

- a. Gas appliance pressure regulators requiring access to the atmosphere for successful operation shall be equipped with vent piping leading outdoors or, if the regulator vent is an integral part of the equipment, into the combustion chamber adjacent to a continuous pilot, unless constructed or equipped with a vent limiting means to limit the escape of gas from the vent opening in the event of diaphragm failure.
- **b.** Vent limiting means shall be employed on listed gas appliance pressure regulators only.
- c. In the case of vents leading outdoors, means shall be employed to prevent water from entering this piping and also to prevent stoppage of it by insects and foreign matter.
- **d.** Under no circumstances shall a regulator be vented to the gas utilization equipment flue or exhaust system.

- e. In the case of vents entering the combustion chamber, the vent shall be located so the escaping gas will be readily ignited by the pilot and the heat liberated thereby will not adversely affect the normal operation of the safety shutoff system. The terminus of the vent shall be securely held in a fixed position relative to the pilot. For manufactured gas, the need for a flame arrester in the vent piping shall be determined.
- f. A vent line(s) from a gas appliance pressure regulator and a bleed line(s) from a diaphragm type valve shall not be connected to a common manifold terminating in a combustion chamber. Vent lines shall not terminate in positive pressure type combustion chambers.

5.1.20 Bleed Lines for Diaphragm Type Valves:

- a. Diaphragm type valves shall be equipped to convey bleed gas to the outside atmosphere or into the combustion chamber adjacent to a continuous pilot.
- **b.** In the case of bleed lines leading outdoors, means shall be employed to prevent water from entering this piping and also to prevent stoppage of it by insects and foreign matter.
- c. Under no circumstances shall bleed lines terminate in the gas utilization equipment flue or exhaust system.
- d. In the case of bleed lines entering the combustion chamber, the bleed line shall be located so the bleed gas will be readily ignited by the pilot and the heat liberated thereby will not adversely affect the normal operation of the safety shutoff system. The terminus of the bleed line shall be securely held in a fixed position relative to the pilot. For manufactured gas, the need for a flame arrester in the bleed line piping shall be determined.
- e. A bleed line(s) from a diaphragm type valve and a vent line(s) from a gas appliance pressure regulator shall not be connected to a common manifold terminating in a combustion chamber. Bleed lines shall not terminate in positive pressure type combustion chambers.
- **5.1.21** Combination of Equipment: Any combination of gas utilization equipment, attachments, or devices used together in any manner shall comply with the standards which apply to the individual equipment.
- **5.1.22 Installation Instructions:** The installing agency shall conform with the equipment manufacturer's specific recommendations in com-

pleting an installation that will provide satisfactory performance and serviceability. The installing agency shall also leave the manufacturer's installation, operating, and maintenance instructions in a location on the premises where they will be readily available for reference and guidance of the authority having jurisdiction, servicemen, and the owner or operator.

5.1.23 Protection of Outdoor Equipment: Gas utilization equipment not listed for outdoor installation but installed outdoors shall be provided with protection to the degree that the environment requires. Equipment listed for outdoor installation may be installed without protection in accordance with the provisions of their listing. (See 5.2.1.)

5.2 Accessibility and Clearance.

- 5.2.1 Accessibility for Service: All gas utilization equipment shall be located with respect to building construction and other equipment so as to permit access to the gas utilization equipment. Sufficient clearance shall be maintained to permit cleaning of heating surfaces; the replacement of filters, blowers, motors, burners, controls, and vent connections; the lubrication of moving parts where necessary; the adjustment and cleaning of burners and pilots; and, the proper functioning of explosion vents, if provided. For attic installation the passageway and servicing area adjacent to the equipment shall be floored.
- **5.2.2** Clearance to Combustible Materials: Gas utilization equipment and their vent connectors shall be installed with clearances from combustible material so their operation will not create a hazard to persons or property.

Minimum clearances between combustible walls and the back and sides of various conventional types of equipment and their vent connectors are specified in Part 6, Installation of Specific Equipment, and Part 7, Venting of Equipment. (Reference may also be made to the Standard for Chimneys, Fireplaces, Vents and Solid Fuel Burning Appliances, ANSI/NFPA 211.)

Equipment shall not be installed on carpeting, unless the equipment is listed for such installation.

5.3 Air for Combustion and Ventilation.

5.3.1 General.


- a. The provisions of 5.3 apply to gas utilization equipment installed in buildings and which require air for combustion, ventilation, and dilution of flue gases from within the building. They do not apply to (1) direct vent equipment which is constructed and installed so that all air for combustion is obtained from the outside atmosphere and all flue gases are discharged to the outside atmosphere, or (2) enclosed furnaces which incorporate an integral total enclosure and use only outside air for combustion and dilution of flue gases.
- b. Equipment shall be installed in a location in which the facilities for ventilation permit satisfactory combustion of gas, proper venting, and maintenance of ambient temperature at safe limits under normal conditions of use. Equipment shall be located so as not to interfere with proper circulation of air. When normal infiltration does not provide the necessary air, outside air shall be introduced.
- c. In addition to air needed for combustion, process air shall be provided as required for: cooling of equipment or material, controlling dew point, heating, drying, oxidation or dilution, safety exhaust, odor control, and air for compressors.
- **d.** In addition to air needed for combustion, air shall be supplied for ventilation, including all air required for comfort and proper working conditions for personnel.
- e. A draft hood or a barometric draft regulator shall be installed in the same room or enclosure as the equipment in such a manner as to prevent any difference in pressure between the hood or regulator and the combustion air supply.
- f. While all forms of building construction cannot be covered in detail, air for combustion, ventilation, and dilution of flue gases for gas utilization equipment vented by natural draft normally may be obtained by application of one of the methods covered in 5.3.3 and 5.3.4.
- g. Air requirements for the operation of exhaust fans, kitchen ventilation systems, clothes dryers, and fireplaces shall be considered in determining the adequacy of a space to provide combustion

air requirements. See Appendix H for one method of determining adequate air for equipment operation.

5.3.2 Equipment Located in Unconfined Spaces: In unconfined spaces (see Section 1.7, Definitions) in buildings, infiltration may be adequate to provide air for combustion, ventilation, and dilution of flue gases. However, in buildings of unusually tight construction (see Section 1.7, Definitions), additional air shall be provided using the methods described in 5.3.3-b or 5.3.4.

5.3.3 Equipment Located in Confined Spaces:


a. All Air from Inside the Building: The confined space shall be provided with two permanent openings communicating directly with an additional room(s) of sufficient volume so that the combined volume of all spaces meets the criteria for an unconfined space. The total input of all gas utilization equipment installed in the combined space shall be considered in making this determination. Each opening shall have a minimum free area of 1 square inch per 1,000 Btu per hour of the total input rating of all gas utilization equipment in the confined space, but not less than 100 square inches. One opening shall be within 12 inches of the top and one within 12 inches of the bottom of the enclosure. (See Figure 1.)



NOTE: Each opening shall have a free area of not less than one square inch per 1,000 Btu per hour of the total input rating of all equipment in the enclosure, but not less than 100 square inches.


Figure 1. Equipment Located in Confined Spaces; All Air from Inside the Building. See 5.3.3-a.

- b. All Air From Outdoors: The confined space shall be provided with two permanent openings, one commencing within 12 inches of the top and one commencing within 12 inches of the bottom of the enclosure. The openings shall communicate directly, or by ducts, with the outdoors or spaces (crawl or attic) that freely communicate with the outdoors.
 - 1. When directly communicating with the outdoors, each opening shall have a minimum free area of 1 square inch per 4,000 Btu per hour of total input rating of all equipment in the enclosure. (See Figure 2.)
 - 2. When communicating with the outdoors through vertical ducts, each opening shall have a minimum free area of 1 square inch per 4,000 Btu per hour of total input rating of all equipment in the enclosure. (See Figure 3.)
 - 3. When communicating with the outdoors through horizontal ducts, each opening shall have a minimum free area of 1 square inch per 2,000 Btu per hour of total input rating of all equipment in the enclosure. (See Figure 4.)




NOTE: The inlet and outlet air openings shall each have a free area of not less than one square inch per 4,000 Btu per hour of the total input rating of all equipment in the enclosure.

Figure 2. Equipment Located in Confined Spaces; All Air from Outdoors — Inlet Air from Ventilated Crawl Space and Outlet Air to Ventilated Attic. See 5.3.3-b.



NOTE: The inlet and outlet air openings shall each have a free area of not less than one square inch per 4,000 Btu per hour of the total input rating of all equipment in the enclosure.

Figure 3. Equipment Located in Confined Spaces; All Air from Outdoors Through Ventilated Attic. See 5.3.3-b.



NOTE: Each air duct opening shall have a free area of not less than one square inch per 2,000 Btu per hour of the total input rating of all equipment in the enclosure.

If the equipment room is located against an outside wall and the air openings communicate directly with the outdoors, each opening shall have a free area of not less than one square inch per 4,000 Btu per hour of the total input rating of all equipment in the enclosure.

Figure 4. Equipment Located in Confined Spaces; All Air from Outdoors, See 5.3.3-b.

- 4. When ducts are used, they shall be of the same cross-sectional area as the free area of the openings to which they connect. The minimum dimension of rectangular air ducts shall be not less than 3 inches.
- **5.3.4** Specially Engineered Installations: The requirements of 5.3.3 shall not necessarily govern when special engineering, approved by the authority having jurisdiction, provides an adequate supply of air for combustion, ventilation, and dilution of flue gases.
- 5.3.5 Louvers and Grilles: In calculating free area in 5.3.3, consideration shall be given to the blocking effect of louvers, grilles, or screens protecting openings. Screens used shall not be smaller than ¼ inch mesh. If the free area through a design of louver or grille is known, it should be used in calculating the size opening required to provide the free area specified. If the design and free area are not known, it may be assumed that wood louvers will have 20-25 percent free area and metal louvers and grilles will have 60-75 percent free area. Louvers and grilles shall be fixed in the open position or interlocked with the equipment so that they are opened automatically during equipment operation.
- **5.3.6** Special Conditions Created by Mechanical Exhausting or Fireplaces: Operation of exhaust fans, ventilation systems, clothes dryers, or fireplaces may create conditions requiring special attention to avoid unsatisfactory operation of installed gas utilization equipment.

5.4 Equipment on Roofs.

5.4.1 General:

- a. Gas utilization equipment on roofs shall be designed or enclosed so as to withstand climatic conditions in the area in which they are installed. If enclosures are provided, each enclosure shall permit easy entry and movement, shall be of reasonable height, and shall have at least 30-inch clearance between the entire service access panel(s) of the equipment and the wall of the enclosure.
- **b.** Roofs on which equipment is to be installed shall be capable of supporting the additional load or shall be reinforced to support the additional load.
- c. All access locks, screws, and bolts shall be of corrosion-resistant material.

5.4.2 Installation of Equipment on Roofs:

a. Gas utilization equipment shall be installed in accordance with its listing and the manufacturer's installation instructions.

- b. Equipment shall be installed on a well-drained surface of the roof. At least 6 feet clearance shall be available between any part of the equipment and the edge of a roof or similar hazard, or rigidly fixed rails or guards at least 42 inches in height shall be provided on the exposed side except that parapets or other building structures at least 42 inches in height may be utilized in lieu of rails or guards.
- c. All equipment requiring an external source of electrical power for its operation shall be provided with (1) a readily accessible electrical disconnect means within sight of the equipment, which will completely deenergize the equipment, and (2) a 120-volt A-C grounding type receptacle outlet on the roof adjacent to the equipment. The receptacle outlet shall be on the supply side of the disconnect switch.
- d. When water stands on the roof at the equipment or in the passageways to the equipment, or when the roof is of a design having a water seal, a suitable platform or walkway or both shall be provided above the water line. Such platform(s) or walkway(s) shall be located adjacent to the equipment and control panels so that the equipment can be safely serviced when water stands on the roof.

5.4.3 Access to Equipment on Roofs:

- **a.** Gas utilization equipment located on roofs or other elevated locations shall be accessible.
- **b.** Buildings of more than 15 feet in height shall have an inside means of access to the roof.
- c. The inside means of access shall be a permanent, or fold-away, inside stairway or ladder, terminating in an enclosure, scuttle, or trap door. Such scuttles or trap doors shall be at least 24 inches by 24 inches in size, shall open easily and safely under all conditions, especially snow, and shall be constructed so as to permit access from the roof side unless deliberately locked on the inside.

At least 6 feet of clearance shall be available between the access opening and the edge of the roof or similar hazard, or rigidly fixed rails or guards at least 42 inches in height shall be provided on the exposed side; parapets or other building structure at least 42 inches in height may be utilized in lieu of guards or rails.

d. Proper permanent lighting shall be provided at the roof access. The switch for such lighting shall be located inside the building near the access means leading to the roof.

5.5 Equipment Connections to Building Piping.

- **5.5.1** Connecting Gas Equipment: Gas utilization equipment shall be connected to the building piping in compliance with 5.5.4 by one of the following:
 - a. Rigid metallic pipe and fittings.
 - **b.** Semirigid metallic tubing and metallic fittings. Aluminum alloy tubing shall not be used in exterior locations.
 - c. Listed connectors used in accordance with the terms of their listing that are completely in the same room as the equipment.
 - **d.** Listed gas hose connectors in accordance with 5.5.2.
 - e. Gas-fired food service (commercial cooking) equipment listed for use with casters or otherwise subject to movement for cleaning, and other large and heavy gas utilization equipment that may be moved, shall be connected in accordance with the connector manufacturer's installation instructions using a listed appliance connector complying with the Standard for Connectors for Movable Gas Appliances, ANSI Z21.69.
 - f. In "b" and "c" above, the connector or tubing shall be installed so as to be protected against physical and thermal damage. Aluminum-alloy tubing and connectors shall be coated to protect against external corrosion where they are in contact with masonry, plaster, or insulation or are subject to repeated wettings by such liquids as water (except rain water), detergents, or sewage.
- **5.5.2** Use of Gas Hose Connectors: Listed gas hose connectors shall be used in accordance with the terms of their listing as follows:
 - a. Indoor: Indoor gas hose connectors may be used with laboratory, shop, or ironing equipment that requires mobility during operation. A shutoff valve shall be installed where the connector is attached to the building piping. The connector shall be of minimum length but shall not exceed 6 feet. The connector shall not be concealed and shall not extend from one room to another nor pass through wall partitions, ceilings, or floors.
 - **b. Outdoor:** Outdoor gas hose connectors may be used to connect portable outdoor gas-fired equipment. A shutoff valve or a listed quick-disconnect device shall be installed where the connector is attached to the supply piping and in such a manner to prevent the accumulation of water or foreign matter. This connection shall only be made in the outdoor area where the equipment is to be used.

5.5.3 Connection of Portable and Mobile Industrial Gas Equipment:

- a. Portable industrial gas utilization equipment or equipment requiring mobility or subject to vibration may be connected to the building gas piping system by the use of flexible hose suitable and safe for the conditions under which it may be used.
- b. Industrial gas utilization equipment requiring mobility may be connected to the rigid piping by the use of swivel joints or couplings which are suitable for the service required. Where swivel joints or couplings are used, only the minimum number required shall be installed.
- c. Industrial gas utilization equipment subject to vibration may be connected to the building piping system by the use of all metal flexible connectors suitable for the service required.
- **d.** Where flexible connections are used, they shall be of the minimum practical length and shall not extend from one room to another nor pass through any walls, partitions, ceilings, or floors. Flexible connections shall not be used in any concealed location. They shall be protected against physical or thermal damage and shall be provided with gas shutoff valves in readily accessible locations in rigid piping upstream from the flexible connections.
- 5.5.4 Equipment Shutoff Valves and Connections: Any gas utilization equipment connected to a piping system shall have an accessible, approved manual shutoff valve with a nondisplaceable rotor member installed within 6 feet of the equipment it serves. When a connector is used the valve shall be installed upstream of the connector. A union or flanged connection shall be provided downstream from this valve to permit removal of controls.
- **5.5.5** Quick-Disconnect Devices: Gas utilization equipment connectors may be connected to the building piping by means of a listed quick-disconnect device, and when installed indoors, a manual shutoff valve shall be installed upstream of the quick-disconnect device.
- 5.5.6 Sediment Trap: If a sediment trap is not incorporated as a part of the gas utilization equipment, a sediment trap shall be installed as close to the inlet of the equipment as practical at the time of equipment installation. The sediment trap shall be either a tee fitting with a capped nipple in the bottom outlet as illustrated in Figure 5 or other device recognized as an effective sediment trap. Illuminating appliances, ranges, clothes dryers, and outdoor grills need not be so equipped.

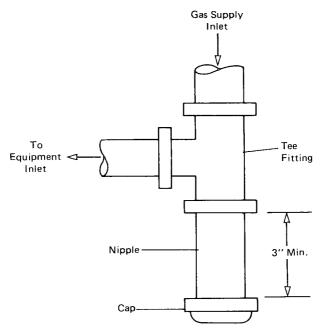


Figure 5. Method of Installing a Tee Fitting Sediment Trap.

5.5.7 **Installation of Piping.** Piping shall be installed in a manner not to interfere with inspection, maintenance, or servicing of the gas utilization equipment.

5.6 Electrical.

- **5.6.1 Electrical Connections:** Electrical connections between gas utilization equipment and the building wiring, including the grounding of the equipment, shall conform to the *National Electrical Code*, ANSI/NFPA 70.
- **5.6.2** Electric Ignition and Control Devices: Electrical ignition, burner control, and electrical vent damper devices shall not permit unsafe operation of the gas utilization equipment in the event of electrical power interruption or when the power is restored.

- 5.6.3 Electrical Circuit: The electrical circuit employed for operating the automatic main gas-control valve, automatic pilot, room temperature thermostat, limit control, or other electrical devices used with the gas utilization equipment shall be in accordance with the wiring diagrams supplied with the equipment.
- **5.6.4** Continuous Power: All gas utilization equipment using electrical controls shall have the controls connected into a permanently live electrical circuit, i.e., one that is not controlled by a light switch. Central heating equipment shall be provided with a separate electrical circuit.
- 5.7 Room Temperature Thermostats.
- **5.7.1 Locations:** Room temperature thermostats shall be installed in accordance with the manufacturer's instructions.
- **5.7.2 Drafts:** Any hole in the plaster or panel through which the wires pass from the thermostat to the gas utilization equipment being controlled shall be sealed so as to prevent drafts from affecting the thermostat.

PART 6

INSTALLATION OF SPECIFIC EQUIPMENT

6.1 General.

a. This Part is primarily applicable to nonindustrial type gas utilization equipment and installations and, unless specifically indicated, does not apply to industrial type equipment and installations. Listed gas utilization equipment shall be installed in accordance with their listing and the manufacturer's instructions, or as elsewhere specified in this Part. Unlisted equipment shall be installed as specified in this Part as applicable to the equipment.

For additional information concerning particular gas equipment and accessories, including industrial types, reference can be made to the standards listed in Appendix A.

b. Gas utilization equipment shall not be installed so its combustion, ventilation, and dilution air is obtained only from a bedroom or bathroom unless the bedroom or bathroom is an unconfined space (see 5.3.2 and Section 1.7, Definitions).

6.2 Air Conditioning Equipment.

- **6.2.1 Independent Gas Piping:** Gas piping serving heating gas utilization equipment may also serve cooling equipment when heating and cooling equipment cannot be operated simultaneously. (See 2.4.)
- **6.2.2** Connection of Gas Engine-Powered Air Conditioners: To protect against the effects of normal vibration in service, gas engines shall not be rigidly connected to the gas supply piping.

6.2.3 Clearances for Indoor Installation:

- a. Listed air conditioning equipment installed in rooms which are large in comparison with the size of the equipment shall be installed with clearances not less than those specified in Line I of Table V except as provided in "1," "2," and "3" below.
 - 1. Air conditioning equipment listed for installation at lesser clearances than those specified in Table V may be installed in accordance with its listing and the manufacturer's instructions
 - 2. Air conditioning equipment listed for installation at greater clearances than those specified in Table V shall be installed

in accordance with its listing and the manufacturer's instructions unless protected as specified in "3."

- 3. Air conditioning equipment installed in rooms large in comparison with the size of the equipment may be installed with reduced clearances to combustible material provided the combustible material or the equipment is protected as described in Table VI.
- b. Air conditioning equipment installed in spaces such as alcoves and closets shall be specifically listed for such installation and installed in accordance with the terms of its listing. The installation clearances for air conditioning equipment in rooms not large in comparison with the size of equipment shall be as specified in the listing, regardless of whether the enclosure is of combustible or noncombustible material, and shall not be reduced by the protection methods described in Table VI.
- c. Unlisted air conditioning equipment shall be installed with clearances from combustible material of not less than 18 inches above the equipment and at the sides, front, and rear, and 9 inches from the draft hood.
- d. When the plenum for an air conditioner which includes provisions for heating air is adjacent to combustible material, the clearance shall be measured to the surface of the plaster or other noncombustible finish when the clearance specified is 2 inches or less.
- **e.** The clearance to this equipment shall not interfere with combustion air, draft hood clearance and relief, and accessibility for servicing. (See 5.2.1, 5.3, and 7.12.8.)
- **6.2.4** Erection and Mounting: Air conditioning equipment shall be erected in accordance with the manufacturer's instructions. Unless the equipment is listed for installation on a combustible surface such as a floor or roof, or unless the surface is protected in an approved manner, it shall be installed on a surface of noncombustible construction with noncombustible material and surface finish and with no combustible material against the underside thereof.
- **6.2.5 Plenums and Air Ducts:** A plenum supplied as a part of the air conditioning equipment shall be installed in accordance with the manufacturer's instructions. When a plenum is not supplied with the equipment, any fabrication and installation instructions provided by the manufacturer shall be followed. The method of connecting supply and return ducts shall facilitate proper circulation of air. (Reference may be made to the Standard for the Installation of Air Conditioning and

Ventilating Systems, ANSI/NFPA 90A, or the Standard for the Installation of Warm Air Heating and Air Conditioning Systems, ANSI/NFPA 90B.)

When the air conditioner is installed within a room not large in comparison with the size of the equipment, the air circulated by the equipment shall be handled by ducts which are sealed to the casing of the equipment and which separate the circulating air from the combustion and ventilation air.

6.2.6 Refrigeration Coils: (See 6.3.7 and 6.3.8.)

6.2.7 Switches in Electrical Supply Line: Means for interrupting the electrical supply to the air conditioning equipment and to its associated cooling tower (if supplied and installed in a location remote from the air conditioner) shall be provided within sight of and not over 50 feet from the air conditioner and cooling tower.

6.3 Central Heating Boilers and Furnaces.

6.3.1 Clearance:

- a. Central heating boilers and furnaces installed in rooms large in comparison with the size of the equipment shall be installed with clearances not less than specified in Table V except as provided in "1" and "2" below.
 - 1. Central heating furnaces and boilers listed for installation at lesser clearances than specified in Table V may be installed in accordance with their listing and the manufacturer's instructions.
 - 2. Central heating furnaces and boilers installed in rooms large in comparison with the size of the equipment may be installed with reduced clearances to combustible material provided the combustible material or the equipment is protected as described in Table VI.
- b. Central heating furnaces and boilers installed in spaces such as alcoves and closets shall be specifically listed for such installation and installed in accordance with the terms of listing. The installation clearances for furnaces and boilers in rooms not large in comparison with the size of the equipment shall be as specified in the listing, regardless of whether the enclosure is of combustible or noncombustible material, and shall not be reduced by the protection methods described in Table VI.

Table V

Clearances to Combustible Material for Furnaces and Boilers
Installed in Rooms Which Are Large in Comparison With Size of
Equipment, Except as Provided in 6.3.1-a (See Note 9)

	Minimum Clearance, Inches							
	Above and Sides of Plenum	Jacket Sides and Rear	Front (See Note 1)	Draft Hood and Barometric Draft Regulator	Vent Connector (See Note 2)			
I. Listed automatically fired, forced air or gravity system, with 250 F temperature limit control.	(See Notes 3 and 4)	6	18	6	6 (See Note 10)			
II. Unlisted automatically fired, forced air or gravity system, equipped with temperature limit control which cannot be set higher than 250 F.	6 (See Note 5)	6	18	18 (See Note 6)	18 (See Note 6)			
III. Listed Automatically Fired Heating Boilers— Steam boilers operating at not over 15 psi gage pressure and hot water boilers operating at not in excess of 250 F.	6 (See Note 7)	6	18	6	6 (See Note 10)			
IV. Unlisted Automatically Fired Heating Boilers-Steam boilers operating at not over 15 psi gage pressure and hot water boilers operating at not in excess of 250 F.	6 (See Note 7)	6	18	18 (See Note 6)	18 (See Note 6)			
V. Central heating boilers and furnaces, other than above.	18 (See Note 8)	18	18	18 (See Note 6)	18 (See Note 6)			

NOTES APPLICABLE TO TABLE V

- Front clearance shall be sufficient for servicing the burner and furnace or boiler.
- 2. The vent connector clearance does not apply to listed Type B gas vents.
- 3. This clearance may be reduced to 1 inch for a listed forced air or gravity furnace equipped with:
 - a. A limit control that cannot be set higher than 200 F, or
 - b. A marking to indicate that the outlet air temperature cannot exceed 200 F.
- 4. Clearance from supply ducts within 3 feet of the plenum shall not be less than that specified from the plenum. No clearance is necessary beyond this distance.
- 5. Clearance from supply ducts within 6 feet of the plenum shall not be less than 6 inches. No clearance is necessary beyond this distance.
- 6. For unlisted gas utilization equipment equipped with an approved draft hood, this clearance may be reduced to 9 inches.
- 7. This clearance is above top of boiler.
- 8. Clearance from supply ducts shall not be less than 18 inches out to 3 feet from the plenum, not less than 6 inches from 3 feet to 6 feet, and not less than 1 inch beyond 6 feet.
- 9. Rooms which are large in comparison with the size of the equipment are rooms having a volume equal to at least 12 times the total volume of an air conditioning appliance or furnace and at least 16 times the total volume of a boiler or water heater. Total volume of an appliance is determined from exterior dimensions and is to include fan compartments and burner vestibules, when used. When the actual ceiling height of a room is greater than 8 feet, the volume of a room shall be figured on the basis of a ceiling height of 8 feet.
- 10. These clearances shall apply unless the listing of an appliance specifies different clearances, in which case the listed clearances shall apply.


Table VI
Reduction of Clearances with Specified Forms of Protection

Type of protection applied to and covering all surfaces of combustible material within the distance specified as the required clearance with no protection (See Figures 6, 7, and 8)	Where the required clearance with no protection from appliance, vent connector, or single wall metal pipe is:									
	36 in	ches	18 in	ches	t2 in	ches	9	inches	6 in	ches
	Allowable Clearances with Specified Protection, inches									
	Above	Sides and Rear	Above	Sides and Rear	Above	Sides and Rear	Above	Sides and Rear	Above	Sides and Rear
(a) 3½ in. thick masonry wall without ventilated air space	_	24	_	12		9	_	6	_	5
(b) ½ in. insulation board over 1 in. glass fiber or mineral wool batts	24	18	12	9	9	6	6	5	4	3
(c) 0.024 (24 gauge) sheet metal over 1 in, glass fiber or mineral wool batts reinforced with wire on rear face with ventilated air space	18	12	9	6	6	4	5	3	3	3
(d) $3\frac{1}{2}$ in, thick masonry wall with ventilated air space		12		6	_	6	_	6	_	6
(e) 0.024 (24 gauge) sheet metal with ventilated air space	18	12	9	6	6	4	5	3	3	2
(f) $\frac{1}{2}$ in, thick insulation board with ventilated air space	18	12	9	6	6	4	5	3	3	3
(g) 0.024 (24 gauge) sheet metal with ventilated air space over 0.024 (24 gauge) sheet metal with ventilated air space	18	12	9	6	6	4	5	3	3	3
(h) 1 in, glass fiber or mineral wool batts sandwiched between two sheets 0.024 (24 gauge) sheet metal with ventilated air space.	18	12	9	6	6	4	5	3	3	3

NOTES APPLICABLE TO TABLE VI

- Reduction of clearances from combustible materials shall not interfere with combustion air, draft hood clearance and relief, and accessibility of servicing.
- 2. All clearances shall be measured from the outer surface of the combustible material to the nearest point on the surface of the appliance, disregarding any intervening protection applied to the combustible material.
- 3. Spacers and ties shall be of noncombustible material. No spacer or tie shall be used directly opposite appliance or connector.
- 4. With all clearance reduction systems using a ventilated air space, adequate provision for air circulation shall be provided as described. (See Figures 7 and 8.)
- There shall be at least 1 inch between clearance reduction system and combustible walls and ceilings for reduction systems using ventilated air space.
- 6. If a wall protector is mounted on a single flat wall away from corners, adequate air circulation may be provided by leaving only the bottom and top edges or only the side and top edges open with at least 1 inch air gap.
- Mineral wool batts (blanket or board) shall have a minimum density of 8 lb/ft³ and a minimum melting point of 1500 F.
- 8. Insulation material used as part of clearance reduction system shall have a thermal conductivity of 1.0 (Btu-in)/(sq ft-hr-F) or less.
- 9. There shall be at least 1 in. between the appliance and the protector. In no case shall the clearance between the appliance and the combustible surface be reduced below that allowed in the table.
- All clearances and thicknesses are minimum; larger clearances and thicknesses are acceptable.


- c. When the plenum is adjacent to plaster on metal lath or noncombustible material attached to combustible material, the clearance shall be measured to the surface of the plaster or other noncombustible finish when the clearance specified is 2 inches or less.
- **d.** The clearance to this equipment shall not interfere with combustion air, draft hood clearance and relief, and accessibility for servicing. (See 5.2.1. 5.3. and 7.12.8.)
- **6.3.2** Erection and Mounting: A central heating boiler or furnace shall be erected in accordance with the manufacturer's instructions and shall be installed on a floor of noncombustible construction with noncombustible flooring and surface finish and with no combustible material against the underside thereof or on fire-resistive slabs or arches having no combustible material against the underside thereof, unless listed for installation on a combustible floor or the floor is protected in an approved manner.

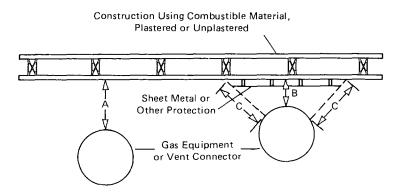

[&]quot;A" equals the clearance with no protection specified in Tables V and IX and in the sections applying to various types of equipment.

Figure 6. Extent of Protection Necessary to Reduce Clearances from Gas Equipment or Vent Connectors.

[&]quot;B" equals the reduced clearance permitted in accordance with Table VI. The protection applied to the construction using combustible material shall extend far enough in each direction to make "C" equal to "A".

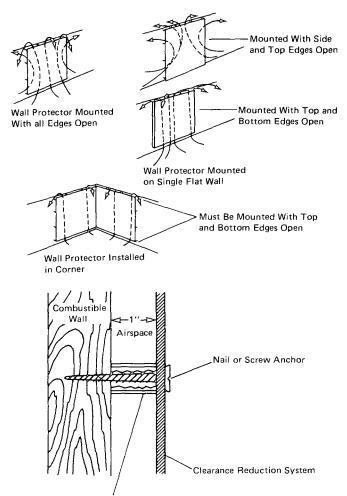

1" Noncombustible Spacer Such as Stacked Washers, Small Diameter Pipe, Tubing, or Electrical Conduit.

Masonry Walls May be Attached to Combustible Walls Using Wall Ties.

Do Not Use Spacers Directly Behind Appliance or Connector.

Figure 7. Wall Protector Clearance Reduction System.

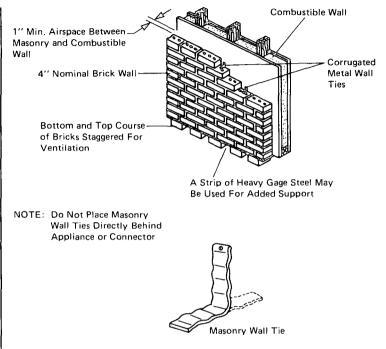


Figure 8. Masonry Clearance Reduction System.

6.3.3 Temperature or Pressure Limiting Devices: Steam and hot water boilers, respectively, shall be provided with approved automatic limiting devices for shutting down the burner(s) to prevent boiler steam pressure or boiler water temperature from exceeding the maximum allowable working pressure or temperature.

Safety limit controls shall not be used as operating controls.

- **6.3.4** Low Water Cutoff: Hot water boilers installed above the radiation level and all steam boilers shall be provided with an automatic means to shut off the fuel supply to the burner(s) if the boiler water level drops to the lowest safe water line.
- **6.3.5** Steam Safety and Pressure Relief Valves: Steam and hot water boilers shall be equipped, respectively, with listed or approved steam

safety or pressure relief valves of appropriate discharge capacity and conforming with ASME requirements.† A shutoff valve shall not be placed between the relief valve and the boiler, or on discharge pipes between such valves and the atmosphere.

6.3.6 Plenums and Air Ducts:

- a. Plenums and air ducts shall be installed in accordance with the Standard for the Installation of Air Conditioning and Ventilating Systems, ANSI/NFPA 90A, or the Standard for the Installation of Warm Air Heating and Air Conditioning Systems, ANSI/NFPA 90B.
- **b.** A plenum supplied as a part of a furnace shall be installed in accordance with the manufacturer's instructions.
- c. When a plenum is not supplied with the furnace, any fabrication and installation instructions provided by the manufacturer shall be followed. The method of connecting supply and return ducts shall facilitate proper circulation of air. (Reference may be made to the Standard for the Installation of Air Conditioning and Ventilating Systems, ANSI/NFPA 90A and to the Standard for the Installation of Warm Air Heating and Air Conditioning Systems, ANSI/NFPA 90B.)
- d. When a furnace is installed so supply ducts carry air circulated by the furnace to areas outside the space containing the furnace, the return air shall also be handled by a duct(s) sealed to the furnace casing and terminating outside the space containing the furnace.

6.3.7 Refrigeration Coils:

- a. A refrigeration coil shall not be installed in conjunction with a forced air furnace when circulation of cooled air is provided by the furnace blower, unless the blower has sufficient capacity to overcome the external static resistance imposed by the duct system and cooling coil at the air throughput necessary for heating or cooling, whichever is greater.
- b. Furnaces shall not be located upstream from cooling units, unless the cooling unit is designed or equipped so as not to develop excessive temperature or pressure.
- c. Refrigeration coils shall be installed in parallel with or on the downstream side of central furnaces to avoid condensation in the

[†]For details of requirements on low pressure heating boiler safety devices refer to ANSI/ASME Boiler and Pressure Vessel Code, 1986 Edition, Low Pressure Heating Boilers. Section IV

heating element, unless the furnace has been specifically listed for downstream installation. With a parallel flow arrangement, the dampers or other means used to control flow of air shall be sufficiently tight to prevent any circulation of cooled air through the furnace.

d. Means shall be provided for disposal of condensate and to prevent dripping of condensate on the heating element.

6.3.8 Cooling Units Used with Heating Boilers:

- a. Boilers, when used in conjunction with refrigeration systems, shall be installed so that the chilled medium is piped in parallel with the heating boiler with appropriate valves to prevent the chilled medium from entering the heating boiler.
- b. When hot water heating boilers are connected to heating coils located in air handling units where they may be exposed to refrigerated air circulation, such boiler piping systems shall be equipped with flow control valves or other automatic means to prevent gravity circulation of the boiler water during the cooling cycle.

6.4 Clothes Dryers.

6.4.1 Clearance:

- a. Listed Type 1 clothes dryers shall be installed with a minimum clearance of 6 inches from adjacent combustible material, except that clothes dryers listed for installation at lesser clearances may be installed in accordance with their listing. Type 1 clothes dryers installed in closets shall be specifically listed for such installation.
- b. Listed Type 2 clothes dryers shall be installed with clearances of not less than shown on the marking plate and in the manufacturer's instructions. Type 2 clothes dryers designed and marked "For use only in noncombustible locations" shall not be installed elsewhere
- c. Unlisted clothes dryers shall be installed with clearances to combustible material of not less than 18 inches. Combustible floors under unlisted clothes dryers shall be protected in an approved manner.

6.4.2 Exhausting to the Outside Air:

a. Type I clothes dryers installed in closets shall be exhausted to the outside air, and no other fuel-burning appliance shall be installed in the same closet. Type 1 clothes dryers shall not be installed in bathrooms or bedrooms unless exhausted to the outside air.

b. Type 2 clothes dryers shall be exhausted to the outside air.

6.4.3 Provisions for Make-Up Air:

- a. When a Type 1 clothes dryer is exhausted to the outside, consideration shall be given to provision for make-up air. (See 5.3.6.) Provision for make-up air shall be provided for closet installed Type 1 clothes dryers in accordance with the manufacturer's installation instructions.
- **b.** Provision for make-up air shall be provided for Type 2 clothes dryers, with a minimum free area (*see* 5.3.5) of one square inch for each 1,000 Btu per hour total input rating of the dryer(s) installed.

6.4.4 Exhaust Ducts for Type 1 Clothes Dryers:

- a. A clothes dryer exhaust duct shall not be connected into any vent connector, gas vent, chimney, crawl space, attic. or other similar concealed space.
- **b.** Ducts for exhausting clothes dryers shall not be put together with sheet-metal screws or other fastening means which extend into the duct and which would catch lint and reduce the efficiency of the exhaust system.

6.4.5 Exhaust Ducts for Type 2 Clothes Dryers:

- **a.** Exhaust ducts for Type 2 clothes dryers shall comply with 6.4.4.
- b. Exhaust ducts for Type 2 clothes dryers shall be constructed of sheet metal or other noncombustible material. Such ducts shall be equivalent in strength and corrosion resistance to ducts made of galvanized sheet steel not less than 0.0195 inch thick.†
- c. Type 2 clothes dryers shall be equipped or installed with lint controlling means.
- d. Exhaust ducts for Type 2 clothes dryers shall have a clearance of at least 6 inches to combustible material except as provided in "e."

[†]This corresponds to No. 24 U.S. Standard gage sheet steel with all applicable minus tolerances included.

- e. Exhaust ducts for Type 2 clothes dryers may be installed with reduced clearances to combustible material provided the combustible material is protected as described in Table VI.
- f. When ducts pass through walls, floors, or partitions, the space around the duct shall be sealed with noncombustible material.
- g. Multiple installations of Type 2 clothes dryers shall be made in a manner to prevent adverse operation due to back pressures that might be created in the exhaust systems.
- **6.4.6** Multiple Family or Public Use: All clothes dryers installed for multiple family or public use shall be equipped with approved safety shutoff devices and shall be installed as specified for a Type 2 clothes dryer under 6.4.5.

6.5 Conversion Burners.

Installation of conversion burners shall conform to the Standard for Installation of Domestic Gas Conversion Burners, ANSI Z21.8.

- 6.6 Decorative Appliances for Installation in Vented Fireplaces.
- **6.6.1 Prohibited Installations:** Decorative appliances for installation in vented fireplaces shall not be installed in bathrooms or bedrooms.
 - **6.6.2 Installation:** A decorative appliance for installation in a vented fireplace shall be installed only in a vented fireplace having a working chimney flue and constructed of noncombustible materials. These appliances shall not be thermostatically controlled.
 - a. A listed decorative appliance for installation in a vented fireplace shall be installed in accordance with its listing and the manufacturer's instructions
 - **b.** An unlisted decorative appliance for installation in a vented fireplace shall be installed in a fireplace having a permanent free opening, based on appliance input rating and chimney height, equal to or greater than that specified in Table VII.
- **6.6.3** Fireplace Screens: A fireplace screen shall be installed with a decorative appliance for installation in a vented fireplace in order to provide protection from inadvertent contact with the appliance.

Table VII

Free Opening Area of Chimney Damper for Venting Flue Gases from Unlisted Decorative Appliances for Installation in Vented Fireplaces

Minimum Permanent Free Opening, Square Inches*

Chimney Height,	8	13	20	29	39	51	64
Feet	Appliance Input Rating, Btu Per Hour						
6	7,800	14,000	23,200	34,000	46,400	62,400	80,000
8	8,400	15,200	25,200	37,000	50,400	68,000	86,000
10	9,000	16,800	27,600	40,400	55,800	74,400	96,400
15	9,800	18,200	30,200	44,600	62,400	84,000	108,800
20	10,600	20,200	32,600	50,400	68,400	94,000	122,200
30	11,200	21,600	36,600	55,200	76,800	105,800	138,600

The first six minimum permanent free openings (8 to 51 sq. in.) correspond approximately to the cross-sectional areas of chimneys having diameters of 3 through 8 inches, respectively. The 64 sq. in. opening corresponds to the cross-sectional area of standard 8 in. × 8 in. chimney tile.

6.7 Decorative Appliances, Vented.

6.7.1 Prohibited Installations: Unlisted vented decorative appliances shall not be installed in bathrooms or bedrooms.

6.7.2 Installation:

- a. Listed vented decorative appliances shall be installed in accordance with their listing and the manufacturer's instructions. They may be installed in or attached to combustible material when so listed.
- b. Unlisted vented decorative appliances shall not be installed in or attached to combustible material. They shall have a clearance at the sides and rear of not less than 18 inches, except that appliances which make use of metal, asbestos, or ceramic material to direct radiation to the front of the appliance shall have a clearance of 36 inches in front and, if constructed with a double back of metal or ceramic, may be installed with a clearance of 18 inches at the sides and 12 inches at the rear. Combustible floors under unlisted vented decorative appliances shall be protected in an approved manner. Such unlisted appliances shall be equipped with a draft hood and be properly vented in accordance with Part 7.
- c. Panels, grilles, and access doors which must be removed for normal servicing operations shall not be attached to the building.
- **6.7.3** Combustion and Circulating Air: Adequate combustion and circulating air shall be provided (see 5.3).
- 6.8 Direct Make-Up Air Heaters.
- **6.8.1 Installation:** Direct make-up air heaters shall not be used to supply any area containing sleeping quarters.
- **6.8.2** Clearance from Combustible Material: The clearances specified below shall not interfere with combustion air, accessibility for operation, and servicing.
 - **a.** Listed direct make-up air heaters shall be installed in accordance with their listings and the manufacturer's instructions.
 - **b.** Unlisted direct make-up air heaters shall be installed with clearances to combustible material of not less than 18 inches. Combustible floors under unlisted floor-mounted heaters shall be protected in an approved manner.

- **6.8.3** Outside Air: All air handled by a direct make-up air heater, including combustion air, shall be brought in from outdoors. Indoor air may be added to the outdoor air stream after the outdoor air stream has passed the combustion zone.
- **6.8.4** Outside Louvers: If outside louvers of either the manual or automatic type are used, they shall be proved in the open position before the main burners can operate.

6.8.5 Controls:

- a. Listed direct make-up air heaters shall be equipped with air-flow sensing devices, safety shutoff devices, operating temperature controls, and thermally actuated temperature limit controls in accordance with the terms of their listings.
- **b.** Unlisted direct make-up air heaters shall be equipped with:
 - 1. Airflow sensing devices so designed and installed as to shut off the gas to the main burners upon failure of either combustion air or main air supply. (Controls actuated by failure of the power supply to the blower motor do not meet the intent of this provision.)
 - 2. Combustion safeguards, including manual reset safety shutoff devices.
 - 3. Operating temperature controls and thermally actuated manual reset temperature limit controls, the latter of which shall not permit the discharge air temperature to exceed 150 F.
- **6.8.6 Input Ratings:** Unlisted direct make-up air heaters shall have input ratings such that the ratio of gas input by volume to the total volume of gas-air mixture discharged will not exceed 0.2 percent.
- 6.8.7 Atmospheric Vents and Gas Relief or Bleeds: Direct make-up air heaters with enclosed valve trains shall be equipped with both atmospheric vent lines and gas reliefs or bleeds leading outdoors. Means shall be employed on these lines to prevent water from entering and to prevent stoppage by insects and foreign matter. An atmospheric vent line need not be provided on a valve train component equipped with a vent limiter.
- **6.8.8** Exhaust: The design of the installation shall include adequate provision to permit make-up air heaters to operate at rated capacity by providing properly designed relief openings or an interlocked power exhaust system.

6.8.9 Purging: The blower of an unlisted direct make-up heater and the exhaust system shall be operated to effect at least four air changes of the combustion chamber before the gas to the main burners is ignited.

6.9 Duct Furnaces.

6.9.1 Clearances:

- a. Listed duct furnaces shall be installed with clearances of at least 6 inches between adjacent walls, ceilings, and floors of combustible material and the furnace draft hood, except that furnaces listed for installation at lesser clearances may be installed in accordance with their listings. In no case shall the clearance be such as to interfere with combustion air and accessibility. (See 5.2.1 and 5.3.)
- b. Unlisted duct furnaces shall be installed with clearances to combustible material in accordance with the clearances specified for unlisted furnaces and boilers in Table V. Combustible floors under unlisted duct furnaces shall be protected in an approved manner.
- **6.9.2** Erection of Equipment: Duct furnaces shall be erected and firmly supported in accordance with the manufacturer's instructions.
- **6.9.3** Access Panels: The ducts connected to duct furnaces shall have removable access panels on both the upstream and downstream sides of the furnace.
- **6.9.4** Location of Draft Hood and Controls: The controls, combustion air inlet, and draft hoods for duct furnaces shall be located outside the ducts. The draft hood shall be located in the same enclosure from which combustion air is taken.
- **6.9.5** Circulating Air: When a duct furnace is installed so that supply ducts carry air circulated by the furnace to areas outside the space containing the furnace, the return air shall also be handled by a duct(s) sealed to the furnace casing and terminating outside the space containing the furnace.

If the duct furnace is connected to a return air duct or any other inlet air restriction, the furnace shall be installed on the positive pressure side of the circulating air blower.

6.9.6 Duct Furnaces Used with Refrigeration Systems:

a. A duct furnace shall not be installed in conjunction with a refrigeration coil when circulation of cooled air is provided by the blower, unless the blower has sufficient capacity to overcome the

external static resistance imposed by the duct system, furnace, and the cooling coil at the air throughput necessary for heating or cooling, whichever is greater.

- b. To avoid condensation within heating elements, duct furnaces used in conjunction with cooling equipment shall be installed in parallel with or on the upstream side of cooling coils, unless the duct furnace has been specifically listed for downstream installation. With a parallel flow arrangement, the dampers or other means used to control the flow of air shall be sufficiently tight to prevent any circulation of cooled air through the unit.
- c. When duct furnaces are to be located upstream from cooling units, the cooling unit shall be so designed or equipped as to not develop excessive temperatures or pressures.
- d. Duct furnaces may be installed downstream from evaporative coolers or air washers if the heating element is made of corrosion-resistant material. Stainless steel, ceramic-coated steel, or an aluminum-coated steel in which the bond between the steel and the aluminum is an iron-aluminum alloy, are considered to be corrosion-resistant. Air washers operating with chilled water which delivers air below the dew point of the ambient air at the equipment are considered as refrigeration systems.
- **6.9.7** Installation in Commercial Garages and Aircraft Hangars: Duct furnaces installed in garages for more than three motor vehicles or in aircraft hangars shall be of a listed type and shall be installed in accordance with 5.1.11 and 5.1.12.

6.10 Floor Furnaces.

6.10.1 Installation:

- a. Listed floor furnaces shall be installed in accordance with their listing and the manufacturer's instructions. They may be installed in combustible floors.
- **b.** Unlisted floor furnaces shall not be installed in combustible floors.
- c. Thermostats controlling floor furnaces shall not be located in a room or space which can be separated from the room or space in which the register of the floor furnace is located.

6.10.2 Temperature Limit Controls:

a. Listed automatically operated floor furnaces shall be equipped with temperature limit controls in accordance with the terms of their listing.

- **b.** Unlisted automatically operated floor furnaces shall be equipped with a temperature limit control arranged to shut off the flow of gas to the burner in the event the temperature at the warm air outlet register exceeds 350 F above room temperature.
- **6.10.3** Combustion and Circulating Air: Adequate combustion and circulating air shall be provided (see 5.3).
- **6.10.4 Placement:** The following provisions apply to furnaces that serve one story.
 - **a. Floors:** Floor furnaces shall not be installed in the floor of any doorway, stairway landing, aisle, or passageway of any enclosure, public or private, or in an exitway from any such room or space.
 - b. Walls and Corners: The register of a floor furnace with a horizontal warm air outlet shall not be placed closer than 6 inches to the nearest wall. A distance of at least 18 inches from two adjoining sides of the floor furnace register to walls shall be provided to eliminate the necessity of occupants walking over the warm air discharge. The remaining sides may be placed not closer than 6 inches to a wall. Wall-register models shall not be placed closer than 6 inches to a corner.
 - **c. Draperies:** The furnace shall be placed so that a door, drapery, or similar object cannot be nearer than 12 inches to any portion of the register of the furnace.
- **6.10.5** Bracing: The space provided for the furnace shall be framed with doubled joists and with headers not lighter than the joists.
- **6.10.6** Support: Means shall be provided to support the furnace when the floor register is removed.
- **6.10.7** Clearance: The lowest portion of the floor furnace shall have at least a 6-inch clearance from the general ground level, except that when the lower 6-inch portion of the floor furnace is sealed by the manufacturer to prevent entrance of water, the clearance may be reduced to not less than 2 inches. When these clearances are not present, the ground below and to the sides shall be excavated to form a "basin-like" pit under the furnace so that the required clearance is provided beneath the lowest portion of the furnace. A 12-inch clearance shall be provided on all sides except the control side, which shall have an 18-inch clearance.
- **6.10.8** Access: The space in which any floor furnace is installed shall be accessible by an opening in the foundation not less than 24 by 18

inches, or a trap door not less than 24 by 24 inches in any cross section thereof, and a passageway not less than 24 by 18 inches in any cross section thereof.

- **6.10.9** Seepage Pan: When the excavation exceeds 12 inches in depth or water seepage is likely to collect, a watertight copper pan, concrete pit, or other suitable material shall be used, unless adequate drainage is provided or the equipment is sealed by the manufacturer to meet this condition. A copper pan shall be made of not less than 16-ounce-persquare-foot sheet copper. The pan shall be anchored in place so as to prevent floating, and the walls shall extend at least 4 inches above the ground level with at least 6 inches clearance on all sides, except the control side which shall have at least 18 inches clearance.
- **6.10.10** Wind Protection: Floor furnaces shall be protected, where necessary, against severe wind conditions.
- **6.10.11 Upper Floor Installations:** Listed floor furnaces may be installed in an upper floor, provided the furnace assembly projects below into a utility room, closet, garage, or similar nonhabitable space. In such installations, the floor furnace shall be enclosed completely (entirely separated from the nonhabitable space) with means for air intake to meet the provisions of 5.3, with access for servicing, the minimum furnace clearances of 6 inches to all sides and bottom, and with the enclosure constructed of portland cement plaster or metal lath or other noncombustible material.
- **6.10.12** First Floor Installation: Listed floor furnaces installed in the first or ground floors of buildings need not be enclosed unless the basements of these buildings have been converted to apartments or sleeping quarters, in which case the floor furnace shall be enclosed as specified for upper floor installations and shall project into a nonhabitable space.
- 6.11 Food Service (Commercial Cooking) Equipment, Floor Mounted.
- 6.11.1 Clearance for Listed Equipment: Listed floor-mounted food service equipment, such as ranges for hotels and restaurants, deep fat fryers, unit broilers, gas-fired kettles, steam cookers, steam generators, and baking and roasting ovens, shall be installed at least 6 inches from combustible material except that at least a 2-inch clearance shall be maintained between a draft hood and combustible material. Floor-mounted food service equipment listed for installation at lesser clearances may be installed in accordance with its listing and the manufac-

turer's instructions. Equipment designed and marked "For use only in noncombustible locations" shall not be installed elsewhere.

6.11.2 Clearance for Unlisted Equipment:

- a. Unlisted floor-mounted food service equipment, except as provided in "b" and "c" below, shall be installed to provide a clearance to combustible material of not less than 18 inches at the sides and rear of the equipment and from the vent connector and not less than 48 inches above cooking tops and at the front of the equipment.
- b. Unlisted floor-mounted food service equipment may be installed in rooms, but not in partially enclosed areas such as alcoves, with reduced clearances to combustible material, provided the combustible material or the equipment is protected as described in Table VI.
- c. Unlisted floor-mounted food service equipment may be installed in rooms, but not in partially enclosed areas such as alcoves, with reduced clearance of 6 inches to combustible material, provided the wall or combustible material is protected by sheet metal not less than 0.0152 inch thick,* fastened with noncombustible spacers that are spaced at not less than 2-foot vertical and horizontal intervals to provide a clearance of 1½ inches from such wall or material. Such protection shall extend at least 12 inches beyond the back, side, top, or any other part of the equipment and the space between the sheet metal and wall or combustible material shall be open on both sides and top and bottom to permit circulation of air.

6.11.3 Mounting On Combustible Floor:

- a. Listed floor-mounted food service equipment that is listed specifically for installation on floors constructed of combustible material may be mounted on combustible floors in accordance with its listing.
- b. Listed floor-mounted food service equipment that is designed and marked "For use only in noncombustible locations" shall be mounted on floors of noncombustible construction with noncombustible flooring and surface finish and with no combustible material against the underside thereof, or on noncombustible slabs

^{*}This corresponds to No. 26 U.S. Standard gage sheet steel with all applicable minus tolerances included.

or arches having no combustible material against the underside thereof. Such construction shall in all cases extend not less than 12 inches beyond the equipment on all sides.

- c. Floor-mounted food service equipment which is not listed for mounting on a combustible floor shall be mounted in accordance with "b" above or be mounted in accordance with one of the following:
 - 1. When the equipment is set on legs which provide not less than 18 inches open space under the base of the equipment, or where it has no burners and no portion of any oven or broiler within 18 inches of the floor, it may be mounted on a combustible floor without special floor protection, provided there is at least one sheet metal baffle between the burner and the floor.
 - 2. When the equipment is set on legs which provide not less than 8 inches open space under the base of the equipment, it may be mounted on combustible floors, provided the floor under the equipment is protected with not less than 3/8-inch insulating millboard covered with sheet metal not less than 0.0195 inch thick.† The above specified floor protection shall extend not less than 6 inches beyond the equipment on all sides.
 - 3. When the equipment is set on legs which provide not less than 4 inches under the base of the equipment, it may be mounted on combustible floors, provided the floor under the equipment is protected with hollow masonry not less than 4 inches in thickness covered with sheet metal not less than 0.0195 inch thick.† Such masonry courses shall be laid with ends unsealed and joints matched in such a way as to provide for free circulation of air through the masonry.
 - 4. When the equipment does not have legs at least 4 inches high, it may be mounted on combustible floors, provided the floor under the equipment is protected by two courses of 4-inch hollow clay tile, or equivalent, with courses laid at right angles and with ends unsealed and joints matched in such a way as to provide for free circulation of air through such masonry courses and covered with steel plate not less than 3/16 inch in thickness.

[†]This corresponds to No. 24 U.S. Standard gage sheet steel with all applicable minus tolerances included.

- **6.11.4** Combustible Material Adjacent to Cooking Top: Any portion of combustible material adjacent to a cooking top section of a food service range, even though listed for close-to-wall installation, which is not shielded from the wall by a high shelf, warming closet, etc., shall be protected as specified in 6.11.2 for a distance of at least 2 feet above the surface of the cooking top.
- **6.11.5** For Use With Casters: Floor-mounted equipment with casters shall be listed for such construction and shall be installed in accordance with their listing and the accompanying instructions for limiting the movement of the equipment to prevent strain on the connection.
- **6.11.6** Install Level: Floor-mounted food service equipment shall be installed level on a firm foundation.
- **6.11.7 Ventilation:** Adequate means shall be provided to properly ventilate the space in which food service equipment is installed to permit proper combustion of the gas. When exhaust fans are used for ventilation, special precautions may be necessary to avoid interference with the operation of the equipment.
- 6.12 Food Service Equipment (Commercial) Counter Appliances.
- **6.12.1 Vertical Clearance:** A vertical distance of not less than 48 inches shall be provided between the top of all food service hot plates and griddles and combustible material.
- **6.12.2** Clearance for Listed Appliances: Listed food service counter appliances such as hot plates and griddles, food and dish warmers, and coffee brewers and urns, when installed on combustible surfaces, shall be set on their own bases or legs and shall be installed with a minimum horizontal clearance of 6 inches from combustible material, except that at least a 2-inch clearance shall be maintained between a draft hood and combustible material. Food service counter appliances listed for installation at lesser clearances may be installed in accordance with their listing and the manufacturer's instructions.
- **6.12.3** Clearance for Unlisted Appliances: Unlisted food service hot plates and griddles shall be installed with a horizontal clearance from combustible material of not less than 18 inches. Unlisted gas food service counter appliances such as coffee brewers and urns, waffle bakers, and hot water immersion sterilizers shall be installed with a horizontal clearance from combustible material of not less than 12 inches. Gas food service counter appliances may be installed with

reduced clearances to combustible material provided as described in Table VI. Unlisted food and dish warmers shall be installed with a horizontal clearance from combustible material of not less than 6 inches.

6.12.4 Mounting of Unlisted Appliances: Unlisted food service counter appliances shall not be set on combustible material unless they have legs which provide not less than 4 inches of open space below the burners, and the combustible surface is protected with insulating millboard at least ½ inch thick covered with sheet metal not less than 0.0122† inch thick, or with equivalent protection.

6.13 Hot Plates and Laundry Stoves.

- a. Listed domestic hot plates and laundry stoves installed on combustible surfaces shall be set on their own legs or bases. They shall be installed with minimum horizontal clearances of 6 inches from combustible material.
- b. Unlisted domestic hot plates and laundry stoves shall be installed with horizontal clearances to combustible material of not less than 12 inches. Combustible surfaces under unlisted domestic hot plates and laundry stoves shall be protected in an approved manner.
- c. The vertical distance between tops of all domestic hot plates and laundry stoves and combustible material shall be at least 30 inches.

6.14 Household Cooking Appliances.

6.14.1 Floor-Mounted Units:

- a. Clearance from Combustible Material: The clearances specified below shall not interfere with combustion air, accessibility for operation, and servicing.
 - 1. Listed floor-mounted household cooking appliances, except as noted in "2" and "3" below, when installed on combustible floors, shall be set on their own bases or legs and shall be installed in accordance with their listing and the manufacturer's instructions.
 - 2. Listed household cooking appliances with listed gas room heater sections shall be installed so that the warm air discharge

[†]This corresponds to No. 28 U.S. Standard gage sheet steel with all applicable minus tolerances included

side shall have a minimum clearance of 18 inches from adjacent combustible material. A minimum clearance of 36 inches shall be provided between the top of the heater section and the bottom of cabinets.

- 3. Household cooking appliances which include a solid or liquid fuel burning section shall be spaced from combustible material and otherwise installed in accordance with the standards applying to the supplementary fuel section of the appliance.
- 4. Unlisted floor-mounted household cooking appliances shall be installed with at least 6-inch clearance at the back and sides to combustible material. Combustible floors under unlisted appliances shall be protected in an approved manner.
- b. Vertical Clearance Above Cooking Top: Household cooking appliances shall have a vertical clearance above the cooking top of not less than 30 inches to combustible material or metal cabinets, except the clearance may be reduced to not less than 24 inches as follows:
 - 1. The underside of the combustible material or metal cabinet above the cooking top is protected with not less than \(\frac{1}{4}\)-inch insulating millboard covered with sheet metal not less than 0.0122 inch thick,* or
 - 2. A metal ventilating hood of sheet metal not less than 0.0122 inch thick* is installed above the cooking top with a clearance of not less than ¼ inch between the hood and the underside of the combustible material or metal cabinet, and the hood is at least as wide as the appliance and is centered over the appliance.
- c. Install Level: Cooking appliances shall be installed so that the cooking top or oven racks are level.

6.14.2 Built-In Units:

a. Installation: Listed built-in household cooking appliances shall be installed in accordance with their listing and the manufacturer's instructions. Listed built-in household cooking appliances may be installed in combustible material unless otherwise marked.

The installation shall not interfere with combustion air, accessibility for operation, and servicing.

^{&#}x27;This corresponds to No. 28 U.S. Standard gage sheet steel with all applicable minus tolerances included.

Unlisted built-in household cooking appliances shall not be installed in, or adjacent to, combustible material.

- b. Vertical Clearance: Built-in top (or surface) cooking appliances shall have a vertical clearance above the cooking top of not less than 30 inches to combustible material or metal cabinets, except the clearance may be reduced to not less than 24 inches as follows:
 - 1. The underside of the combustible material or metal cabinet above the cooking top is protected with not less than ¼-inch insulating millboard covered with sheet metal not less than 0.0122 inch thick* or,
 - 2. A metal ventilating hood of sheet metal not less than 0.0122 inch thick* is installed above the cooking top with a clearance of not less than ¼ inch between the hood and the underside of the combustible material or metal cabinet, and the hood is at least as wide as the appliance and is centered over the appliance.
- c. Horizontal Clearance: The minimum horizontal distance from the center of the burner head(s) of a listed top (or surface) cooking appliance to vertical combustible walls extending above the top panel shall be not less than that distance specified by the permanent marking on the appliance.
- **d.** Install Level: Built-in household cooking appliances shall be installed so that the cooking top, broiler pan, or oven racks are level.

6.15 Illuminating Appliances.

6.15.1 Clearances for Listed Appliances: Listed illuminating appliances shall be installed in accordance with their listing and the manufacturer's instructions.

6.15.2 Clearances for Unlisted Appliances:

a. Enclosed Type:

- 1. Unlisted enclosed illuminating appliances installed outdoors shall be installed with clearances in any direction from combustible material of not less than 12 inches.
- 2. Unlisted enclosed illuminating appliances installed in-

^{*}This corresponds to No. 28 U.S. Standard gage sheet steel with all applicable minus tolerances included.

doors shall be installed with clearances in any direction from combustible material of not less than 18 inches.

b. Open-Flame Type:

- 1. Unlisted open-flame illuminating appliances installed outdoors shall have clearances from combustible material not less than that specified in Table VIII. The distance from ground level to the base of the burner shall be at least 7 feet when installed within 2 feet of walkways. Lesser clearances may be used when acceptable to the authority having jurisdiction.
- 2. Unlisted open-flame illuminating appliances installed outdoors shall be equipped with a limiting orifice or other limiting devices which will maintain a flame height consistent with the clearance from combustible material, as given in Table VIII.
- 3. Appliances designed for flame heights in excess of 30 inches may be installed if acceptable to the authority having jurisdiction. Such appliances shall be equipped with a safety shutoff device or automatic ignition.
- 4. Unlisted open-flame illuminating appliances installed indoors shall have clearances from combustible material acceptable to the authority having jurisdiction.

Table VIII

Flame Height Above Burner	Minimum Clearance from Combustible Material, Feet*			
Head, Inches	Horizontal	Vertical		
12	2	6		
18	3	8		
24	3	10		
30	4	12		

^{*} Measured from the nearest portion of the burner head.

- **6.15.3** Mounting on Buildings: Illuminating appliances designed for wall or ceiling mounting shall be securely attached to substantial structures in such a manner that they are not dependent on the gas piping for support.
- **6.15.4** Mounting on Posts: Illuminating appliances designed for post mounting shall be securely and rigidly attached to a post.

Posts shall be rigidly mounted. The strength and rigidity of posts greater than 3 feet in height shall be at least equivalent to that of a 2½-inch-diameter post constructed of 0.064 inch thick* steel or a 1-inch Schedule 40 steel pipe. Posts 3 feet or less in height shall not be smaller than a ¾-inch Schedule 40 steel pipe.

Drain openings should be provided near the base of posts when there is a possibility of water collecting inside them.

6.15.5 Gas Appliance Pressure Regulators: When a gas appliance pressure regulator is not supplied with an illuminating appliance and the service line is not equipped with a service pressure regulator, an appliance pressure regulator shall be installed in the line to the illuminating appliance. For multiple installations, one regulator of adequate capacity may be used to serve a number of illuminating appliances.

6.16 Incinerators, Commercial-Industrial.

Commercial-industrial type incinerators shall be constructed and installed in accordance with the Standard on Incinerators, Waste and Linen Handling Systems and Equipment, ANSI/NFPA 82.

6.17 Incinerators, Domestic.

6.17.1 Clearance:

- a. Listed incinerators shall be installed in accordance with their listing and the manufacturer's instructions, provided that in any case the clearance shall be sufficient to afford ready accessibility for firing, clean-out, and necessary servicing.
- b. The clearances to combustible material above a charging door shall be not less than 48 inches. The clearance may be reduced to 24 inches provided the combustible material is protected with sheet metal not less than 0.0122 inch thick† spaced out 1 inch on noncombustible spacers, or equivalent protection. Such protection shall extend 18 inches beyond all sides of the charging door opening. Listed incinerators designed to retain the flame during loading need not comply with this paragraph.

,

^{*}This corresponds to No. 14 U.S. Standard gage sheet steel with all applicable minus tolerances included.

[†]This corresponds to No. 28 U.S. Standard gage sheet steel with all applicable minus tolerances included.

- c. Unlisted incinerators shall be installed with clearances to combustible material of not less than 36 inches at the sides, top, and back and not less than 48 inches at the front, but in no case shall the clearance above a charging door be less than 48 inches. Unlisted wall-mounted incinerators shall be installed on a noncombustible wall communicating directly with a chimney.
- d. Domestic type incinerators may be installed with reduced clearances to combustible material in rooms, provided the combustible material is protected as described in Table VI. In partially enclosed areas, such as alcoves, clearances shall not be so reduced.
- e. When a domestic type incinerator that is refractory lined or insulated with heat insulating material is encased in common brick not less than 4 inches in thickness, the clearances may be reduced to 6 inches at the sides and rear, and the clearance at the top may be reduced to 24 inches, provided that the construction using combustible material above the charging door and within 48 inches is protected with sheet metal not less than 0.0122 inch thick† spaced out 1 inch, or equivalent protection.

6.17.2 Mounting:

- a. Listed incinerators specifically listed for installation on combustible floors may be so installed.
- b. Unlisted incinerators, except as provided in "c" and "d" below, shall be mounted on the ground or on floors of noncombustible construction with noncombustible flooring or surface finish and with no combustible material against the underside thereof, or on noncombustible slabs or arches having no combustible material against the underside thereof. Such construction shall extend not less than 12 inches beyond the incinerator base on all sides, except at the front or side where ashes are removed, where it shall extend not less than 18 inches beyond the incinerator.
- c. Unlisted incinerators may be mounted on floors other than as specified in "b" above, provided the incinerator is so arranged that flame or hot gases do not come in contact with its base and, further, provided the floor under the incinerator is protected with hollow masonry not less than 4 inches thick, covered with sheet metal not

[†]This corresponds to No. 28 U.S. Standard gage sheet steel with all applicable minus tolerances included.

less than 0.0195 inch thick.* Such masonry course shall be laid with ends unsealed and joints matched in such a way as to provide a free circulation of air from side to side through the masonry. The floor for 18 inches beyond the front of the incinerator or side where ashes are removed and 12 inches beyond all other sides of the incinerator shall be protected with not less than ¼-inch insulating millboard covered with sheet metal not less than 0.0195 inch thick* or with equivalent protection.

- d. Unlisted incinerators which are set on legs that provide not less than 4 inches open space under the base of the incinerator may be mounted on floors other than as specified in "b" above, provided the incinerator is such that flame or hot gases do not come in contact with its base and, further, provided the floor under the incinerator is protected with not less than ½-inch insulating mill-board covered with sheet metal not less than 0.0195 inch thick.* The above specified floor protection shall extend not less than 18 inches beyond the front of the incinerator or side where ashes are removed and 12 inches beyond all other sides of the incinerator.
- **6.17.3** Draft Hood Prohibited: A draft hood shall not be installed in the vent connector of an incinerator.
- **6.17.4 Venting:** Incinerators shall be vented in accordance with 7.4, 7.5, 7.7, and 7.10.

6.18 Infrared Heaters.

6.18.1 Support: Suspended type infrared heaters shall be safely and adequately fixed in position independent of gas and electric supply lines. Hangers and brackets shall be of noncombustible material.

Heaters subject to vibration shall be provided with vibration isolating hangers.

6.18.2 Clearance:

- a. Listed heaters shall be installed with clearances from combustible material in accordance with their listing and the manufacturer's instructions.
- b. Unlisted heaters shall be installed in accordance with clearances from combustible material acceptable to the authority having jurisdiction.

⁴This corresponds to No. 24 U.S. Standard gage sheet steel with all applicable minus tolerances included.

c. In locations used for the storage of combustible materials, signs shall be posted to specify the maximum permissible stacking height to maintain required clearances from the heater to the combustibles.

6.18.3 Combustion and Ventilation Air:

- a. Where unvented infrared heaters are used, natural or mechanical means shall be provided to supply and exhaust at least 4 cfm per 1,000 Btu per hour input of installed heaters.
- **b.** Exhaust openings for removing flue products shall be above the level of the heaters.
- **6.18.4** Installation in Commercial Garages and Aircraft Hangars: Overhead heaters installed in garages for more than three motor vehicles or in aircraft hangars shall be of a listed type and shall be installed in accordance with 5.1.11 and 5.1.12.
- 6.19 Open Top Broiler Units.
- **6.19.1** Listed Units: Listed open top broiler units shall be installed in accordance with their listing and the manufacturer's instructions.
- **6.19.2** Unlisted Units: Unlisted open top broiler units shall be installed in accordance with the manufacturer's instructions, but shall not be installed in combustible material.
- **6.19.3** Protection Above Domestic Units: Domestic open top broiler units shall be provided with a metal ventilating hood not less than 0.0122 inch thick* with a clearance of not less than ¼ inch between the hood and the underside of combustible material or metal cabinets. A clearance of at least 24 inches shall be maintained between the cooking top and the combustible material or metal cabinet, and the hood shall be at least as wide as the open top broiler unit and centered over the unit. Listed domestic open top broiler units incorporating an integral exhaust system and listed for use without a ventilating hood need not be provided with a ventilating hood if installed in accordance with 6.14.1-b(1).
- **6.19.4** Commercial Units: Commercial open top broiler units shall be provided with ventilation in accordance with the *Standard for the*

^{*}This corresponds to No. 28 U.S. Standard gage sheet steel with all applicable minus tolerances included.

Installation of Equipment for the Removal of Smoke and Grease-Laden Vapors from Commercial Cooking Equipment, ANSI/NFPA 96.

6.20 Outdoor Cooking Appliances.

- **6.20.1** Listed Units: Listed outdoor cooking appliances shall be installed in accordance with their listing and the manufacturer's instructions.
- **6.20.2** Unlisted Units: Unlisted outdoor cooking appliances shall be installed outdoors with clearances to combustible material of not less than 36 inches at the sides and back and not less than 48 inches at the front. In no case shall the appliance be located under overhead combustible construction.

6.21 Pool Heaters.

6.21.1 Location: A pool heater shall be located or protected so as to minimize accidental contact of hot surfaces by persons.

6.21.2 Clearance:

- a. In no case shall the clearances be such as to interfere with combustion air, draft hood or vent terminal clearance and relief, and accessibility for servicing.
- **b.** A listed pool heater shall be installed in accordance with its listing and the manufacturer's instructions.
- c. An unlisted pool heater shall be installed with a minimum clearance of 12 inches on all sides and the rear. A combustible floor under an unlisted pool heater shall be protected in an approved manner.

6.21.3 Temperature or Pressure Limiting Devices:

- **a.** An unlisted pool heater shall be provided with overtemperature protection or overtemperature and overpressure protection by means of an approved device(s).
- b. When a pool heater is provided with overtemperature protection only, and is installed with any device in the discharge line of the heater that can restrict the flow of water from the heater to the pool (such as a check valve, shutoff valve, therapeutic pool valving, or flow nozzles), a pressure relief valve shall be installed either in the heater or between the heater and the restrictive device.

- **6.21.4** Bypass Valves: If an integral bypass system is not provided as a part of the pool heater, a bypass line and valve shall be installed between the inlet and outlet piping for use in adjusting the flow of water through the heater.
- **6.21.5** Venting: A pool heater listed for outdoor installation shall be installed with the venting means supplied by the manufacturer and in accordance with the manufacturer's instructions. (See 7.2.5, 7.2.6, 7.3.4, and 7.8.)

6.22 Refrigerators.

- **6.22.1** Clearance: Refrigerators shall be provided with adequate clearances for ventilation at the top and back. They shall be installed in accordance with the manufacturer's instructions. If such instructions are not available, at least 2 inches shall be provided between the back of the refrigerator and the wall and at least 12 inches above the top.
- **6.22.2** Venting or Ventilating Kits Approved for Use with a Refrigerator: If an accessory kit is used for conveying air for burner combustion or unit cooling to the refrigerator from areas outside the room in which it is located, or for conveying combustion products diluted with air containing waste heat from the refrigerator to areas outside the room in which it is located, the kit shall be installed in accordance with the refrigerator manufacturer's instructions.

6.23 Room Heaters.

- **6.23.1 Prohibited Installations:** Unvented room heaters shall not be installed in bathrooms or bedrooms.*
- **6.23.2 Installations in Institutions:** Room heaters shall not be installed in institutions such as homes for the aged, sanitariums, convalescent homes, orphanages, etc:
- **6.23.3** Clearance: A room heater shall be placed so as not to cause a hazard to walls, floors, curtains, furniture, doors when open, etc., and to the free movements of persons within the room. Heaters designed and marked "For use in noncombustible fireplace only," shall not be installed elsewhere. Listed room heaters shall be installed in accordance

^{*}It is recommended that space heating appliances installed in all bedrooms or rooms generally kept closed be of the direct vent type (see 6.28).

with their listings and the manufacturer's instructions. In no case shall the clearances be such as to interfere with combustion air and accessibility. (See 5.2.1 and 5.3.)

Unlisted room heaters shall be installed with clearances from combustible material not less than the following:

- a. Circulating Type: Room heaters having an outer jacket surrounding the combustion chamber, arranged with openings at top and bottom so that air circulates between the inner and outer jacket, and without openings in the outer jacket to permit direct radiation, shall have clearance at sides and rear of not less than 12 inches.
- b. Radiating Type: Room heaters other than those described above as of circulating type shall have clearance at sides and rear of not less than 18 inches; except that heaters which make use of metal, asbestos, or ceramic material to direct radiation to the front of the heater shall have a clearance of 36 inches in front, and if constructed with a double back of metal or ceramic may be installed with a clearance of 18 inches at sides and 12 inches at rear. Combustible floors under unlisted room heaters shall be protected in an approved manner.
- **6.23.4** Wall-Type Room Heaters: Wall-type room heaters shall not be installed in or attached to walls of combustible material unless listed for such installation.

6.24 Sauna Heaters.

6.24.1 Location and Protection:

- a. A sauna heater shall be so located as to minimize the possibility of accidental contact by a person in the room.
- b. A sauna heater shall be protected from accidental contact by a guard or barrier of material having a low coefficient of thermal conductivity. Wood is satisfactory for this application. The guard shall have no substantial effect on the transfer of heat from the heater to the room.

6.24.2 Installation of Heater:

- a. A listed sauna heater shall be installed in accordance with its listing and the manufacturer's instructions.
- **b.** An unlisted sauna heater shall be installed in accordance with the following:

- 1. The heater shall be installed on noncombustible flooring or on flooring which has been equivalently protected in an approved manner.
- 2. The heater shall be installed in compliance with the manufacturer's instructions except that clearances to the sides, back, and top of the heater shall be not less than 36 inches.
- c. An unlisted sauna heater shall not be installed in or attached to combustible material.
- d. A direct vent sauna heater shall be installed with the vent/air intake terminal in the outside atmosphere. The thickness of the wall on which the heater is mounted shall be within the range of wall thicknesses marked on the heater and covered in the manufacturer's installation instructions.
- e. Panels, grilles, and access doors which must be removed for normal servicing operations shall not be attached to the building.
- f. A sauna heater of other than the direct vent type shall be installed generally in accordance with Figure 9. If the combustion air inlet and the draft hood are in a dressing room adjacent to the sauna room, there shall be provisions to physically prevent blocking the combustion air inlet and the draft hood inlet, and to prevent physical contact with the draft hood and vent assembly, or warning notices shall be posted to avoid such contact. Any warning notice shall be easily readable, shall contrast with its background, and the wording shall be in letters not less than ½ inch high.
- **6.24.3** Connection: The provisions of 5.5, Equipment Connections to Building Piping, shall be observed except that when access to controls is from an adjacent room, connections shall be made in that area.

6.24.4 Combustion and Ventilation Air:

- a. Combustion air shall not be taken from inside the sauna room.
- b. Adequate combustion and ventilation air for a heater not of the direct vent type shall be provided to the area in which the combustion air inlet and draft hood are located by suitable means (see 5.3).

6.24.5 Means for Heat or Exposure Limitation:

a. A sauna heater shall be equipped with a thermostat which will limit room temperature to 194 F. If the thermostat is not an integral part of the heater, the heat sensing element shall be located within 6 inches of the ceiling. If the heat sensing element is a

capillary tube and bulb, the assembly shall be attached to the wall or other support, and shall be protected against physical damage.

b. A timer, if provided to control main burner operation, shall have a maximum operating time of 1 hour. The control for the timer shall be located outside the sauna room.

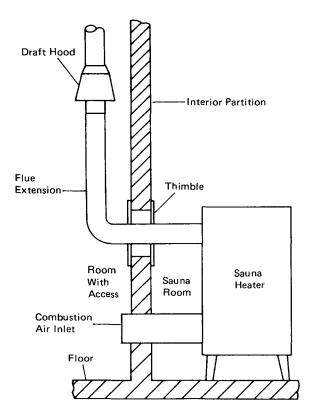


Figure 9. Typical Sauna Heater Installation.

6.24.6 Provisions for Sauna Room Equipped with a Gas-Fired Sauna Heater:

a. A ventilation opening into the sauna room shall be provided. This shall be not less than a 4-inch by 8-inch opening near the top of the door into the sauna room.

b. The following notice on permanent marking material shall be mechanically attached to the sauna room on the outside:

"Warning: Do not exceed 30 minutes in sauna. Excessive exposure can be harmful to health. Any person with poor health should consult a physician before using sauna."

This marking shall contrast with its background and the wording shall be in letters not less than 1/4 inch high.

6.25 Stationary Gas Engines.

The installation of gas engines shall conform with the Standard for the Installation and Use of Stationary Combustion Engines and Gas Turbines, ANSI/NFPA 37.

6.26 Gas-Fired Toilets.

- **6.26.1** Clearance: A listed gas-fired toilet shall be installed in accordance with its listing and the manufacturer's instructions, provided that the clearance shall in any case be sufficient to afford ready accessibility for use, cleanout, and necessary servicing.
- **6.26.2** Mounting: Listed gas-fired toilets specifically listed for installation on combustible floors may be so installed.
- **6.26.3** Installation: Vents or vent connectors which are located so they could be contacted during casual use of the room in which the toilet is installed shall be protected or shielded to prevent such contact.

6.27 Unit Heaters.

6.27.1 Support: Suspended type unit heaters shall be safely and adequately supported with due consideration given to their weight and vibration characteristics. Hangers and brackets shall be of noncombustible material.

6.27.2 Clearance:

a. Suspended Type Unit Heaters:

1. A listed unit heater shall be installed with clearances from combustible material of not less than 18 inches at the sides, 12 inches at the bottom, and 6 inches above the top when the unit heater has an internal draft hood, or 1 inch above the top of the sloping side of a vertical draft hood.

- 2. A unit heater listed for reduced clearances shall be installed in accordance with its listing and the manufacturer's instructions.
- 3. Unlisted unit heaters shall be installed with clearances to combustible material of not less than 18 inches.
- **4.** Clearances for servicing shall be in accordance with the manufacturer's recommendations contained in the installation instructions.

b. Floor-Mounted Type Unit Heaters:

- 1. A listed unit heater shall be installed with clearances from combustible material at the back and one side only of not less than 6 inches. When the flue gases are vented horizontally, the 6 inch clearance shall be measured from the draft hood or vent instead of the rear wall of the unit heater.
- 2. A unit heater listed for reduced clearances shall be installed in accordance with its listing and the manufacturer's instructions.
- 3. Floor-mounted type unit heaters may be installed on combustible floors if listed for such installation.
- 4. Combustible floors under unlisted floor-mounted unit heaters shall be protected in an approved manner.
- 5. Clearances for servicing shall be in accordance with the manufacturer's recommendations contained in the installation instructions.
- **6.27.3** Combustion and Circulating Air: Adequate combustion and circulating air shall be provided (see 5.3).
- **6.27.4 Ductwork:** A unit heater shall not be attached to a warm air duct system unless listed and marked for such installation.
- **6.27.5** Installation in Commercial Garages and Aircraft Hangars: Unit heaters installed in garages for more than three motor vehicles or in aircraft hangars shall be of a listed type and shall be installed in accordance with 5.1.11 and 5.1.12.

6.28 Wall Furnaces.

6.28.1 Installation:

a. Listed wall furnaces shall be installed in accordance with their listing and the manufacturer's instructions. They may be installed in or attached to combustible material.

- b. Unlisted wall furnaces shall not be installed in or attached to combustible material.
- c. Vented wall furnaces connected to a Type B-W gas vent system listed only for single story shall be installed only in single story buildings or the top story of multistory buildings. Vented wall furnaces connected to a Type B-W gas vent system listed for installation in multistory buildings may be installed in single story or multistory buildings. Type B-W gas vents shall be attached directly to a solid header plate which serves as a fire stop at that point and which may be an integral part of the vented wall furnace. The stud space in which the vented wall furnace is installed shall be ventilated at the first ceiling level by installation of the ceiling plate spacers furnished with the gas vent. Fire stop spacers shall be installed at each subsequent ceiling or floor level penetrated by the vent. (See Figure 10 for Type B-W gas vent installation.)
- d. Direct vent wall furnaces shall be installed with the vent/air intake terminal in the outside atmosphere. The thickness of the walls on which the furnace is mounted shall be within the range of wall thickness marked on the furnace and covered in the manufacturer's installation instructions.
- e. Panels, grilles, and access doors which must be removed for normal servicing operations shall not be attached to the building.
- **6.28.2 Location:** Wall furnaces shall be located so as not to cause a hazard to walls, floors, curtains, furniture, or doors. Wall furnaces installed between bathrooms and adjoining rooms shall not circulate air from bathrooms to other parts of the building.
- **6.28.3** Combustion and Circulating Air: Adequate combustion and circulating air shall be provided (see 5.3).

6.29 Water Heaters.

6.29.1 Prohibited Installations: Water heaters, with the exception of those having direct-vent systems, shall not be installed in bathrooms, bedrooms, or any occupied rooms normally kept closed.

Single-faucet automatic instantaneous water heaters, as permitted under 7.2.2 in addition to the above, shall not be installed in kitchen sections of light housekeeping rooms or rooms used by transients.

6.29.2 Location: Water heaters of other than the direct vent type shall be located as close as practicable to the chimney or gas vent.

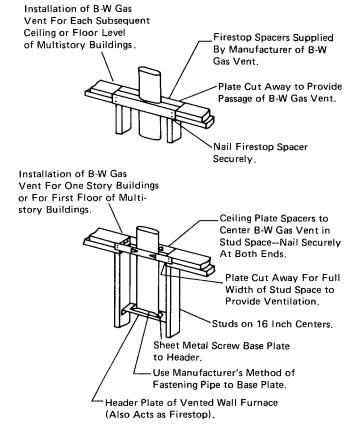


Figure 10. Installation of Type B-W Gas Vents for Vented Wall Furnaces.

6.29.3 Clearance:

- a. In no case shall the clearances be such as to interfere with combustion air, draft hood clearance and relief, and accessibility for servicing. Listed water heaters shall be installed in accordance with their listing and the manufacturer's instructions.
- **b.** Unlisted water heaters shall be installed with a clearance of 12 inches on all sides and rear. Combustible floors under unlisted water heaters shall be protected in an approved manner.

6.29.4 Pressure Limiting Devices: A water heater installation shall be provided with overpressure protection by means of an approved device constructed, listed, and installed in accordance with the terms of its listing and the manufacturer's instructions.

The pressure setting of the device shall exceed the water service pressure and shall not exceed the maximum pressure rating of the water heater.

- **6.29.5** Temperature Limiting Devices: Water heater installation or a hot water storage vessel installation shall be provided with overtemperature protection, by means of an approved device constructed, listed, and installed in accordance with the terms of its listing and the manufacturer's instructions.
- **6.29.6** Temperature, Pressure, and Vacuum Relief Devices: The installation of temperature, pressure, and vacuum relief devices or combinations thereof, and automatic gas shutoff devices shall be in accordance with the terms of their listing and the manufacturer's instructions.

A shutoff valve shall not be placed between the relief valve and the water heater, or on discharge pipes between such valves and the atmosphere.

The hourly Btu discharge capacity or the rated steam relief capacity of the device shall not be less than the input rating of the water heater.

6.29.7 Automatic Instantaneous Type:

Cold Water Supply: The water supply to any automatic instantaneous water heater shall be such as to provide sufficient pressure to properly operate the water actuated control valve when drawing hot water from a faucet on the top floor.

6.29.8 Circulating Tank Types:

- a. Connection to Tank: The method of connecting the circulating water heater to the tank shall provide proper circulation of water through the heater and permit a safe and useful temperature of water to be drawn from the tank. (See Figure 11.)
- **b. Size of Water Circulating Piping:** The size of the water circulating piping, in general, shall conform with the size of the water connections of the heater.
- c. Sediment Drain: A suitable water valve or cock, through which sediment may be drawn off or the tank emptied, shall be installed at the bottom of the tank.

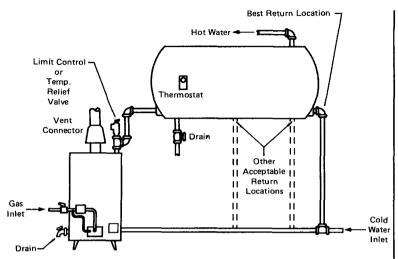


Figure 11. Typical Gravity Circulating Tank Type Installation.

6.29.9 Anti-Siphon Devices: Means acceptable to the authority having jurisdiction shall be provided to prevent siphoning in any water heater or any tank to which a circulating water heater is attached that incorporates a cold water inlet tube. A hole near the top of a cold water inlet tube which enters the top of the water heater or tank is commonly accepted for this purpose.

PART 7

VENTING OF EQUIPMENT

7.1 General: This Part recognizes that the choice of venting materials and the methods of installation of venting systems are dependent on the operating characteristics of the gas utilization equipment. The operating characteristics of vented gas utilization equipment can be categorized with respect to: (1) positive or negative pressure within the venting system; and (2) whether or not the equipment generates flue or vent gases which may condense in the venting system. See Section 1.7 for the definition of these vented appliance categories.

7.2 Specification for Venting.

7.2.1 Connection to Venting Systems: Except as noted in 7.2.2 through 7.2.6, all gas utilization equipment shall be connected to venting systems.

7.2.2 Equipment Not Required to be Vented:

- a. Listed ranges.
- **b.** Built-in domestic cooking units listed and marked for optional venting.
- c. Listed hot plates and listed laundry stoves.
- **d.** Listed Type 1 clothes dryers (see 6.4.4).
- e.* A single listed booster type (automatic instantaneous) water heater, when designed and used solely for the sanitizing rinse requirements of a National Sanitation Foundation Class 1, 2, or 3 dishwashing machine, provided that the input is limited to 50,000 Btu per hour, the storage capacity is limited to 12.5 gallons, and the heater is installed, with the draft hood in place and unaltered, in a commercial kitchen having a mechanical exhaust system. When installed in this manner, the draft hood outlet shall not be less than 36 inches vertically and 6 inches horizontally from any surface other than the heater.
- f.* Listed refrigerators.
- g.* Counter appliances.
- **h.*** Room heaters listed for unvented use (see 6.23.1 and 6.23.2).

^{*}Information on the construction and installation of ventilating hoods may be obtained from the Standard for the Installation of Equipment for the Removal of Smoke and Grease-Laden Vapors from Commercial Cooking Equipment, ANSI/NFPA 96.

- i.* Direct gas-fired make-up air heaters.
- j.* Other equipment listed for unvented use and not provided with flue collars.
- k.* Specialized equipment of limited input such as laboratory burners or gas lights.
- *When any or all of this equipment is installed so the aggregate input rating exceeds 20 Btu per hour per cubic foot of room or space in which it is installed, one or more shall be provided with venting systems or other approved means for removing the vent gases to the outside atmosphere so the aggregate input rating of the remaining unvented equipment does not exceed the 20 Btu per hour per cubic foot figure. When the room or space in which the equipment is installed is directly connected to another room or space by a doorway, archway, or other opening of comparable size which cannot be closed, the volume of such adjacent room or space may be included in the calculations.
- **7.2.3 Ventilating Hoods:** Ventilating hoods and exhaust systems may be used to vent gas utilization equipment installed in commercial applications* (see 7.3.5) and to vent industrial equipment, particularly when the process itself requires fume disposal (see 5.1.7 and 5.1.9).
- **7.2.4** Well-Ventilated Spaces: When located in a large and well-ventilated space, industrial gas utilization equipment may be operated by discharging the flue gases directly into the space.
- 7.2.5 Direct Vent Equipment: Listed direct vent gas utilization equipment shall be considered properly vented when installed in accordance with the terms of its listing, the manufacturer's instructions, and 7.8-c.
- **7.2.6** Equipment with Integral Vents: Gas utilization equipment incorporating integral venting means shall be considered properly vented when installed in accordance with its listing, the manufacturer's instructions, and 7.8-a and -b.

7.3 Design and Construction.

7.3.1 Minimum Safe Performance: A venting system shall be designed and constructed so as to develop a positive flow adequate to remove flue or vent gases to the outside atmosphere.

^{*}Information on the construction and installation of ventilating hoods may be obtained from the Standard for the Installation of Equipment for the Removal of Smoke and Grease-Laden Vapors from Commercial Cooking Equipment, ANSI/NFPA 96.

- **7.3.2 Equipment Draft Requirements:** A venting system shall satisfy the draft requirements of the equipment in accordance with the manufacturer's instructions.
- 7.3.3 Design and Construction: Gas utilization equipment required to be vented shall be connected to a venting system designed and constructed in accordance with the provisions of 7.4 through 7.15.

7.3.4 Mechanical Draft Systems:

- a. Gas utilization equipment, except incinerators, requiring venting may be vented by means of mechanical draft systems of either forced or induced draft design.
- b. Forced draft systems and all portions of induced draft systems under positive pressure during operation shall be designed and installed so as to prevent leakage of flue or vent gases into a building.
- c. Vent connectors serving equipment vented by natural draft shall not be connected into any portion of mechanical draft systems operating under positive pressure.
- d. When a mechanical draft system is employed, provision shall be made to prevent the flow of gas to the main burners when the draft system is not performing so as to satisfy the operating requirements of the equipment for safe performance.
- e. The exit terminals of mechanical draft systems shall be not less than 7 feet above grade when located adjacent to public walkways and shall be located as specified in 7.8-a and -b.

7.3.5 Ventilating Hoods and Exhaust Systems:*

- a. Ventilating hoods and exhaust systems may be used to vent gas utilization equipment installed in commercial applications.
- b. When automatically operated gas utilization equipment is vented through a ventilating hood or exhaust system equipped with a damper or with a power means of exhaust, provisions shall be made to allow the flow of gas to the main burners only when the damper is open to a position to properly vent the equipment and when the power means of exhaust is in operation.

^{*}Information on the construction and installations of ventilating hoods may be obtained from the Standard for the Installation of Equipment for the Removal of Smoke and Grease-Laden Vapors from Commercial Cooking Equipment, ANSI/NFPA 96.

7.3.6 Circulating Air Ducts and Plenums: No portion of a venting system shall extend into or pass through any circulating air duct or plenum.

7.4 Type of Venting System to be Used.

7.4.1 Type of Venting System to be Used:

Gas Utilization Equipment

Listed Category I equipment Listed equipment equipped with draft hood

Equipment listed for use with Type B gas vent

Listed vented wall furnaces Category II equipment

Category III equipment

Category IV equipment

Incinerators, indoors
Incinerators, outdoors

Equipment which may be converted to use of solid fuel Unlisted combination gas and

oil-burning equipment
Listed combination gas and

oil-burning equipment
Combination gas and solid-fuel

burning equipment Equipment listed for use with

chimneys only

Unlisted equipment

Decorative appliance in vented fireplace

Gas-fired toilets

Direct vent equipment
Equipment with integral vent
Equipment in commercial and

industrial installations

Type of Venting System

Type B gas vent (7.6)
Chimney (7.5)
Single-wall metal pipe (7.7)

Type B-W gas vent (7.6, 6.28) As specified or furnished by

equipment manufacturer

As specified or furnished by equipment manufacturer

As specified or furnished by equipment manufacturer

Chimney (7.5)

Single-wall metal pipe (7.7, 7.7.3-c)

Chimney (7.5)

Chimney (7.5)

Type L vent (7.6) or chimney (7.5)

Chimney (7.5)

Chimney (7.5)

Chimney (7.5)

Chimney (6.6.2-b)

Single-wall metal pipe (7.7, 6.26.3)

See 7.2.5

See 7.2.6

Chimney, ventilating hood, and exhaust system (7.3.5)

- 7.4.2 Plastic Piping: Approved plastic piping may be used for venting equipment listed for use with such venting materials.
- 7.5 Masonry, Metal, and Factory-Built Chimneys.

7.5.1 Listing or Construction:

- a. Factory-built chimneys shall be installed in accordance with their listing and the manufacturer's instructions.
- b. Metal chimneys shall be built and installed in accordance with nationally recognized building codes or standards. †
- c. Masonry chimneys shall be built and installed in accordance with nationally recognized building codes or standards† and lined with approved fire clay tile flue liners or other approved liner material that will resist corrosion, softening, or cracking from flue gases at temperatures up to 1800 F.

7.5.2 Termination:

- a. A chimney for residential-type or low-heat gas utilization equipment shall extend at least 3 feet above the highest point where it passes through a roof of a building and at least 2 feet higher than any portion of a building within a horizontal distance of 10 feet. (See Figure 12.)
- **b.** A chimney for medium-heat equipment shall extend at least 10 feet higher than any portion of any building within 25 feet.
- c. A chimney shall extend at least 5 feet above the highest connected equipment draft hood outlet or flue collar.

7.5.3 Size of Chimneys:

- a. The effective area of a chimney venting system shall be in accordance with approved engineering methods.
 - 1. The sizing of a chimney for natural draft venting of one or more listed appliances equipped with a draft hood or Category I appliances listed for use with Type B gas vent, installed in a single story of a building, may be in accordance with Tables G-3 and G-6 of Appendix G.
 - 2. As an alternate method of sizing an individual chimney venting system for a single appliance only, the effective areas of

[†]Among such nationally recognized codes and standards is the Standard for Chimneys, Fireplaces, Vents and Solid Fuel Burning Appliances. ANSI/NFPA 211.

the vent connector and chimney flue shall be not less than the area of the appliance flue collar or draft hood outlet.

- 3. As an alternate method for sizing a chimney connected to more than one appliance, the effective area of the chimney flue shall be not less than the area of the largest vent connector plus 50 percent of the area of additional flue collars or draft hood outlets.
- b. When an incinerator is vented by a chimney serving other gas utilization equipment, the gas input to the incinerator need not be included in calculating chimney size provided the chimney flue diameter is not less than one inch larger in equivalent diameter than the diameter of the incinerator flue outlet.

7.5.4 Inspection of Chimneys:


- a. Before connecting a vent connector to a chimney, the chimney passageway shall be examined to ascertain that it is clear and free of obstructions and shall be cleaned if previously used for venting solid fuel-burning appliances or fireplaces.
- **b.** Cleanouts shall be examined to determine they will remain tightly closed when not in use.
- c. When inspection reveals that an existing chimney is not safe for the intended application, it shall be rebuilt to conform to nationally recognized standards,* lined or relined with a suitable liner, or replaced with a vent or chimney suitable for the equipment to be attached.


7.5.5 Chimney Serving Equipment Burning Other Fuels: (See 7.10.4.)

- 7.5.6 Support of Chimneys: All portions of chimneys shall be supported for the design and weight of the materials employed. Listed factory-built chimneys shall be supported and spaced in accordance with their listings and the manufacturer's instructions.
- 7.5.7 Cleanouts: When a chimney which formerly carried flue products from liquid or solid burning appliances is used with an appliance using fuel gas, an accessible cleanout shall be provided. The cleanout shall have a tight-fitting cover and be installed so its upper edge is at least 12 inches below the lower edge of the lowest chimney inlet opening.

⁴Among such nationally recognized codes and standards is the Standard for Chimneys, Fireplaces, Vents and Solid Fuel Burning Appliances, ANSI/NFPA 211.


Figure 12. Typical Termination Locations for Chimneys and Single-Wall Metal Pipes Serving Residential-Type and Low-Heat Equipment.






A. Termination 10 Feet or Less From Ridge, Wall, or Parapet

Figure 12. (Continued)





B. Termination More Than 10 Feet From Ridge, Wall, or Parapet

7.6 Gas Vents. (See Section 1.7, Definitions.)

7.6.1 Application:

- a. Gas vents shall be installed in accordance with the terms of their listings and the manufacturer's instructions.
- **b.** A Type B-W gas vent shall have a listed capacity not less than that of the listed vented wall furnace to which it is connected.
- c. A gas vent passing through a roof shall extend through the roof flashing, roof jack, or roof thimble.
- d. Type B or Type L vents shall extend in a generally vertical direction with offsets not exceeding 45 degrees, except that a vent system having not more than one 60-degree offset may be allowed.

Any angle greater than 45 degrees from the vertical is considered horizontal. The total horizontal run of a vent plus the horizontal vent connector shall be not greater than 75 percent of the vertical height of the vent.

Exception: Engineered systems as provided in 7.6.3.

7.6.2 Gas Vent Termination:

- a. A gas vent shall terminate above the roof surface with a listed cap or listed roof assembly in accordance with the terms of their respective listings and the manufacturer's instructions, except as provided in 7.2.5, 7.2.6, 7.3.4, and 7.3.5.
- b. A Type B or a Type L gas vent shall terminate at least 5 feet in vertical height above the highest connected equipment draft hood or flue collar.
- c. A Type B-W gas vent shall terminate at least 12 feet in vertical height above the bottom of the wall furnace.
- **d.** A gas vent extending through an exterior wall shall not terminate adjacent to the wall or below eaves or parapets, except as provided in 7.2.5 and 7.3.4.
- 7.6.3 Size of Gas Vents: Venting systems shall be sized and constructed in accordance with approved engineering methods* and the gas equipment manufacturer's instructions.

^{*}Reference may be also be made to the chapter on chimney, gas vent, and fireplace systems of the Equipment Volume of the ASHRAE Handbook.

- a. Category I Appliances: The sizing of natural draft venting systems serving one or more listed appliances equipped with a draft hood or appliances listed for use with Type B gas vent, installed in a single story of a building, may be in accordance with Tables G-1, G-2, G-4, and G-5 of Appendix G.
 - 1. As an alternate method for sizing an individual gas vent for a single appliance only, the effective area of the vent connector and the gas vent shall be not less than the area of the appliance flue collar or draft hood outlet.
 - 2. As an alternate method for sizing a gas vent connected to more than one appliance, the effective area of the vent shall be not less than the area of the largest vent connector plus 50 percent of the areas of additional flue collar or draft hood outlets.
- b. Category II, III, and IV Appliances: The sizing of gas vents for Category II, III, and IV gas utilization equipment shall be in accordance with the equipment manufacturer's instructions.
- 7.6.4 Gas Vents Serving Equipment on More than One Floor: A single or common gas vent is permissible in multistory installations to vent Category I gas utilization equipment located on more than one floor level provided the venting system is designed and installed in accordance with approved engineering practices.

All gas utilization equipment connected to the common vent shall be located in rooms separated from habitable space. Each of these rooms shall have provisions for an adequate supply of combustion, ventilation, and dilution air that is not supplied from habitable space. (See Figure 13.)

The size of the connectors and common segments of multistory venting systems for gas utilization equipment listed for use with Type B double-wall gas vent may be in accordance with Table G-4 and Figures G-6 and G-7 in Appendix G, providing:

- **a.** The available total height "H" for each segment of a multistory venting system is the vertical distance between the level of the highest draft hood outlet or flue collar on that floor and the centerline of the next highest interconnection tee. (See Figure G-6.)
- **b.** The size of the connector for a segment is determined from its gas utilization equipment heat input and available connector rise, and shall not be smaller than the draft hood outlet or flue collar size.

c. The size of the common vertical vent segment, and of the interconnection tee at the base of that segment, shall be based on the total gas utilization equipment heat input entering that segment and its available total height.

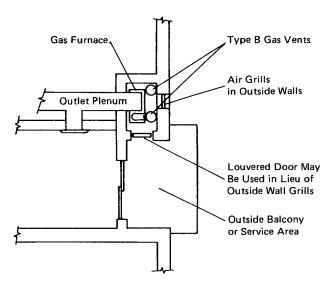


Figure 13. Plan View of Practical Separation Method for Multistory
Gas Venting.

- 7.6.5 Support of Gas Vents: Gas vents shall be supported and spaced in accordance with their listings and the manufacturer's instructions.
- 7.6.6 Marking: In those localities where solid and liquid fuels are used extensively, gas vents shall be plainly and permanently identified by a label attached to the wall or ceiling at a point where the vent connector enters the gas vent. The label shall read:

"This gas vent is for appliances which burn gas. Do not connect to solid or liquid fuel-burning appliances or incinerators."

The authority having jurisdiction shall determine whether its area constitutes such a locality.

7.7 Single-Wall Metal Pipe.

7.7.1 Construction: Single-wall metal pipe shall be constructed of galvanized sheet steel not less than 0.0304 inch thick,* or other approved noncombustible corrosion-resistant material.

7.7.2 Termination:

- a. Single-wall metal pipe shall terminate at least 5 feet in vertical height above the highest connected equipment draft hood outlet or flue collar.
- **b.** Single-wall metal pipe shall extend at least 2 feet above the highest point where it passes through a roof of a building and at least 2 feet higher than any portion of a building within a horizontal distance of 10 feet. (See Figure 12.)
- c. An approved cap which does not obstruct the pipe outlet shall be attached to the terminus of a single-wall metal pipe.

7.7.3 Installation With Equipment Permitted by 7.4.1:

- a. Single-wall metal pipe shall be used only for runs directly from the space in which the gas utilization equipment is located through the roof or exterior wall to the outer air. A pipe passing through a roof shall extend without interruption through the roof flashing, roof jacket, or roof thimble.
- b. Single-wall metal pipe shall not originate in any unoccupied attic or concealed space and shall not pass through any attic, inside wall, or concealed space, or through any floor. For the installation of a single-wall metal pipe through an exterior combustible wall, see 7.10.16-b.
- c. Single-wall metal pipe used for venting an incinerator shall be exposed and readily examinable for its full length and suitable clearances maintained.
- d. Minimum clearances from single-wall metal pipe to combustible material shall be in accordance with Table IX. The clearance from single-wall metal pipe to combustible material may be reduced when the combustible material is protected as specified for vent connectors in Table VI.
- e. When a single-wall metal pipe passes through a roof constructed of combustible material, a noncombustible, nonventilating

^{*}This corresponds to No. 20 Galvanized Sheet Gage number with all applicable minus tolerances included.

Table IX*
Clearances for Connectors

Equipment	Minimum Distance from Combustible Material				
	Listed Type B Gas Vent Material	Listed Type L Vent Material	Single-Wall Metal Pipe	Factory-Built Chimney Sections	
Listed equipment with draft hoods and equip- ment listed for use with Type B Gas Vents	as listed	as listed	6 inches	as listed	
Residential boilers and furnaces with listed gas conversion burner and with draft hood	6 inches	6 inches	9 inches	as listed	
Residential appliances listed for use with Type L vents	not permitted	as listed	9 inches	as listed	
Residential incinerators	not permitted	9 inches	18 inches	as listed	
Listed gas-fired toilets	not permitted	as listed	as listed	as listed	
Unlisted residential appliances with draft hood	not permitted	6 inches	9 inches	as listed	
Residential and low-heat equipment other than those above	not permitted	9 inches	18 inches	as listed	
Medium-heat equipment	not permitted	not permitted	36 inches	as listed	

^{*} These clearances shall apply unless the listing of an appliance specifies different clearances, in which case the listed clearances shall apply.

thimble shall be used at the point of passage. The thimble shall extend at least 18 inches above and 6 inches below the roof with the annular space open at the bottom and closed only at the top. The thimble shall be sized in accordance with 7.10.16-b.

7.7.4 Size of Single-Wall Metal Pipe:

- a. A venting system of single-wall metal pipe shall be sized and constructed in accordance with approved engineering methods* and the gas equipment manufacturer's instructions.
 - 1. As an alternate method of sizing a venting system for a single appliance only, the effective area of the connector and the pipe shall not be less than the area of the appliance flue collar or draft hood outlet.
 - 2. As an alternate method for sizing a venting system connected to more than one appliance, the effective area of the pipe shall be not less than the area of the largest connector plus 50 percent of the area of additional flue collars or draft hood outlets.
 - 3. The sizing of single-wall metal pipe for natural draft venting of one or more listed appliances equipped with draft hoods or Category I appliances listed for use with Type B gas vents, installed in a single room, may be in accordance with Tables G-2 and G-5 of Appendix G.
- **b.** Any shaped single-wall metal pipe may be used, provided its equivalent effective area is equal to the effective area of the round pipe for which it is substituted and provided the minimum internal dimension of the pipe is not less than 2 inches.
- c. The vent cap or a roof assembly shall have a venting capacity not less than that of the pipe to which it is attached.
- 7.7.5 Support of Single-Wall Metal Pipe: All portions of single-wall metal pipe shall be supported for the design and weight of the material employed.
- 7.7.6 Marking: Single-wall metal pipe shall comply with the marking provisions of 7.6.6.

^{*}Reference may also be made to the chapter on chimney, gas vent, and fireplace systems of the Equipment Volume of the ASHRAE Handbook.

7.8 Venting System Location:

a. A venting system shall terminate at least 3 feet above any forced air inlet located within 10 feet.

Exception: This provision shall not apply to the combustion air intake of a direct vent appliance.

- b. The venting system of other than a direct vent appliance shall terminate at least 4 feet below, 4 feet horizontally from, or 1 foot above any door, window, or gravity air inlet into any building. The bottom of the vent terminal shall be located at least 12 inches above grade.
- c. The vent terminal of a direct vent appliance with an input of 50,000 Btu per hour or less shall be located at least 9 inches from any opening through which flue gases could enter a building, and such an appliance with an input over 50,000 Btu per hour shall require a 12-inch vent termination clearance. The bottom of the vent terminal and the air intake shall be located at least 12 inches above grade.
- **d.** Uninsulated single-wall metal pipe shall not be used outdoors in cold climates for venting gas utilization equipment.
- e. Through the wall vents for Category II and IV appliances shall not terminate over public walkways or over an area where condensate or vapor could create a nuisance or hazard or could be detrimental to the operation of regulators, relief valves, or other equipment. Where local experience indicates that condensate may be a problem with Category I and III appliances this provision shall also apply.

7.9 Condensation Drain:

- **a.** Provision shall be made to collect and dispose of condensate from venting systems serving Category II and IV gas utilization equipment in accordance with 7.8-e.
- b. When local experience indicates that condensation may be a problem, provision shall be made to drain off and dispose of condensate from venting systems serving Category I and III gas utilization equipment in accordance with 7.8-e.

7.10 Vent Connectors for Category I Gas Utilization Equipment.

7.10.1 When Required: A vent connector shall be used to connect gas utilization equipment to a gas vent, chimney, or single-wall metal pipe,

except when the gas vent, chimney, or single-wall metal pipe is directly connected to the equipment.

7.10.2 Materials:

- a. A vent connector shall be made of noncombustible corrosionresistant material capable of withstanding the vent gas temperature produced by the gas utilization equipment and of sufficient thickness to withstand physical damage.
- **b.** Vent connectors for residential-type appliances shall comply with the following:
 - 1. Appliances Installed in Attics: Vent connectors for listed gas appliances having draft hoods and appliances listed for use with Type B gas vents, which are installed in attics, shall be of Type B or Type L vent material.
 - 2. Appliances Not Installed in Attics: Vent connectors for listed gas appliances having draft hoods and for appliances having draft hoods and equipped with listed conversion burners, which are not installed in attics, shall be of Type B or Type L vent material or metal pipe having resistance to heat and corrosion not less than that of galvanized sheet steel or aluminum not less than 0.0122 inch thick.*

Vent connectors for combination gas- and oil-burning appliances, residential incinerators, and appliances other than those noted in "1" above, and which are not installed in attics, shall be of Type L vent material, factory-built chimney section, or steel pipe having resistance to heat and corrosion not less than that of galvanized steel as specified in Table X.

- c. A vent connector for low-heat equipment shall be a factory-built chimney section or steel pipe having resistance to heat and corrosion equivalent to that for the appropriate galvanized pipe as specified in Table X. Factory-built chimney sections shall be joined together in accordance with the chimney manufacturer's instructions.
- **d.** Vent connectors for medium-heat equipment and commercial and industrial incinerators shall be constructed of factory-built medium-heat chimney sections or steel of a thickness not less than that specified in Table XI, and shall comply with the following:

^{*}This corresponds to No. 28 Galvanized Sheet Gage number with all applicable minus tolerances included.

- 1. A steel vent connector for equipment with a vent gas temperature in excess of 1000 F, measured at the entrance to the connector, shall be lined with medium duty fire brick (ASTM C64, Type F), or the equivalent.
- 2. The lining shall be at least 2½ inches thick for a vent connector having a diameter or greatest cross-section dimension of 18 inches or less.
- 3. The lining shall be at least $4\frac{1}{2}$ inches thick laid on the $4\frac{1}{2}$ -inch bed for a vent connector having a diameter or greatest cross-section dimension greater than 18 inches.

Table X

Minimum Thickness for Galvanized Steel Vent
Connectors for Low-Heat Appliances

Diameter of Connector, Inches	Minimum Thickness, Inch*
less than 6	0.019 (26)
6 to less than 10	0.023 (24)
10 to 12 inclusive	0.029 (22)
14 to 16 inclusive	0.034 (20)
over 16	0.056 (16)

^{*} The figures in parentheses are the corresponding Galvanized Sheet Gage number with all applicable minus tolerances included.

Table XI

Minimum Thickness for Steel Vent Connectors for Medium
Heat Equipment and Commercial and Industrial Incinerators

Vent Connector Size		Minimum Thickness,		
Diameter, In.	Area, Sq. In.	Inch*		
up to 14	up to 154	0.053 (16)		
over 14 to 16	154 to 201	0.067 (14)		
over 16 to 18	201 to 254	0.093 (12)		
over 18	Larger than 254	0.123 (10)		

^{*} The figures in parentheses are the corresponding Manufacturer's Standard Gage number with all applicable minus tolerances included.

4. Factory-built chimney sections, if employed, shall be joined together in accordance with the chimney manufacturer's instructions.

7.10.3 Size of Vent Connector:

- a. A vent connector for gas utilization equipment with a single draft hood shall be sized and constructed in accordance with approved engineering practices and the gas equipment manufacturer's instructions. Reference may be made to Tables G-1 through G-3 in Appendix G, depending on the construction of the connector.† As an alternate method the effective area of the connector shall be not less than the area of the draft hood outlet.
- b. For a single appliance having more than one draft hood outlet, the manifold shall be constructed according to the instructions of the appliance manufacturer. If there are no instructions, the manifold shall be designed and constructed in accordance with approved engineering practices. As a second alternate, the effective area of the manifold shall equal the combined areas of the draft hood outlets.
- c. When two or more gas appliances are connected to a common vent or chimney, the effective area of each vent connector shall be in accordance with approved engineering practices. Reference may be made to Tables G-4 through G-6 in Appendix G.* As an alternate method, each vent connector shall have an effective area not less than the area of the draft hood outlet of the appliance to which it is connected.
- d. When two or more gas appliances are vented through a common vent connector or manifold, the common vent connector or manifold shall be located at the highest level consistent with available headroom or clearance to combustible material. The effective area of the common vent connector or manifold and all junction fittings shall be not less than the area of the largest vent connector plus 50 percent of the areas of additional draft hood outlets.
- e. When the size of a vent connector is increased to overcome installation limitations and obtain connector capacity equal to the equipment input, the size increase shall be made at the equipment draft hood outlet.

[†]Reference may also be made to the chapter on chimney, gas vent, and fireplace systems of the Equipment Volume of the ASHRAE Handbook.

f. The effective area of the vent connector, when connected to one or more appliances requiring draft for operation, shall be obtained by the application of approved engineering practices to perform as specified in 7.3.1 and 7.3.2.

7.10.4 Two or More Appliances Connected to a Single Vent:

- a. Gas utilization equipment shall not be connected to a chimney flue serving a separate appliance designed to burn solid fuel.
- b. Gas utilization equipment and equipment burning liquid fuel may be connected to one chimney flue through separate openings or may be connected through a single opening if joined by a suitable fitting located as close as practical to the chimney. If two or more openings are provided into one chimney flue, they shall be at different levels. If the gas utilization equipment is automatically controlled, it shall be equipped with a safety shutoff device.
- c. When two or more vent connectors enter a common gas vent, chimney flue, or single-wall metal pipe, the smaller connector shall enter at the highest level consistent with the available headroom or clearance to combustible material.

7.10.5 Combination Units:

- a. A listed combination gas- and solid fuel-burning appliance equipped with a manual reset device to shut off gas to the main burner in the event of sustained backdraft or flue gas spillage may be connected to a single chimney flue. The chimney flue shall be sized to properly vent the appliance.*
- **b.** A listed combination gas- and oil-burning appliance may be connected to a single chimney flue. The chimney flue shall be sized to properly vent the appliance.*
- **7.10.6** Clearance: Minimum clearances from vent connectors to combustible material shall be in accordance with Table IX, except that the clearance between a vent connector and combustible material may be reduced when the combustible material is protected as specified for vent connectors in Table VI.
- **7.10.7** Avoid Unnecessary Bends: A vent connector shall be installed so as to avoid turns or other construction features which create excessive resistance to flow of vent gases.

^{*}Reference may also be made to the chapter on chimney, gas vent, and fireplace systems of the Equipment Volume of the ASHRAE Handbook.

- **7.10.8** Joints: Vent connectors shall be firmly attached to draft hood outlets or flue collars by sheet-metal screws or other approved means, except vent connectors of listed Type B or Type L vent material which shall be assembled in accordance with the manufacturer's instructions. Joints between sections of connector piping shall be fastened by sheet-metal screws or other approved means.
- **7.10.9** Slope: A vent connector shall be installed without any dips or sags and shall slope upward at least 1/4 inch per foot.

7.10.10 Length of Vent Connector:

- **a.** A vent connector shall be as short as possible and the gas utilization equipment located as close as practicable to the chimney or vent.
- b. Except when part of a designed venting system, the horizontal run of an uninsulated vent connector to a natural draft chimney or vent serving a single appliance shall not be more than 75 percent of the height of the vertical portion of the chimney or vent above the connector.
- c. Except when part of a designed venting system, the horizontal run of an insulated vent connector to a natural draft chimney or vent serving a single gas or liquid fuel-fired appliance shall not be more than 100 percent of the height of the vertical portion of the chimney or vent above the connector.
- **7.10.11** Support: A vent connector shall be supported for the design and weight of the material employed to maintain clearances and prevent physical damage and separation of joints.
- **7.10.12** Location: When the vent connector used for gas utilization equipment having a draft hood must be located in or pass through a crawl space or other area which may be cold, that portion of the vent connector shall be of listed double-wall Type B or Type L vent material or material having equivalent insulation qualities.
- 7.10.13 Chimney Connection: In entering a passageway in a masonry or metal chimney, the vent connector shall be installed above the extreme bottom to avoid stoppage. A thimble or slip joint may be used to facilitate removal of the connector. The connector shall be firmly attached to or inserted into the thimble or slip joint to prevent the connector from falling out. Means shall be employed which will prevent the connector from entering so far as to restrict the space between its end and the opposite wall of the chimney.

- **7.10.14** Inspection: The entire length of a vent connector shall be readily accessible for inspection, cleaning, and replacement.
- **7.10.15** Fireplaces: A vent connector shall not be connected to a chimney flue serving a fireplace unless the fireplace flue opening is permanently sealed.

7.10.16 Passage Through Ceilings, Floors, or Walls:

- a. A vent connector shall not pass through any ceiling, floor, fire wall, or fire partition. A single-wall metal pipe connector shall not pass through any interior wall.
- **b.** A vent connector made of a single-wall metal pipe shall not pass through a combustible exterior wall unless guarded at the point of passage by a ventilated metal thimble not smaller than the following:
 - 1. For listed gas utilization equipment equipped with draft hoods and equipment listed for use with Type B gas vents, 4 inches larger in diameter than the vent connector. When there is a run of not less than 6 feet of vent connector in the open between the draft hood outlet and the thimble, the thimble may be 2 inches larger in diameter than the vent connector.
 - 2. For unlisted equipment having draft hoods, 6 inches larger in diameter than the vent connector.
 - 3. For residential incinerators and all other residential and low-heat equipment, 12 inches larger in diameter than the vent connector.

In lieu of thimble protection, all combustible material in the wall may be cut away from the vent connector a sufficient distance to provide the specified clearance from such vent connector to combustible material. Any material used to close up such opening shall be noncombustible.

- c. Except as provided in "a" above, vent connectors made of listed Type B or Type L vent material and serving listed equipment with draft hoods and other equipment listed for Type B gas vents may pass through walls or partitions constructed of combustible material if the connectors are installed with not less than the listed clearance to combustible material.
- **d.** Vent connectors for medium-heat equipment shall not pass through walls or partitions constructed of combustible material.
- 7.11 Vent Connectors for Category II, III, and IV Gas Utilization Equipment. (See 7.4.1, Type of Venting System to be Used.)

7.12 Draft Hoods and Draft Controls.

7.12.1 Equipment Requiring Draft Hoods: Vented gas utilization equipment shall be installed with draft hoods except dual oven type combination ranges, incinerators, direct vent equipment, equipment requiring chimney draft for operation, single firebox boilers equipped with conversion burners with inputs greater than 400,000 Btu per hour, equipment equipped with blast, power, or pressure burners which are not listed for use with draft hoods, and equipment designed for forced venting.

7.12.2 Installation:

- a. Except as noted in "b" below, a draft hood supplied with or forming a part of listed vented gas utilization equipment shall be installed without alteration, exactly as furnished and specified by the equipment manufacturer. If a draft hood is not supplied by the equipment manufacturer when one is required, a draft hood shall be installed, be of a listed or approved type and, in the absence of other instructions, be of the same size as the equipment flue collar. When a draft hood is required with a conversion burner, it shall be of a listed or approved type.
- **b.** If it is determined that a draft hood of special design is needed or preferable for a particular installation, the advice of the gas utilization equipment manufacturer and the approval of the authority having jurisdiction shall be secured.
- 7.12.3 Draft Control Devices: When a draft control device is part of the gas utilization equipment or is supplied by the equipment manufacturer, it shall be installed without alteration in accordance with the manufacturer's instructions. In the absence of manufacturer's instructions, the device shall be attached to the flue collar of the equipment or as near to the equipment as conditions permit.
- 7.12.4 Additional Devices: Gas utilization equipment (except incinerators) requiring controlled chimney draft may be equipped with a listed double acting barometric draft regulator installed and adjusted in accordance with the manufacturer's instructions. Figure 14 shows examples of correct and incorrect locations for barometric draft regulators. A device which will automatically shut off gas to the burner in the event of sustained backdraft is recommended if such backdraft might adversely affect burner operation or if flue gas spillage might introduce a hazard.

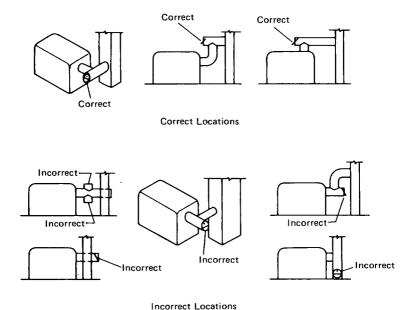


Figure 14. Locations for Barometric Draft Regulators.

- 7.12.5 Incinerator Draft Regulator: A listed gas-fired incinerator may be equipped with a listed single acting barometric draft regulator when recommended by the incinerator manufacturer. This draft regulator shall be installed in accordance with the instructions accompanying the incinerator.
- **7.12.6** Install In Same Room: A draft hood or a barometric draft regulator shall be installed in the same room or enclosure as the equipment in such a manner as to prevent any difference in pressure between the hood or regulator and the combustion air supply.
- 7.12.7 Positioning: A draft hood or draft regulator shall be installed in the position for which it was designed with reference to the horizontal and vertical planes and shall be located so that the relief opening is not obstructed by any part of the gas utilization equipment or adjacent construction. The equipment and its draft hood shall be located so that the relief opening is accessible for checking vent operation.

7.12.8 Clearance: A draft hood shall be located so its relief opening is not less than 6 inches from any surface except that of the gas utilization equipment it serves and the venting system to which the draft hood is connected. When a greater or lesser clearance is indicated on the equipment label, the clearance shall not be less than that specified on the label. These clearances shall not be reduced.

7.13 Manually Operated Dampers.

A manually operated damper shall not be placed in the vent connector from any gas utilization equipment, except in a connector serving a listed gas-fired incinerator when recommended by the incinerator manufacturer and installed in accordance with the instructions accompanying the incinerator. Fixed baffles are not classified as manually operated dampers.

7.14 Automatically Operated Vent Dampers.

An automatically operated vent damper shall be of a listed type. (Also see 9.3.)

7.15 Obstructions.

Except as noted below, a device which will retard the flow of vent gases shall not be installed in a vent connector, chimney, or vent.

- a. Draft regulators and safety controls (1) specifically listed for installation in venting systems and installed in accordance with the terms of their listing, and (2) designed and installed in accordance with approved engineering methods and approved by the authority having jurisdiction.
- **b.** Listed heat reclaimers and automatically operated vent dampers installed in accordance with the terms of their listing.
- c. Approved economizers, heat reclaimers, and recuperators installed in venting systems of equipment not required to be equipped with draft hoods provided performance in accordance with 7.3.1 and 7.3.2 is obtained.

PART 8

PROCEDURES TO BE FOLLOWED TO PLACE EQUIPMENT IN OPERATION

8.1 Adjusting the Burner Input.

- **8.1.1** Burner Input: Each burner shall be adjusted to its proper input in accordance with the manufacturer's instructions. Overheating of burners is prohibited.
- **8.1.2** High Altitude: Ratings of gas utilization equipment are based on sea level operation and need not be changed for operation at elevations up to 2,000 feet. For operation at elevations above 2,000 feet and, in the absence of specific recommendations from the local authority having jurisdiction, equipment ratings shall be reduced at the rate of 4 percent for each 1,000 feet above sea level before selecting appropriately sized equipment.

8.1.3 Checking Burner Input:

- a. Checking Burner Input Using a Meter: To check the Btu input rate, the test hand on the meter should be timed for at least one revolution and the input determined from this timing. Test dials are generally marked ½, 1, 2, or 5 cubic feet per revolution depending upon the size of the meter. Instructions for converting the test hand readings to cubic feet per hour are given in Table XII.
- **b.** Checking Burner Input Not Using a Meter: The fixed orifice size for each burner may be determined in accordance with Table F-1 for utility gases and Table F-2 for undiluted liquefied petroleum gases in Appendix F.
- **8.1.4** Adjusting Input: The input rate shall be adjusted to the proper rate by changing a fixed orifice size, changing the adjustment of an adjustable orifice, or by readjustment of the gas pressure regulator outlet pressure (when a regulator is provided). Consult the serving gas supplier.

8.2 Primary Air Adjustment.

The primary air for injection (Bunsen) type burners shall be adjusted for proper flame characteristics in accordance with the manufacturer's

instructions. Normally, the primary air adjustment should first be set to give a soft blue flame having luminous tips and then increased to a point where the yellow tips just disappear. If the burner cannot be adjusted as above, consult the manufacturer or serving gas supplier. After setting the primary air, the adjustment means shall be secured in position.

8.3 Safety Shutoff Devices.

When a safety shutoff device is provided, it shall be checked for proper operation and adjustment in accordance with the manufacturer's instructions. If the device does not function properly to turn off the gas supply in the event of pilot outage, it shall be properly serviced or replaced with new equipment.

8.4 Automatic Ignition.

Gas utilization equipment supplied with means for automatic ignition shall be checked for proper operation. If necessary, proper adjustments shall be made.

8.5 Protective Devices.

All protective devices furnished with the gas utilization equipment, such as a limit control, fan control to blower, temperature and pressure relief valve, low water cutoff device, manual operating features, etc., shall be checked for proper operation.

8.6 Checking the Draft.

Vent connected gas utilization equipment shall be operated for several minutes and checked to see that the combustion products are going up the chimney, or gas vent, properly by passing a lighted match or taper around the edge of the relief opening of the draft hood. If the chimney or gas vent is drawing properly, the match flame will be drawn into the draft hood. If not, the combustion products will tend to extinguish this flame. If the combustion products are escaping from the relief opening of the draft hood, the equipment shall not be operated until proper adjustments or repairs are made to provide adequate draft through the chimney or gas vent.

8.7 Operating Instructions.

Operating instructions shall be furnished and shall be left in a prominent position near the equipment for the use of the consumer.

Table XII

Gas Input to Burner in Cubic Feet Per Hour

	Size of Test Meter Dial				
Seconds For One Revolution	One-Half Cu. Ft.	One Cu. Ft. Cubic Fee	Two Cu. Ft. t Per Hour	Five Cu. Ft.	
10	180	360	720	1,800	
11	164	327	655	1,636	
12	150	300	600	1,500	
13	138	277	555	1,385	
14	129	257	514	1,286	
15	120	240	480	1,200	
16	112	225	450	1,125	
17	106	212	424	1,059	
18	100	200	400	1,000	
19	95	189	379	947	
20	90	180	360	900	
21	86	171	343	857	
22	82	164	327	818	
23	78	157	313	783	
24	75	150	300	750	
25	72	144	288	720	
26	69	138	277	692	
27	67	133	267	667	
28	64	129	257	643	
29	62	124	248	621	
30	60	120	240	600	
31	58	116	232	581	
32	56	113	225	563	
33	55	109	218	545	
34	53	106	212	529	
35	51	103	206	514	
36	50	100	200	500	
37	49	97	195	486	
38	47	95	189	474	
39	46	92	185	462	
40	45	90	180	450	
41	44	88	176	440	
42	43	86	172	430	
43	42	84	167	420	
44	41	82	164	410	
45	40	80	160	400	
46	39	78	157	391	
47	38	77	153	383	
48	37	75	150	375	
49	37	73	147	367	

NOTE: To convert to Btu per hour multiply by the Btu heating value of the gas used.

Table XII (Continued)

Gas Input to Burner in Cubic Feet Per Hour

Seconds For One Revolution	One-Half Cu. Ft.	Size of Test I One Cu. Ft. Cubic Feet	Two Cu. Ft.	Five Cu. Ft.
50	36	72	144	360
51	35	71	141	353
52	35	69	138	346
53	34	68	136	340
54	33	67	133	333
55	33	65	131	327
56	32	64	129	321
57	32	63	126	316
58	31	62	124	310
59	30	61	122	305
60	30	60	120	300
62	29	58	116	290
64	29	56	112	281
66	29	54	109	273
68	28	53	106	265
70	26	51	103	257
70 72	25	50	100	250
74 74	24	. 48	97	243
76	24	47	95	237
78 78	23	46	92	231
80	22	45	90	225
82	22	44	88	220
84	21	43	86	214
86	21	42	84	209
88	20	41	82	205
90	20	40	80	200
94	19	38	76	192
98	18	37	74	184
100	18	36	72	180
104	17	35	69	173
108	17	33	67	167
112	16	32	64	161
116	15	31	62	155
120	15	30	60	150
130	14	28	55	138
140	13	26	51	129
150	12	24	48	120
160	11	22	45	112
170	îi	21	42	106
180	10	20	40	100

NOTE: To convert to Btu per hour multiply by the Btu heating value of the gas used.

8.8 Notification of Completion.

When regulations so require, the serving gas supplier or the authority having jurisdiction shall be notified that the installation has been completed.

PART 9

MODIFICATIONS TO EXISTING APPLIANCE INSTALLATIONS FOR THE PURPOSE OF FUEL CONSERVATION

9.1 Safety Inspection.

Prior to attempting any modification, a safety inspection of the existing appliance installation shall be performed by a qualified agency performing the modification. See Appendix H for a recommended procedure for such a safety inspection.

9.2 Reduction of Vent Connector Size.

If an existing vent connector is determined to be oversized for the input rate of the connected appliance, it may be resized in accordance with 7.10.3.

9.3 Automatic Vent Damper Device Installation.

A listed automatic vent damper device may be installed on an existing appliance installation provided the appliance is listed and equipped with a draft hood and provided the device is installed by a qualified agency (see 1.4) in accordance with the terms of its listing. The name of the installer and date of installation shall be marked on a label affixed to the damper device. For recommended procedures for installing automatic vent damper devices on existing appliance installations, see Appendices I, J, and K.

APPENDIX A

LIST OF REFERENCE STANDARDS

(Sources for reference standards, given in A5 of this Appendix, are denoted by superscript numbers.)

A1. Standards for Equipment and Installations Not Within the Scope of This Code

- ANSI/ASME Boiler and Pressure Vessel Code, 1986 Edition, Section III ("Nuclear Power Plant Components"), Division 1-Subsections NB, NC, and ND, Article 3600.²⁻⁶
- ANSI/ASME Code for Pressure Piping^{2,6}
 - B31.1-1986, Power Piping
 - B31.3.1984, Chemical Plant and Petroleum Refinery Piping
 - B31.4-1979, Liquid Petroleum Transportation Piping Systems
 - B31.5-1983, Refrigeration Piping
 - B31.8-1986, Gas Transmission and Distribution Piping Systems
- ANSI/NFPA 51-1987, Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting and Allied Processes^{2,11}
- ANSI/NFPA 59-1984, Standard for the Storage and Handling of Liquefied Petroleum Gases at Utility Gas Plants^{2,11}
- ANSI/NFPA 59A-1985, Standard for the Production, Storage and Handling of Liquefied Natural Gas (LNG)^{2,11}
- ANSI/NFPA 61B-1980, Standard for the Prevention of Fires and Explosions in Grain Elevators and Facilities Handling Bulk Raw Agricultural Commodities^{2,11}

A2. Reference Standards Which May Be Used in Applying This Code

- ANSI A119.2/NFPA 501C-1987, Standard on Recreational Vehicles^{2,11} ANSI A119.4/NFPA 501D-1987, Standard for Recreational Vehicle
- ANSI A119.4/NFPA 501D-1987, Standard for Recreational Vehicle Parks and Campgrounds^{2,11}
- ANSI A225.1-1982, Standard for Manufactured Home Installations (Manufactured Home Sites, Communities and Set-ups)²
- ANSI Z21.8-1984, Standard for Installation of Domestic Gas Conversion Burners^{1,2}
- ANSI Z83.3-1971, and Addenda, Z83.3a-1972 and Z83.3b-1976 (R1983), Standard for Gas Utilization Equipment in Large Boilers^{1,2}
- ANSI/ASME Boiler and Pressure Vessel Code, 1986 Edition, Section IX 1
- ANSI/ASTM D2385-1981, Method of Test for Hydrogen Sulfide and Mercaptan Sulfur in Natural Gas (Cadmium Sulfate Iodometric Titration Method)^{2,4}

ANSI/ASTM D2420-1986, Method of Test for Hydrogen Sulfide in Liquefied Petroleum (LP) Gases (Lead Acetate Method)^{2,4}

ANSI/NFPA 30-1987, Flammable and Combustible Liquids Code^{2,11}

ANSI/NFPA 37-1984, Standard for the Installation and Use of Stationary Combustion Engines and Gas Turbines^{2,11}

ANSI/NFPA 58-1986, Standard for the Storage and Handling of Liquefied Petroleum Gases^{2,11}

ANSI/NFPA 68-1988, Guide for Venting of Deflagrations^{2,11}

ANSI/NFPA 70-1987, National Electrical Code^{2,11}

ANSI/NFPA 82-1983, Standard on Incinerators, Waste and Linen Handling Systems and Equipment^{2,11}

ANSI/NFPA 85A-1987, Standard for the Prevention of Furnace Explosions in Fuel Oil- and Natural Gas-Fired Single Burner Boiler-Furnaces^{2,11}

ANSI/NFPA 85B-1984, Standard for the Prevention of Furnace Explosions in Natural Gas-Fired Multiple Burner Boiler-Furnaces^{2,1}

ANSI/NFPA 86-1985, Standard for Ovens and Furnaces^{2,11}

ANSI/NFPA 88A-1985, Standard for Parking Structures^{2,11}

ANSI/NFPA 88B-1985, Standard for Repair Garages^{2,11}

ANSI/NFPA 90A-1985, Standard for the Installation of Air Conditioning and Ventilating Systems^{2,11}

ANSI/NFPA 90B-1984, Standard for the Installation of Warm Air Heating and Air Conditioning Systems^{2,11}

ANSI/NFPA 96-1987, Standard for the Installation of Equipment for the Removal of Smoke and Grease-Laden Vapors from Commercial Cooking Equipment^{2,11}

ANSI/NFPA 211-1988, Standard for Chimneys, Fireplaces, Vents and Solid Fuel Burning Appliances^{2,11}

ANSI/NFPA 409-1985, Standard on Aircraft Hangars^{2,11}

API Std. 1104-1983, Standard for Welding Pipelines and Related Facilities (16th edition)³

ASHRAE Handbook and Product Directory, Equipment Volume, 1983⁵

AWS B2.1-1984, Standard for Welding Procedure and Performance Qualification⁸

AWS B2.2-1985, Standard for Brazing Procedure and Performance Qualification⁸

Manufactured Home Construction and Safety Standard, Title 24 CFR, Part 3280°

A3. Reference Standards for Material Specifications

Steel Pipe and Tubing

ANSI A21.52-1982, Standard for Ductile-Iron Pipe, Centrifugally Cast, in Metal Molds or Sand-Lined Molds, for Gas^{1,2}

ANSI/ASME B36.10-1985, Standard for Welded and Seamless Wrought-Steel Pipe^{2.6}

ASTM A53-86, Standard Specification for Black and Hot-Dipped, Zinc Coated Welded and Seamless Steel Pipe⁴

ASTM A106-86, Specification for Seamless Carbon Steel Pipe for High-Temperature Service⁴.

ASTM A120-84, Specification for Black and Hot-Dipped Zinc-Coated (Galvanized) Welded and Seamless Steel Pipe for Ordinary Uses⁴

ASTM A254-84, Standard Specification for Copper Brazed Steel Tubing⁴

ASTM A377-84, Specification for Ductile Iron Pressure Pipe⁴

ASTM A539-85, Standard Specification for Electric Resistance-Welded Coiled Steel Tubing for Gas and Fuel Oil Lines⁴

Copper and Brass Pipe and Tubing (For all standards.)4

ASTM B88-86, Specification for Seamless Copper Water Tube

ASTM B280-86, Specification for Seamless Copper Tube for Air Conditioning and Refrigeration Field Service

Aluminum Pipe and Tubing (For all standards.)4

ASTM B210-86, Specification for Aluminum-Alloy Drawn Seamless Tubes

ASTM B241-87, Specification for Aluminum-Alloy Seamless Pipe and Seamless Extruded Tube

Plastic Pipe, Tubing, and Fittings (For all standards.)4

ASTM D2513-86a, Specification for Thermoplastic Gas Pressure Pipe, Tubing, and Fittings

ASTM D2517-81, Specification for Reinforced Epoxy Resin Gas Pressure Pipe and Fittings

Flanges

ANSI B16.1-1975, Standard for Cast Iron Pipe Flanges and Flanged Fittings, Class 25, 125, 250, and 8001.2

ANSI B16.5-1981, Standard for Pipe Flanges and Flanged Fittings, Steel Nickel Alloy and Other Special Alloys^{1,2}

ANSI B16.20-1973, Standard for Ring-Joint Gaskets and Grooves for Steel Pipe Flanges^{1,2}

ANSI/AWWA C111/A21.11-1985, Standard for Rubber Gasket Joints for Ductile-Iron and Gray-Iron Pressure Pipe and Fittings^{2,7}

MSS SP-6-1980, Standard Finishes for Contact Faces of Pipe Flanges and Connecting-End Flanges of Valves and Fittings^{2,7}

Miscellaneous

ANSI/ASME B1.20.1-1983, Standard for Pipe Threads, General Purpose (Inch)^{2.6}

ANSI/ASME Boiler and Pressure Vessel Code (1986 Edition)^{2.6}

ANSI/MSS SP-58-1983, Standard Practice for Pipe Hangers and Supports—Materials, Design and Manufacture^{2,10}

A4. Reference Standards for Equipment and Accessories

Equipment (For all standards).^{1,2}

ANSI Z21.1-1987, Household Cooking Gas Appliances

ANSI Z21.5.1-1982, and Addenda, Z21.5.1a-1987, Gas Clothes Dryers, Volume 1, Type 1 Clothes Dryers

ANSI Z21.5.2-1987, Gas Clothes Dryers, Volume II, Type 2 Clothes Dryers

ANSI Z21.10.1-1987, and Addenda, Z21.10.1a-1988, Gas Water Heaters, Volume I, Storage Water Heaters With Input Ratings of 75,000 Btu Per Hour or Less

ANSI Z21.10.3-1987, and Addenda, Z21.10.3a-1988, Gas Water Heaters, Volume III, Storage with Input Ratings Above 75,000 Btu Per Hour, Circulating and Instantaneous Water Heaters

ANSI Z21.11.1-1983, and Addenda, Z21.11.1a-1985 and Z21.11.1b-1987, *Gas-Fired Room Heaters*, Volume I, Vented Room Heaters ANSI Z21.11.2-1983, and Addenda, Z21.11.2a-1984, *Gas-Fired Room*

Heaters, Volume II, Unvented Room Heaters

ANSI Z21.13-1987, Gas-Fired Low-Pressure Steam and Hot Water Boilers

ANSI Z21.19-1983, and Addenda, Z21.19a-1984, Refrigerators Using Gas Fuel

ANSI Z21.40.1-1981, and Addenda, Z21.40.1a-1982, Gas-Fired Absorption Summer Air Conditioning Appliances

ANSI Z21.42-1971, and Addenda, Z21.42a-1973 and Z21.42b-1981, Gas-Fired Illuminating Appliances

ANSI Z21.44-1985, and Addenda, Z21.44a-1985 and Z21.44b-1987, Gas-Fired Gravity and Fan Type Direct Vent Wall Furnaces

ANSI Z21.47-1987, Gas-Fired Central Furnaces (Except Direct Vent Central Furnaces)

ANSI Z21.48-1986, and Addenda, Z21.48a-1987, Gas-Fired Gravity and Fan Type Floor Furnaces

ANSI Z21.49-1986, and Addenda, Z21.49a-1987, Gas-Fired Gravity and Fan Type Vented Wall Furnaces

ANSI Z21.50-1986, and Addenda, Z21.50a-1987, Vented Decorative Gas Appliances

ANSI Z21.56-1986, and Addenda, Z21.56a-1987, Gas Fired Pool Heaters

ANSI Z21.57-1987, Recreational Vehicle Cooking Gas Appliances

ANSI Z21.58-1987, Outdoor Cooking Gas Appliances

ANSI Z21.60-1981, and Addenda, Z21.60a-1982 and Z21.60b-1984, Decorative Gas Appliances for Installation in Vented Fireplaces

ANSI Z21.61-1983, Gas-Fired Toilets

ANSI Z21.64-1985, and Addenda, Z21.64a-1981 and Z21.64b-1987, Direct Vent Central Furnaces

ANSI Z83.4-1985, and Addenda, Z83.4a-1986, Direct Gas-Fired Make-Up Air Heaters

ANSI Z83.6-1982, and Addenda, Z83.6a-1984 and Z83.6b-1985, Gas-Fired Infrared Heaters

ANSI Z83.8-1985, and Addenda, Z83.8a-1986, Gas Unit Heaters

ANSI Z83.9-1986, Gas-Fired Duct Furnaces

ANSI Z83.11-1986, and Addenda, Z83.11a-1987, Food Service Equipment—Ranges and Unit Broilers

ANSI Z83.12-1986, and Addenda, Z83.12a-1987, Food Service Equipment—Baking and Roasting Ovens

ANSI Z83.13-1986, and Addenda, Z83.13a-1987, Food Service Equipment—Deep Fat Fryers

ANSI Z83.14-1986, and Addenda, Z83.14a-1987, Food Service Equipment—Gas Counter Appliances (Counter- or Floor-Mounted)

ANSI Z83.15-1986, and Addenda, Z83.15a-1987, Food Service Equipment Gas—Fired Kettles, Steam Cookers and Steam Generators

ANSI Z83.16-1982, and Addenda, Z83.16a-1984, Unvented Commercial and Industrial Heaters

Accessories (For all standards.) 1.2

ANSI Z21.2-1983, and Addenda, Z21.2a-1985 and Z21.2b-1987, Gas Hose Connectors for Portable Indoor Gas-Fired Equipment

ANSI Z21.12-1981, and Addenda, Z21.12a-1983, Draft Hoods

ANSI Z21.15-1979, and Addenda, Z21.15a-1981 and Z21.15b-1984, Manually Operated Gas Valves

ANSI Z21.17-1984, Domestic Gas Conversion Burners

ANSI Z21.18-1987, Gas Appliance Pressure Regulators

ANSI Z21.20-1985, and Addenda, Z21.20a-1987, Automatic Gas Ignition Systems and Components

ANSI Z21.21-1987, Automatic Valves for Gas Appliances

ANSI Z21.22-1986, Relief Valves and Automatic Gas Shutoff Devices for Hot Water Supply Systems

ANŠI Z21.23-1980, and Addenda, Z21.23a-1985, Gas Appliance Thermostats

ANSI Z21.24-1987, Metal Connectors for Gas Appliances

ANSI Z21.35-1969, Gas Filters on Appliances

ANSI Z21.41-1978, and Addenda, Z21.41a-1981 and Z21.41b-1983, Quick-Disconnect Devices for Use With Gas Fuel

ANSI Z21.45-1985, and Addenda, Z21.45a-1987, Flexible Connectors of Other Than All-Metal Construction for Gas Appliances

ANSÍ Z21.54-1987, Gas Hose Connectors for Portable Outdoor Gas-Fired Appliances

ANSI Z21.66-1985, Electrically Operated Automatic Vent Damper Devices for Use With Gas-Fired Appliances

ANSI Z21.67-1985, Mechanically Actuated Automatic Vent Damper Devices for Use With Gas-Fired Appliances

ANSI Z21.68-1985, Thermally Actuated Automatic Vent Damper Devices for Use With Gas-Fired Appliances

ANSI Z21.69-1987, Connectors for Movable Gas Appliances ANSI/UL 144-1985, Pressure Regulating Valves for LP-Gas ^{2,12}

A5. Sources for Reference Standards

- American Gas Association, 1515 Wilson Boulevard, Arlington, Virginia 22209.
- American National Standards Institute, Inc., 1430 Broadway, New York, New York 10018.
- American Petroleum Institute, 2101 L Street, N.W., Washington, D.C. 20037.
- 4. American Society for Testing and Materials, 1916 Race Street, Philadelphia, Pennsylvania 19103.
- 5. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc., 1791 Tullie Circle, N.E., Atlanta, Georgia 30329.
- American Society of Mechanical Engineers, United Engineering Center, 345 East 47th Street, New York, New York 10017.
- 7. American Water Works Association (Utilities), 6666 W. Quincy Avenue, Denver, Colorado 80235.
- 8. American Welding Society, 550 N.W. LeJeune Road, Miami, Florida 33126.
- Department of Housing and Urban Development, Washington, D.C. 20410.
- Manufacturers Standardization Society of the Valve & Fittings Industry, 5203 Leesburg Pike, Suite 502, Falls Church, Virginia 22041.
- 11. National Fire Protection Association, Batterymarch Park, Quincy, Massachusetts 02269.
- 12. Underwriters Laboratories Inc., Publication Stock, 333 Pfingsten Rd., Northbrook, Illinois 60062.

APPENDIX B

COORDINATION OF GAS UTILIZATION EQUIPMENT DESIGN, CONSTRUCTION, AND MAINTENANCE

(This Appendix is informative and is not a part of the Code. This checklist may be helpful in the design and selection of gas utilization equipment.)

B1. Coordination.

- **B1.1** Because industrial gas applications are so varied in nature, many agencies are jointly involved with their safe and satisfactory use. Prior to installation, the specific assignments should be agreed upon by the parties concerned. A typical, but not mandatory, delineation of assignments is given in B1.2 through B1.5, and a detailed checklist is given in B2.
- **B1.2** Person or agency planning an installation of gas equipment:
- **B1.2.1** Verifies the adequacy of the gas supply, volume, pressure, and meter location.
 - B1.2.2 Determines suitability of gas for the process.
 - **B1.2.3** Notifies gas suppliers of significant changes in requirements.
- **B1.3** Upon request, the gas supplier furnishes the user complete information on:
- **B1.3.1** Combustion characteristics and physical or chemical properties such as specific gravity, heating value, pressure, and the approximate analysis of the gas.
- **B1.3.2** Conditions under which an adequate supply of gas at suitable pressure can be brought to the site.
 - **B1.3.3** Continuity of the gas supply.
- B1.4 The gas equipment manufacturer or builder provides:
- **B1.4.1** Design and construction of all gas equipment or assemblies shipped from its plant.
- **B1.4.2** Design and construction of all gas equipment fabricated, erected, or assembled by the gas equipment manufacturer or builder in the field.
- **B1.4.3** A statement of the maximum hourly Btu input, type of gas, and design pressure range.
 - **B1.4.4** Written installation and operating instructions for the user.
- **B1.5** The person or agency making and the person or agency authorizing the installation of gas equipment (purchaser) jointly:

- **B1.5.1** Select, erect, or assemble gas equipment, components, or designs purchased or developed by that person or agency.
- **B1.5.2** Assure conformance to codes, ordinances, or regulations applicable to the installation.
 - **B1.5.3** Provide adequate means of disposal of products of combustion.
 - B1.5.4 Initially operate the gas equipment in a safe manner.

B2. Gas Equipment Design and Construction Checklist.

- **B2.1** The basic design and installation should consider:
 - **B2.1.1** Suitability of equipment for process requirements.
 - **B2.1.2** Adequate structural strength and stability.
 - **B2.1.3** Reasonable life expectation.
 - **B2.1.4** Conformance to existing safety standards.
 - **B2.1.5** Adequate combustion space and venting.
 - **B2.1.6** Means for observation and inspection of combustion.
- **B2.2** Materials of construction used, other than pipe, fittings, and valves, should provide reasonable life expectancy for the service intended and be capable of satisfactorily withstanding:
 - **B2.2.1** Operating temperatures.
 - B2.2.2 Chemical action.
 - B2.2.3 Thermal shock.
 - B2.2.4 Load stresses.
- **B2.3** Combustion systems should be selected for the characteristics of the available gas so that they will operate properly at the elevation at point of use and produce:
 - **B2.3.1** Proper heat distribution.
 - **B2.3.2** Adequate operating temperature range.
 - B2.3.3 Suitable flame geometry.
 - **B2.3.4** Flame stability.
 - **B2.3.5** Operating flexibility.
 - **B2.3.6** Desired heating chamber atmosphere.
- **B2.4** Pipe, fittings, and valves shall conform to applicable American National Standards as indicated in 2.6. Piping, bushings, and material in fittings should not be selected nor used until the following factors have been considered:
- **B2.4.1** Correct size to handle required volume (consideration of pressure drop in controls and manifolds is particularly important in low pressure systems).

- **B2.4.2** Material specifications suitable for pressures and temperatures encountered.
 - **B2.4.3** Adequate supports and protection against physical damage.
 - **B2.4.4** Tight assembly and thorough leak inspection.
- **B2.4.5** Use of sufficient unions and flanges, where permitted, for convenient field replacement or repair.
- **B2.4.6** Arrangement of piping to provide accessibility for equipment adjustments and freedom from thermal damage.
- **B2.5** Information concerning the characteristics of the gas and electricity available at the point of utilization should be specific and complete. Gas controls and electrical equipment should be selected to conform to these characteristics which include:
- **B2.5.1** Gas characteristics: Heat content, pressure, specific gravity, and approximate analysis.
- **B2.5.2** Electrical characteristics: voltages, number of phases, and frequencies for both control and power circuits.
- **B2.5.3** Location of electrical equipment and wiring to avoid thermal damage and excessive concentrations of dust, dirt, or foreign material.
- **B2.5.4** Requirements of applicable electrical codes and standards, with particular reference to Article 500 of the *National Electrical Code*, ANSI/NFPA 70.
- **B2.6** Temperature controls, if used, should be carefully selected considering:
 - **B2.6.1** Range and type of instruments and sensing elements.
 - **B2.6.2** Type of control action.
 - **B2.6.3** Suitability for service required.
- **B2.6.4** Correlation of control instruments with operating equipment.
- **B2.7** In enclosed chambers, the accumulation of gas-air or solvent-air mixtures which may be accidentally ignited constitutes a potential hazard to life and property. For this reason, consideration shall be given to the selection and installation of suitable protective equipment. The selection of a satisfactory protective system and components not otherwise covered by existing codes or standards should be based on the requirements of each individual installation after consultation with the various interested parties, including user, designer, insurance company, and local authorities having jurisdiction. Some of the factors and considerations involved in the selection of protective equipment are:
 - **B2.7.1** Feasibility of its installation.
 - **B2.7.2** Its adaptability to process and control requirements.

B2.7.3 Conformance to existing standards, ordinances, requirements, and other regulations which apply. (See Appendix A for listing of standards and specifications.)

B3. Maintenance of Gas Equipment.

- **B3.1** These recommendations are prepared for maintenance of gas equipment. Special types of equipment demand special attention.
- **B3.2** Burners and pilots should be kept clean and in proper operating condition. Burner refractory parts should be examined at frequent regular intervals to assure good condition.
- **B3.3** When automatic flame safeguards are used, a complete shutdown and restart should be made at frequent intervals to check the components for proper operation.

B3.4 Other Safeguard Equipment.

- **B3.4.1** Accessory safeguard equipment, such as manual reset valves with pressure or vacuum switches, high temperature limit switches, draft controls, shutoff valves, air flow switches, door switches, and gas valves, should be operated at frequent regular intervals to insure proper functioning. If inoperative, they should be repaired or replaced promptly.
- **B3.4.2** When fire checks are installed in gas-air mixture piping to prevent flashbacks from traveling farther upstream, the pressure loss across the fire checks should be measured at regular intervals. When excessive pressure loss is found, screens should be removed and cleaned. Water type backfire checks should be inspected at frequent regular intervals and liquid level maintained.
- **B3.4.3** All safety shutoff valves should be checked for leakage and proper operation at frequent regular intervals.
- **B3.5** Auxiliary Devices.
- **B3.5.1** A necessary part of the gas equipment maintenance should be the proper maintenance of auxiliary devices. Maintenance instructions as supplied by the manufacturers of these devices should be followed.
- **B3.5.2** Gas combustion equipment, including blowers, mechanical mixers, control valves, temperature control instruments, air valves, and air filters, should be kept clean and should be examined at frequent regular intervals.
 - **B3.5.3** Necessary repairs and replacements should be made promptly.
- **B3.6** Regulator and zero governor vents and impulse or control piping and tubing should be kept clear. Regulator valves which operate improperly should be cleaned, repaired, or replaced promptly.

- **B3.7** A necessary part of the gas equipment maintenance should be the proper maintenance of the gas piping system. It is recommended that gas piping be inspected and tested for leakage at regular intervals in accordance with the provisions of 4.1.5. Air piping should be kept internally clean to prevent accumulation of dust, lint, and grease in air jets and valves. Where conditions warrant, filters should be installed at the intake to the fans.
- **B3.8** Stand-by or substitute fuel equipment and systems for gas equipment should be kept in good operating condition and tested periodically.
- **B3.9** An adequate supply of repair parts should be maintained.

APPENDIX C

SIZING AND CAPACITIES OF GAS PIPING

(This Appendix is informative and is not a part of the Code.)

In order to determine the size of piping to be used in designing a gas piping system, the following factors must be considered:

- Allowable loss in pressure from point of delivery to equipment.
- b. Maximum gas demand.
- c. Length of piping and number of fittings.
- d. Specific gravity of the gas.
- e. Diversity factor.

For any gas piping system, for special gas utilization equipment, or for conditions other than those covered by Tables C-3 through C-6, C-16, or C-17, such as longer runs, greater gas demands, or greater pressure drops, the size of each gas piping system should be determined by standard engineering practices acceptable to the authority having jurisdiction.

Description of Tables

a. The quantity of gas to be provided at each outlet should be determined, whenever possible, directly from the manufacturer's Btu input rating of the equipment which will be installed. In case the ratings of the equipment to be installed are not known, Table C-1 shows the approximate consumption of average appliances of certain types in Btu per hour.

To obtain the cubic feet per hour of gas required, divide the total Btu input of all equipment by the average Btu heating value per cubic foot of the gas. The average Btu per cubic foot of the gas in the area of the installation may be obtained from the serving gas supplier.

b. Capacities for gas at low pressures (0.5 psig or less) in cubic feet per hour of 0.60 specific gravity gas for different sizes and lengths are shown in Tables C-3 and C-4 for iron pipe or equivalent rigid pipe and in Tables C-5 and C-6 for semi-rigid tubing. Tables C-3 and C-5 are based upon a pressure drop of 0.3 inch water column, whereas Tables C-4 and C-6 are based upon a pressure drop of 0.5 inch water column. In using these tables no additional allowance is necessary for an ordinary number of fittings.

- c. Capacities in thousands of Btu per hour of undiluted liquefied petroleum gases based on a pressure drop of 0.5 inch water column for different sizes and lengths are shown in Table C-16 for iron pipe or equivalent rigid pipe and in Table C-17 for semi-rigid tubing. In using these tables, no additional allowance is necessary for an ordinary number of fittings.
- **d.** Gas piping systems that are to be supplied with gas of a specific gravity of 0.70 or less can be sized directly from Tables C-3 through C-6, unless the authority having jurisdiction specifies that a gravity factor be applied. When the specific gravity of the gas is greater than 0.70, the gravity factor shall be applied.

Application of the gravity factor converts the figures given in Tables C-3 through C-6 to capacities with another gas of different specific gravity. Such application is accomplished by multiplying the capacities given in Tables C-3 through C-6 by the multipliers shown in Table C-15. In case the exact specific gravity does not appear in the table, choose the next higher value specific gravity shown.

Use of Capacity Tables

To determine the size of each section of gas piping in a system within the range of the capacity tables, proceed as follows: (Also see sample calculation at end of Appendix C.)

- 1. Determine the gas demand of each appliance to be attached to the piping system. When Tables C-3 through C-6 are to be used to select the piping size, calculate the gas demand in terms of cubic feet per hour for each piping system outlet. When Tables C-16 or C-17 are to be used to select the piping size, calculate the gas demand in terms of thousands of Btu per hour for each piping system outlet.
- 2. When the piping system is for use with other than undiluted liquefied petroleum gases, determine the design system pressure, the allowable loss in pressure (pressure drop), and the specific gravity of the gas to be used in the piping system.
- 3. Measure the length of piping from the point of delivery to the most remote outlet in the building.
- 4. In the appropriate capacity table, select the column showing the measured length, or the next longer length if the table does not give the exact length. This is the only length used in determining the size of any section of gas piping. If the gravity factor is to be applied, the values in the selected column of the table are multiplied by the appropriate multiplier from Table C-15.

Capacities may also be determined by using the following formulae:*

High Pressure (1.5 psig and above):

Q = 181.6
$$\sqrt{\frac{D^5 \cdot (P_1^2 - P_2^2) \cdot Y}{Cr \cdot fba \cdot L}}$$

= 2237 $D^{2.623} \left[\frac{(P_1^2 - P_2^2) \cdot Y}{Cr \cdot L} \right]^{0.541}$

Low Pressure (less than 1.5 psig):

$$Q = 187.3 \sqrt{\frac{D^5 \cdot \Delta H}{Cr \cdot fba \cdot L}}$$
$$= 2313 D^{2623} \left(\frac{\Delta H}{Cr \cdot L}\right)^{0.541}$$

where

Q = Rate, cu ft per hr at 60 F and 30 in. mercury column

D = Inside diameter of pipe, in.

 P_1 = Upstream pressure, psia

 P_2 = Downstream pressure, psia

Y = Superexpansibility factor[†] = 1/supercompressibility factor

Cr = Factor for viscosity, density and temperature

= 0.00354 ST
$$\left(\frac{Z}{S}\right)^{.152}$$

^{*}For further details on the formulae, refer to "Polyflo Flow Computer," available from Polyflo Company, 3412 High Bluff, Dallas, Texas 75234.

[†]For values for natural gas, refer to "Manual for Determination of Supercompressibility Factors for Natural Gas," available from American Gas Association, 1515 Wilson Boulevard, Arlington, Virginia 22209. For values for liquefied petroleum gases, refer to "Engineering Data Book," available from Gas Processors Association, 1812 First Place, Tulsa, Oklahoma 74102.

S = Specific gravity of gas at 60 F and 30 in. mercury column

T = Absolute temperature, F or

= t + 460

t = Temperature, F

Z = Viscosity of gas, centipoise (0.012 for natural gas, 0.008 for propane), or

 $= 1488 \mu$

 μ = Viscosity, pounds per second ft

fba = Base friction factor for air at 60 F (CF = 1)

L = Length of pipe, ft

 ΔH = Pressure drop, in. water column (27.7" H₂0 = 1 psi)

$$CF = Factor \ CF = \left(\frac{fb}{fba}\right)$$

fb = Base friction factor for any fluid at a given temperature, F

- 5. Use this vertical column to locate ALL gas demand figures for this particular system of piping.
- 6. Starting at the most remote outlet, find in the vertical column just selected the gas demand for that outlet. If the exact figure of demand is not shown, choose the next larger figure below in the column.
- 7. Opposite this demand figure, in the first column at the left, will be found the correct size of gas piping.
- 8. Proceed in a similar manner for each outlet and each section of gas piping. For each section of piping determine the total gas demand supplied by that section.

Table C-1
Approximate Gas Input for Typical Appliances

Appliance	Input Btu per hr. (Approx.)
Range, Free Standing, Domestic	65,000
Built-In Oven or Broiler Unit, Domestic	25,000
Built-In Top Unit, Domestic	40,000
Water Heater, Automatic Storage	
30 to 40 Gal. Tank	45,000
Water Heater, Automatic Storage	,
50 Gal. Tank	55,000
Water Heater, Automatic Instantaneous	•
Capacity $\begin{cases} 2 \text{ gal. per minute} \\ 4 \text{ gal. per minute} \\ 6 \text{ gal. per minute} \end{cases}$	142,800
Capacity { 4 gal. per minute	285,000
6 gal. per minute	428,400
Water Heater, Domestic, Circulating or Side-Arm	35,000
Refrigerator	3,000
Clothes Dryer, Type 1 (Domestic)	35,000
Gas Light	2,500
Incinerator, Domestic	35,000

For specific appliances or appliances not shown above, the input should be determined from the manufacturer's rating.

Table C-2

Equivalent Lengths, in Feet of Straight Pipe, of Bends, Fittings, and Valves

The equivalent lengths in feet shown in Table C-2* have been computed on a basis that the inside diameter corresponds to that of Schedule 40 (standard-weight) steel pipe, which is close enough for most purposes involving other schedules of pipe. Where a more specific solution for equivalent length is desired, this may be made by multiplying the actual inside diameter of the pipe in inches by n/12, or the actual inside diameter in feet by n. N can be read from the table heading. The equivalent length values can be used with reasonable accuracy for copper or brass fittings and bends. For copper or brass valves, however, the equivalent length of pipe should be taken as 45 percent longer than the values in the table which are for steel pipe. Resistance per foot of copper or brass pipe is less than that of steel.

^{*}From PIPING HANDBOOK, by Sabin Crocker. 4th Ed., Copyright, 1945 by McGraw-Hill, Inc., Table XIV, pp. 100-101. Used by permission of McGraw-Hill Book Company.

Table C-2

		S	crewed 1	ittings ²			90° we sn	lding 100th					
		45° ell	90° ell	180° close return bends	Tee	R/d = 1	$R/d = 1\frac{1}{3}$	R/d = 2	R/d = 4	R/d = 6	R/d = 8		
k factor =		0.42	0.90	2.00	1.80	0.48	0.36	0.27	0.21	0.27	0.36		
L/d' ratio ⁵ $n =$		14	30	67	60	16	12	9	7	9	12		
Nominal pipe size, in.	Inside diam. d, in., Sched. 407		₽	4		0	0						
			$L = e^{\epsilon}$			gth in feet of Schedule 40 eight) straight pipe ⁷							
1/2 3/4 1 1 1/4 1 1/2	0.622 0.824 1.049 1.380 1.610	0.73 0.96 1.22 1.61 1.88	1.55 2.06 2.62 3.45 4.02	3.47 4.60 5.82 7.66 8.95	3.10 4.12 5.24 6.90 8.04	0.83 1.10 1.40 1.84 2.14	0.62 0.82 1.05 1.38 1.61	0.47 0.62 0.79 1.03 1.21	0.48	0.79 1.03	0.82 1.05		
2 2 ¹ / ₂ 3 4 5	2.067 2.469 3.068 4.026 5.047	2.41 2.88 3.58 4.70 5.88	5.17 6.16 7.67 10.1 12.6	11.5 13.7 17.1 22.4 28.0	10.3 12.3 15.3 20.2 25.2	2.76 3.29 4.09 5.37 6.72	2.07 2.47 3.07 4.03 5.05	1.55 1.85 2.30 3.02 3.78		2.30 3.02	2.47		
6 8 10 12 14	6.065 7.981 10.02 11.94 13.13	7.07 9.31 11.7 13.9 15.3	15.2 20.0 25.0 29.8 32.8	33.8 44.6 55.7 66.3 73.0	30.4 40.0 50.0 59.6 65.6	15.9 17.5	6.07 7.98 10.0 11.9 13.1	5.98 7.51 8.95 9.85	4.65 5.85 6.96 7.65	7.51 8.95 9.85	7.98 10.0 11.9 13.1		
16 18 20 24	15.00 16.88 18.81 22.63	17.5 19.7 22.0 26.4	37.5 42.1 47.0 56.6	83.5 93.8 105 126	75.0 84.2 94.0 113	20.0 22.5 25.1 30.2	15.0 16.9 18.8 22.6	11.2 12.7 14.1 17.0	9.85 11.0	12.7	18.8		

- Values for welded fittings are for conditions where bore is not obstructed by weld spatter or backing rings. If appreciably obstructed, use values for "Screwed Fittings."
- Flanged fittings have three-fourths the resistance of screwed elbows and tees.
- 3. Tabular figures give the extra resistance due to curvature alone to which should be added the full length of travel.

Table C-2 (Continued)

					•		•			
Mit	er elbo	ws4 (No	. of mit	ers)	Weldir	ıg tees	(screw	Va ed, flan	lves ged, or	welded)
1-45°	1-60°	1-90°	2-90°	3-90°	Forged	Miter ⁴	Gate	Globe	Angle	Swing check
0.45	0.90	1.80	0.60	0.45	1.35	1.80	0.21	10	5.0	2.5
15	30	60	20	15	45	60	7	333	167	83
\Diamond	A	尸	« (\)	° Ø		Q				ä
<i>L</i> =	equiva	lent ler	ngth in	feet of	Schedule	e 40 (sta	ndard	weight)	straight	pipe ⁷
0.78 1.03 1.31 1.72 2.01	1.55 2.06 2.62 3.45 4.02	3.10 4.12 5.24 6.90 8.04	1.04 1.37 1.75 2.30 2.68	0.78 1.03 1.31 1.72 2.01	2.33 3.09 3.93 5.17 6.04	3.10 4.12 5.24 6.90 8.04	0.36 0.48 0.61 0.81 0.94	17.3 22.9 29.1 38.3 44.7	8.65 11.4 14.6 19.1 22.4	4.32 5.72 7.27 9.58 11.2
2.58 3.08 3.84 5.04 6.30	5.17 6.16 7.67 10.1 12.6	10.3 12.3 15.3 20.2 25.2	3.45 4.11 5.11 6.71 8.40	2.58 3.08 3.84 5.04 6.30	7.75 9.25 11.5 15.1 18.9	10.3 12.3 15.3 20.2 25.2	1.21 1.44 1.79 2.35 2.94	57.4 68.5 85.2 112 140	28.7 34.3 42.6 56.0 70.0	14.4 17.1 21.3 28.0 35.0
7.58 9.97 12.5 14.9 16.4	15.2 20.0 25.0 29.8 32.8	30.4 40.0 50.0 59.6 65.6	10.1 13.3 16.7 19.9 21.9	7.58 9.97 12.5 14.9 16.4	22.8 29.9 37.6 44.8 49.2	30.4 40.0 50.0 59.6 65.6	3.54 4.65 5.85 6.96 7.65	168 222 278 332 364	84.1 111 139 166 182	42.1 55.5 69.5 83.0 91.0
18.8 21.1 23.5 28.3	37.5 42.1 47.0 56.6	75.0 84.2 94.0 113	25.0 28.1 31.4 37.8	18.8 21.1 23.5 28.3	56.2 63.2 70.6 85.0	75.0 84.2 94.0 113	8.75 9.85 11.0 13.2	417 469 522 629	208 234 261 314	104 117 131 157

- 4. Small size socket-welding fittings are equivalent to miter elbows and miter tees.
- 5. Equivalent resistance in number of diameters of straight pipe computed for a value of f = 0.0075 from the relation n = k/4f.
- 6. For condition of minimum resistance where the center-line length of each miter is between d and 21/1d.
- 7. For pipe having other inside diameters, the equivalent resistance may be computed from the above n values.

Table C-3

Maximum Capacity of Pipe in Cubic Feet of Gas per Hour for Gas Pressures of 0.5 Psig or Less and a Pressure Drop of 0.3 Inch Water Column

(Based on a 0.60 Specific Gravity Gas)

Nominal Iron Pipe Size,	Internal Diameter,		Length of Pipe, Feet												
Inches	Inches	10	20	30	40	50	60	70	80	90	100	125	150	175	200
1/4	.364	32	22	18	15	14	12	11	11	10	9	8	8	7	6
3/8	.493	72	49	40	34	30	27	25	23	22	21	18	17	15	14
1/2	.622	132	92	73	63	56	50	46	43	40	38	34	31	28	26
3/4	.824	278	190	152	130	115	105	96	90	84	79	72	64	59	55
1	1.049	520	350	285	245	215	195	180	170	160	150	130	120	110	100
1 1/4	1.380	1,050	730	590	500	440	400	370	350	320	305	275	250	225	210
1 1/2	1.610	1,600	1,100	890	760	670	610	560	530	490	460	410	380	350	320
2	2.067	3,050	2,100	1,650	1,450	1,270	1,150	1,050	990	930	870	780	710	650	610
21/2	2.469	4,800	3,300	2,700	2,300	2,000	1,850	1,700	1,600	1,500	1,400	1,250	1,130	1,050	980
3	3.068	8,500	5,900	4,700	4,100	3,600	3,250	3,000	2,800	2,600	2,500	2,200	2,000	1,850	1,700
4	4.026	17,500	12,000	9,700	8,300	7,400	6,800	6,200	5,800	5,400	5,100	4,500	4,100	3,800	3,500

Table C-4

Maximum Capacity of Pipe in Cubic Feet of Gas per
Hour for Gas Pressures of 0.5 Psig or Less and a
Pressure Drop of 0.5 Inch Water Column

(Based on a 0.60 Specific Gravity Gas)

Nominal Iron Pipe Size,	Internal Diameter.	Length of Pipe, Feet													
Inches	Inches	10	20	30	40	50	60	70	80	90	100	125	150	175	200
1/4	.364	43	29	24	20	18	· 16	15	14	13	12	11	10	9	8
3/8	.493	95	65	52	45	40	36	33	31	29	27	24	22	20	19
1/2	.622	175	120	97	82	73	66	61	57	53	50	44	40	37	35
3/4	.824	360	250	200	170	151	138	125	118	110	103	93	84	77	72
1	1.049	680	465	375	320	285	260	240	220	205	195	175	160	145	135
11/4	1.380	1,400	950	770	660	580	530	490	460	430	400	360	325	300	280
11/2	1.610	2,100	1,460	1,180	990	900	810	750	690	650	620	550	500	460	430
2	2.067	3,950	2,750	2,200	1,900	1,680	1,520	1,400	1,300	1,220	1,150	1,020	950	850	800
21/2	2.469	6,300	4,350	3,520	3,000	2,650	2,400	2,250	2,050	1,950	1,850	1,650	1,500	1,370	1,280
3	3.068	11,000	7,700	6,250	5,300	4,750	4,300	3,900	3,700	3,450	3,250	2,950	2,650	2,450	2,280
4	4.026	23,000	15,800	12,800	10,900	9,700	8,800	8,100	7,500	7,200	6,700	6,000	5,500	5,000	4,600

Table C-5

Maximum Capacity of Semi-Rigid Tubing in Cubic Feet of Gas per Hour for Gas Pressures of 0.5 Psig or Less and a Pressure Drop of 0.3 Inch Water Column

(Based on a 0.60 Specific Gravity Gas)

Outside Diameter,		Length of Tubing, Feet													
Inch	10	20	30	40	50	60	70	80	90	100	125	150	175	200	
3/8	20	14	11	10	9	8	7	7	6	6	5	5	4	4	
1/2	42	29	23	20	18	16	15	14	13	12	11	10	9	8	
5/8	86	59	47	40	36	33	30	28	26	25	22	20	18	17	
3/4	150	103	83	71	63	57	52	49	46	43	38	35	32	30	
7/8	212	146	117	100	89	81	74	69	65	61	54	49	45	42	

Table C-6

Maximum Capacity of Semi-Rigid Tubing in Cubic Feet of Gas per Hour for Gas Pressures of 0.5 Psig or Less and a Pressure Drop of 0.5 Inch Water Column

(Based on a 0.60 Specific Gravity Gas)

Outside Diameter,		Length of Tubing, Feet													
Inch	10	20	30	40	50	60	70	80	90	100	125	150	175	200	
3/8	27	18	15	13	11	10	9	9	8	8	7	6	6	5	
1/2	56	38	31	26	23	21	19	18	17	16	14	13	12	11	
5/8	113	78	62	53	47	43	39	37	34	33	29	26	24	22	
3/4	197	136	109	93	83	75	69	64	60	57	50	46	42	39	
7/8	280	193	155	132	117	106	98	91	85	81	71	65	60	55	

Table C-7

Pipe Sizing Table for Pressures Under 1 Pound
Approximate Capacity of Pipes of Different Diameters and
Lengths in Cubic Feet per Hour With Pressure Drop of
0.3 Inch Water Column and 0.6 Specific Gravity

Pipe Size of Schedule 40 Standard Pipe	Internal	Internal Total Equivalent Length of Pipe in Feet											
(Inches)	(Inches)	50	100	150	200	250	300	400	500	1000	1500	2000	
1.00	1.049	215	148	119	102	90	82	70	62	43	34	29	
1.25	1.380	442	304	244	209	185	168	143	127	87	70	60	
1.50	1.610	662	455	366	313	277	251	215	191	131	105	90	
2.00	2.067	1275	877	704	602	534	484	414	367	252	203	173	
2.50	2.469	2033	1397	1122	960	851	771	660	585	402	323	276	
3.00	3.068	3594	2470	1983	1698	1505	1363	1167	1034	711	571	488	
3.50	3.548	5262	3616	2904	2485	2203	1996	1708	1514	1041	836	715	
4.00	4.026	7330	5038	4046	3462	3069	2780	2380	2109	1450	1164	996	
5.00	5.047	13261	9114	7319	6264	5552	5030	4305	3816	2623	2106	1802	
6.00	6.065	21472	14758	11851	10143	8990	8145	6971	6178	4246	3410	2919	
8.00	7.981	44118	30322	24350	20840	18470	16735	14323	12694	8725	7006	5997	
10.00	10.020	80130	55073	44225	37851	33547	30396	26015	23056	15847	12725	10891	
12.00	11.938	126855	87187	70014	59923	53109	48120	41185	36501	25087	20146	17242	